



Dr. Walter Pickel

Coal & Organic Petrology Services Pty Ltd

PO Box 174

Sans Souci, NSW 2219

AUSTRALIA

E-mail:

walter.pickel_(at)_organicpetrology.com


Tel.: +61 2 9524 0403

Fax: +61 2 9526 70

RIC 2010

Exercise of the standardization
WG of the ICCP

Convener: Walter Pickel

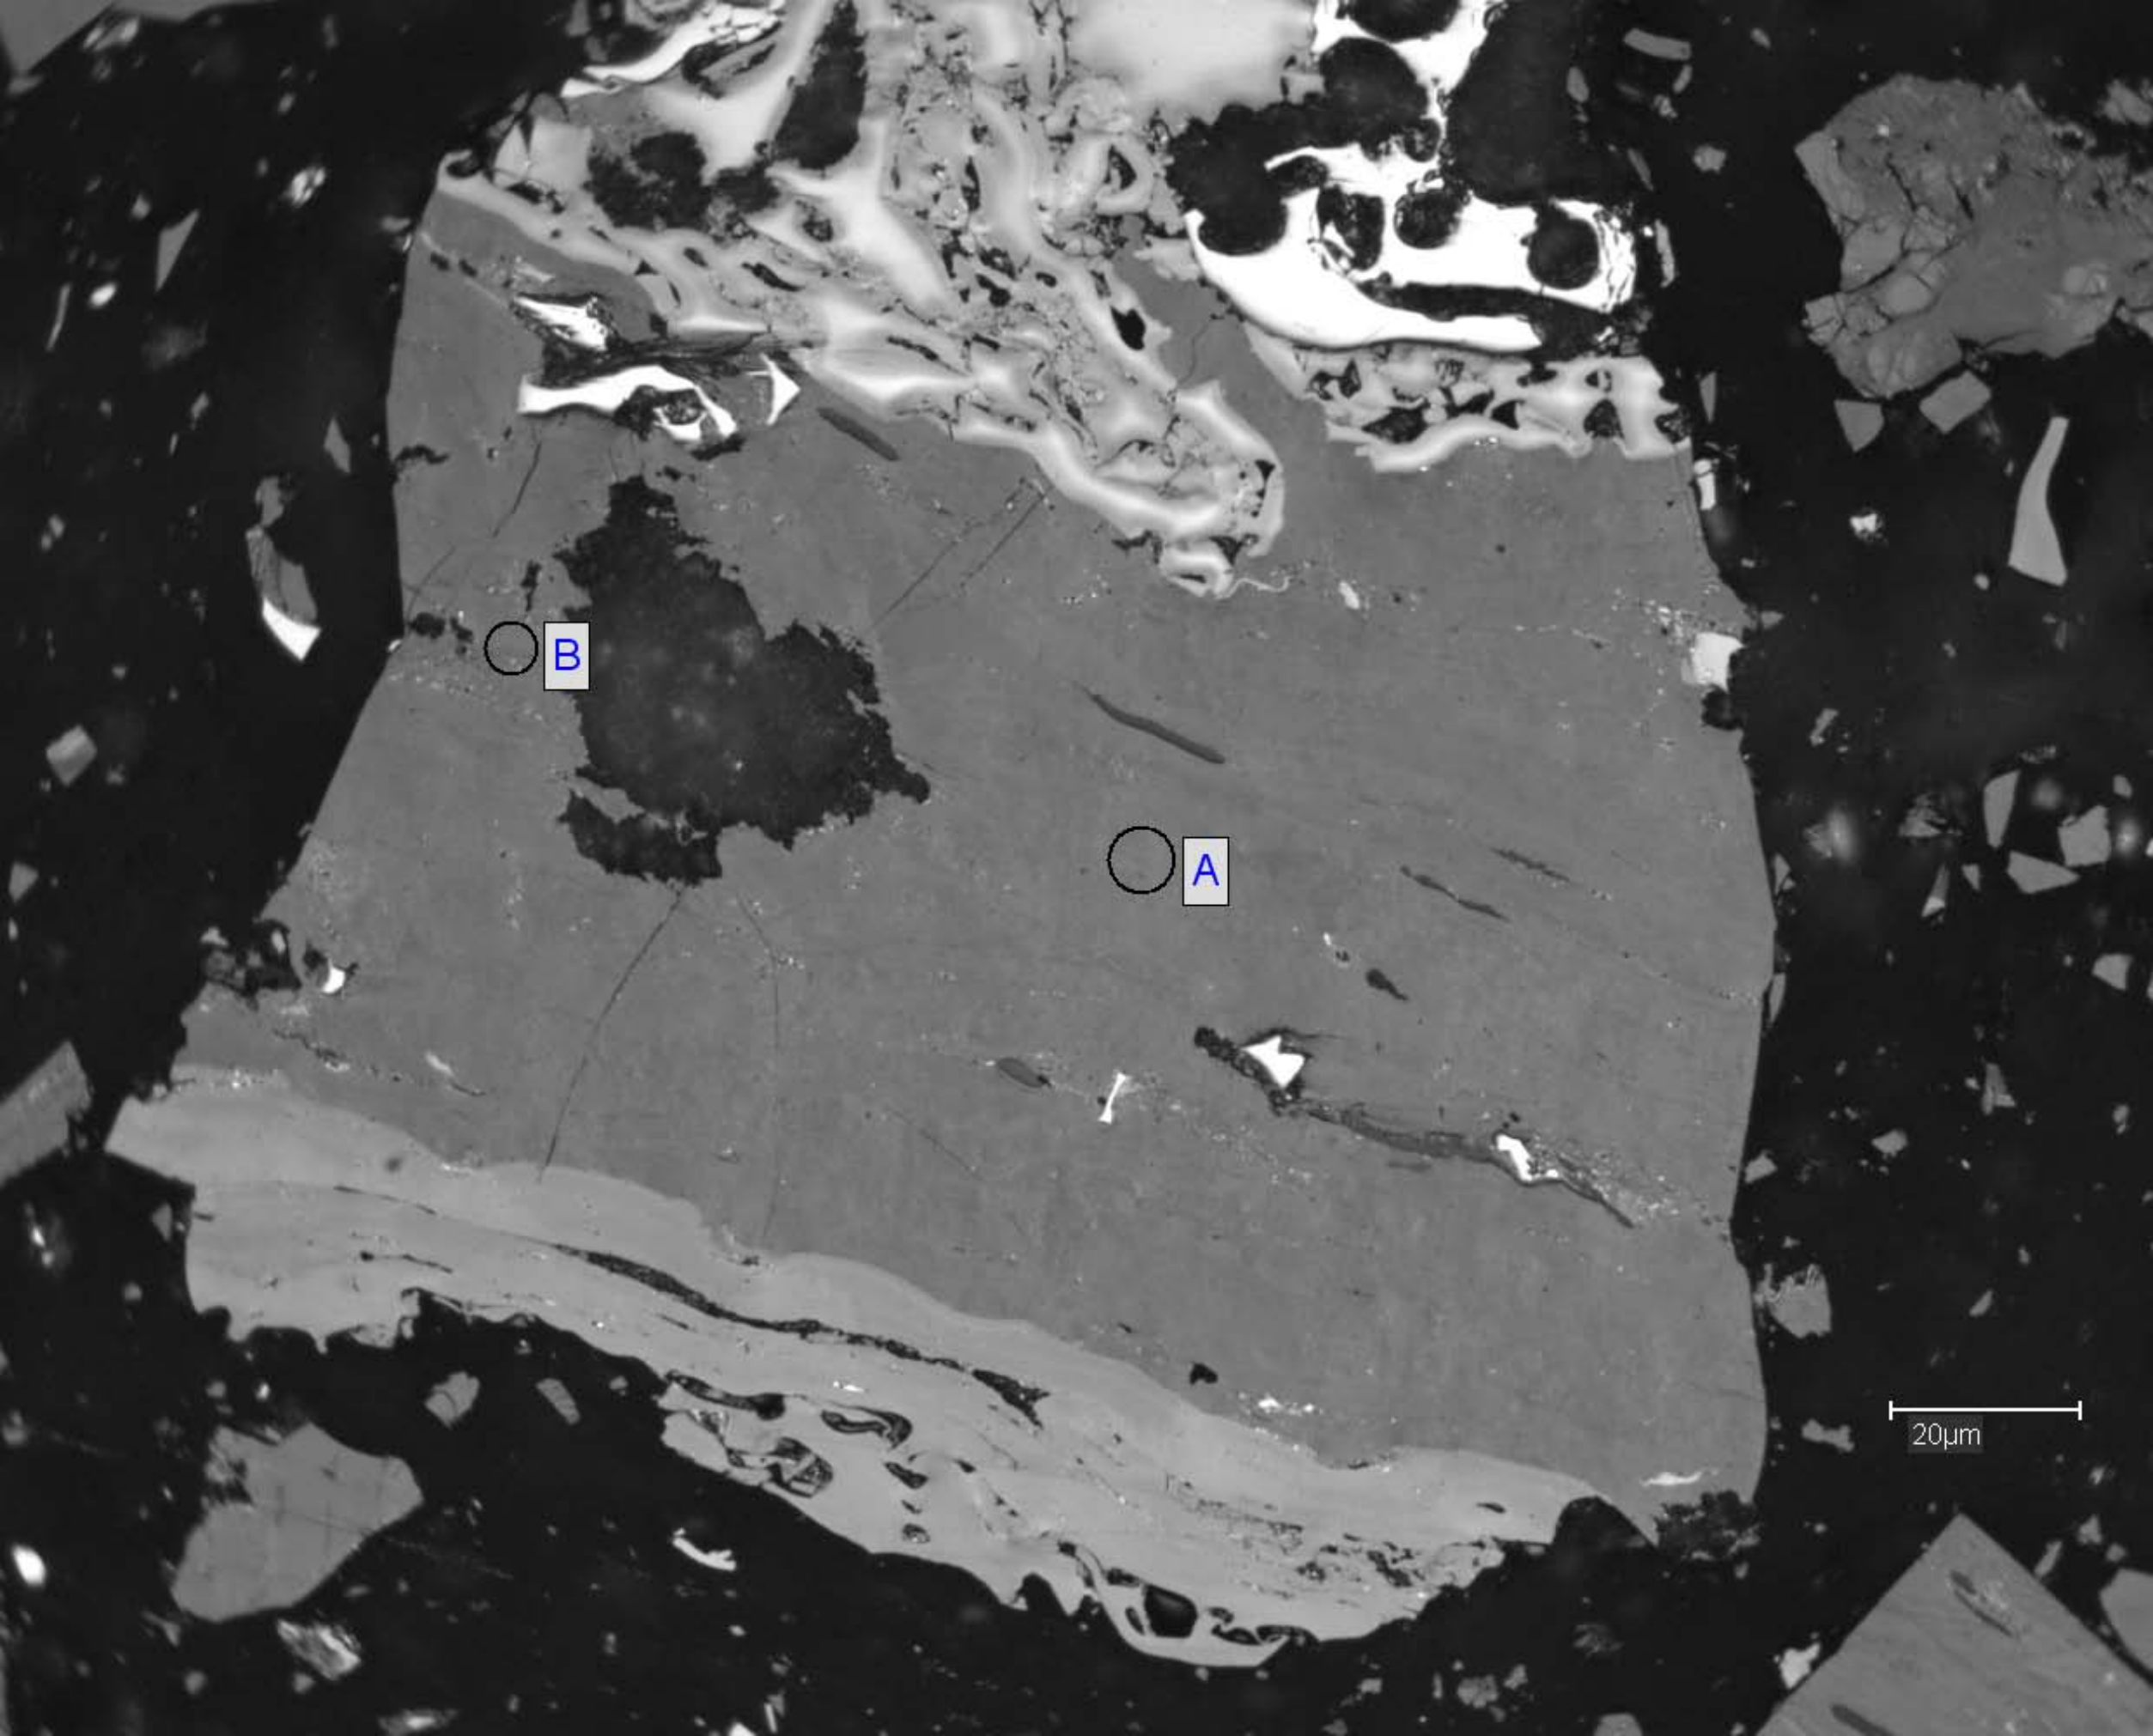

○ B

○ A


20µm


20μm

A

B

C

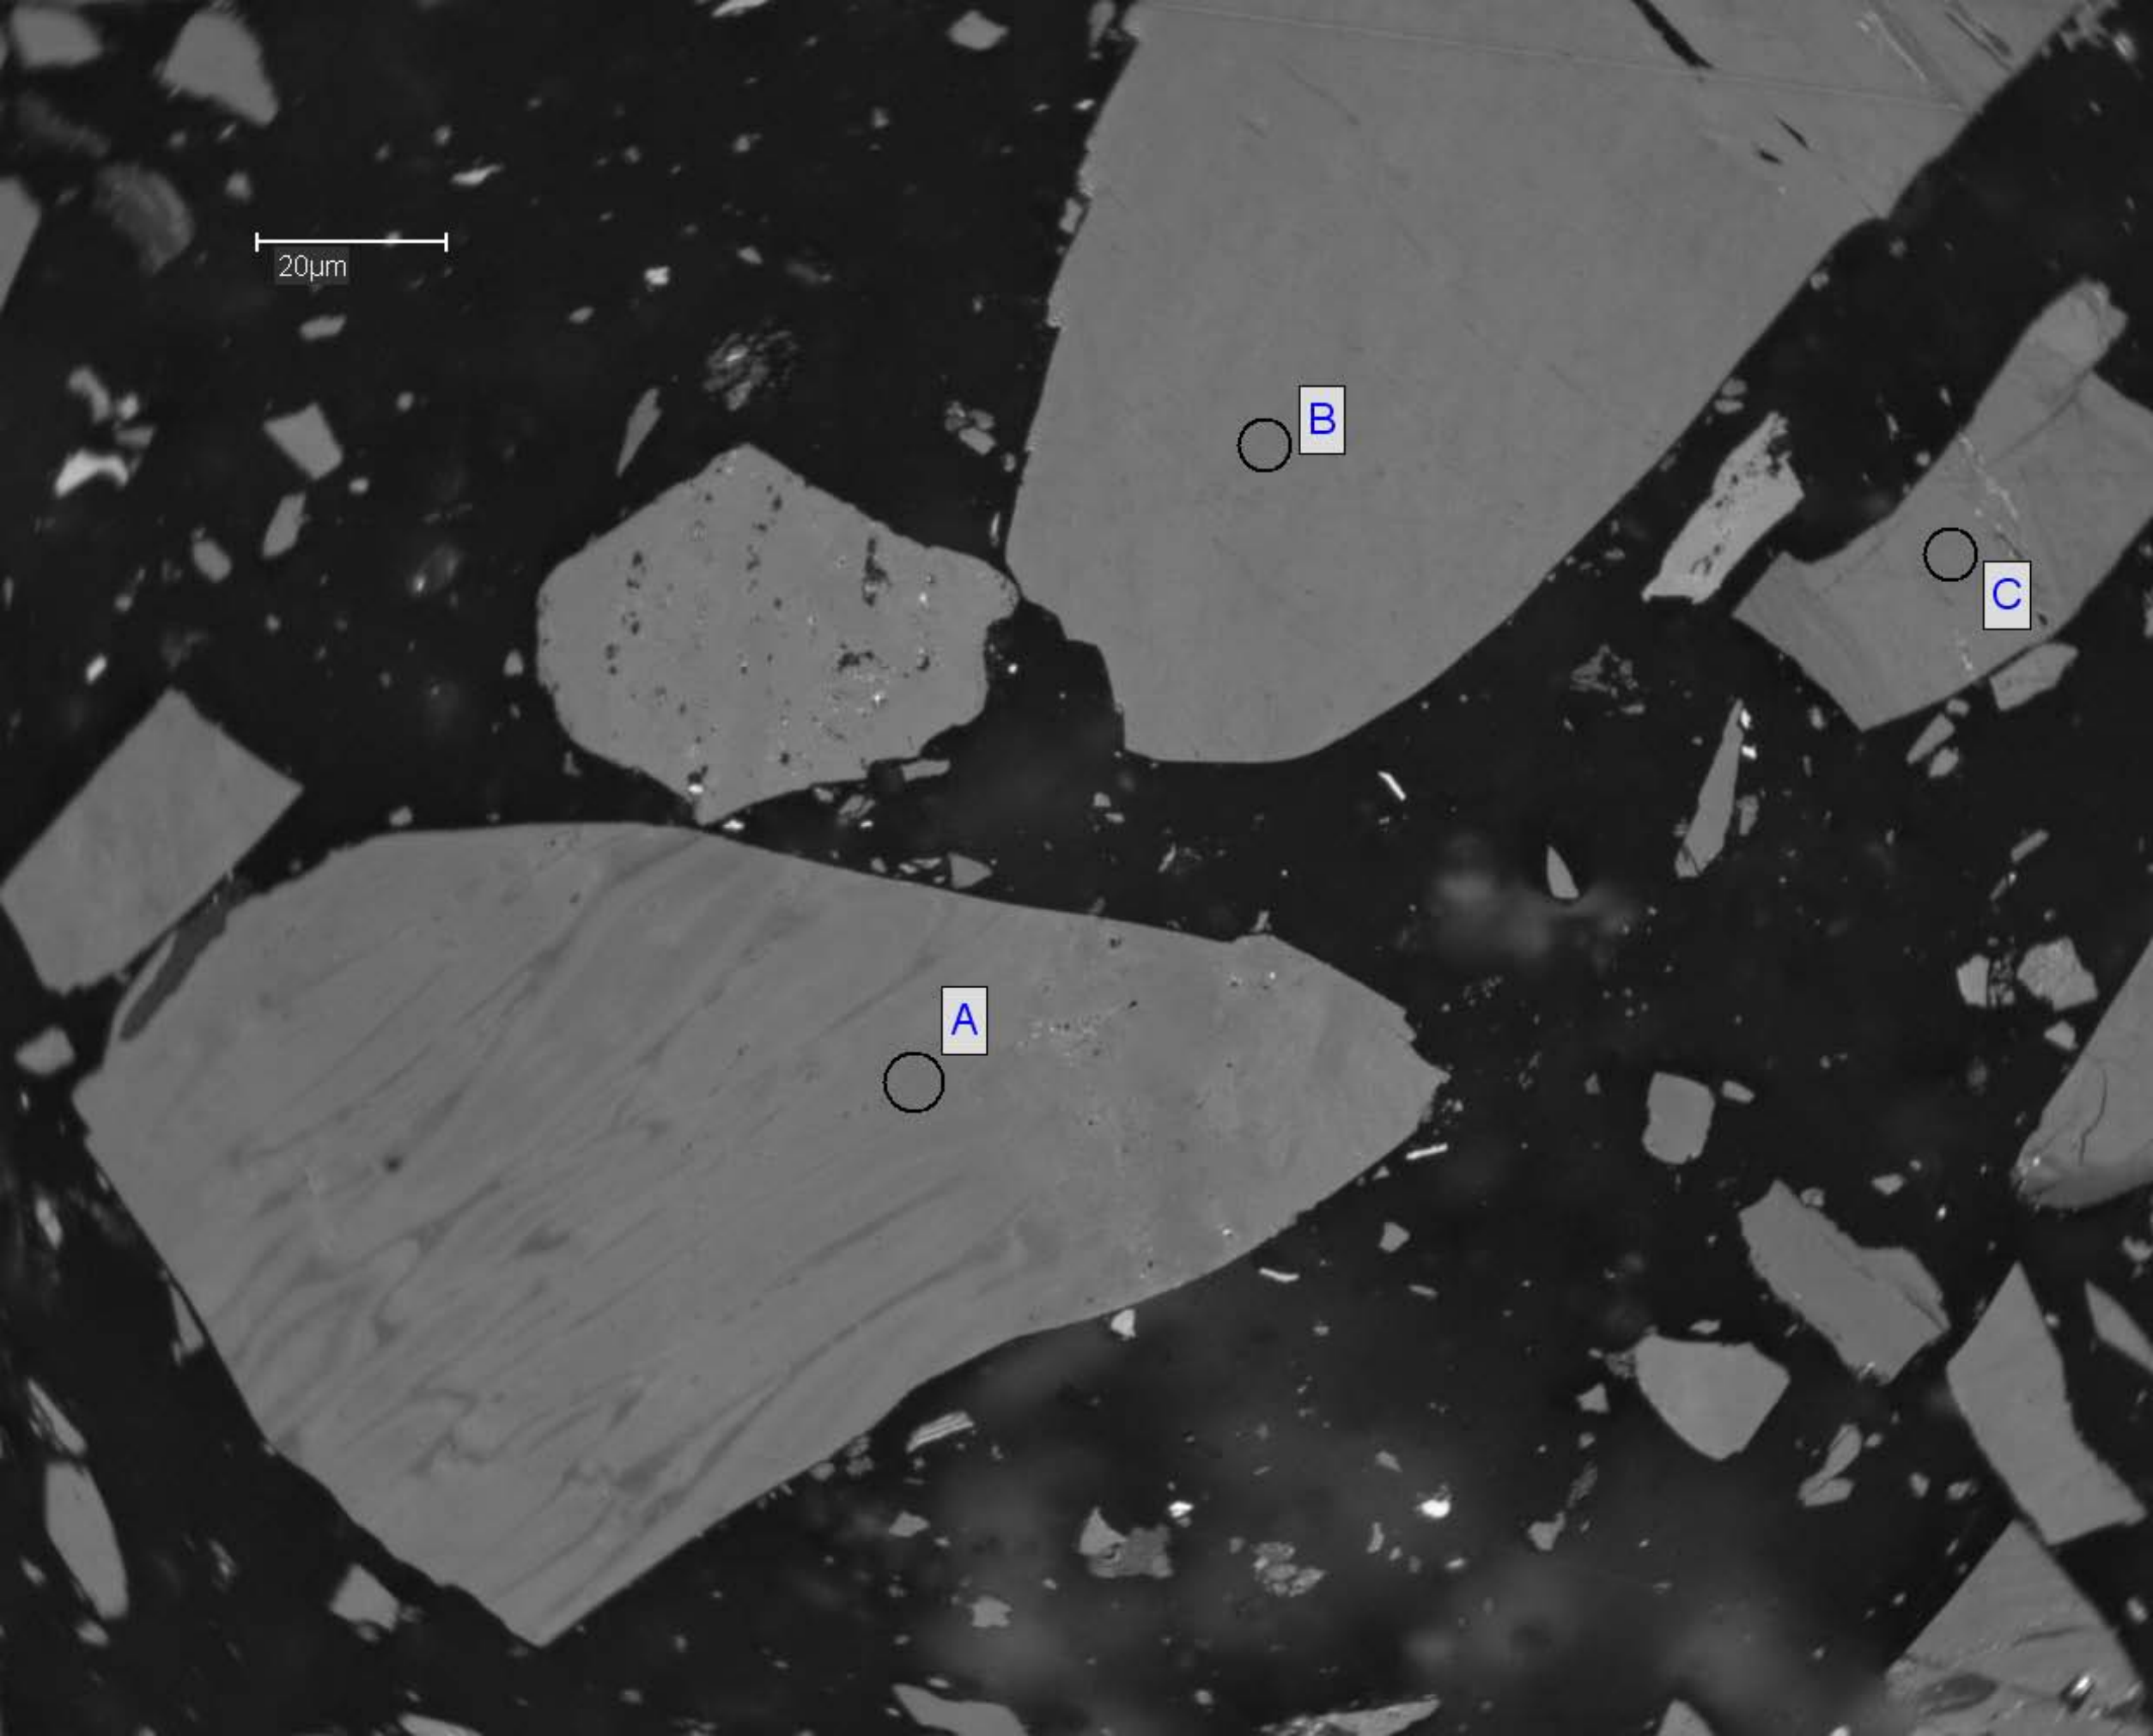

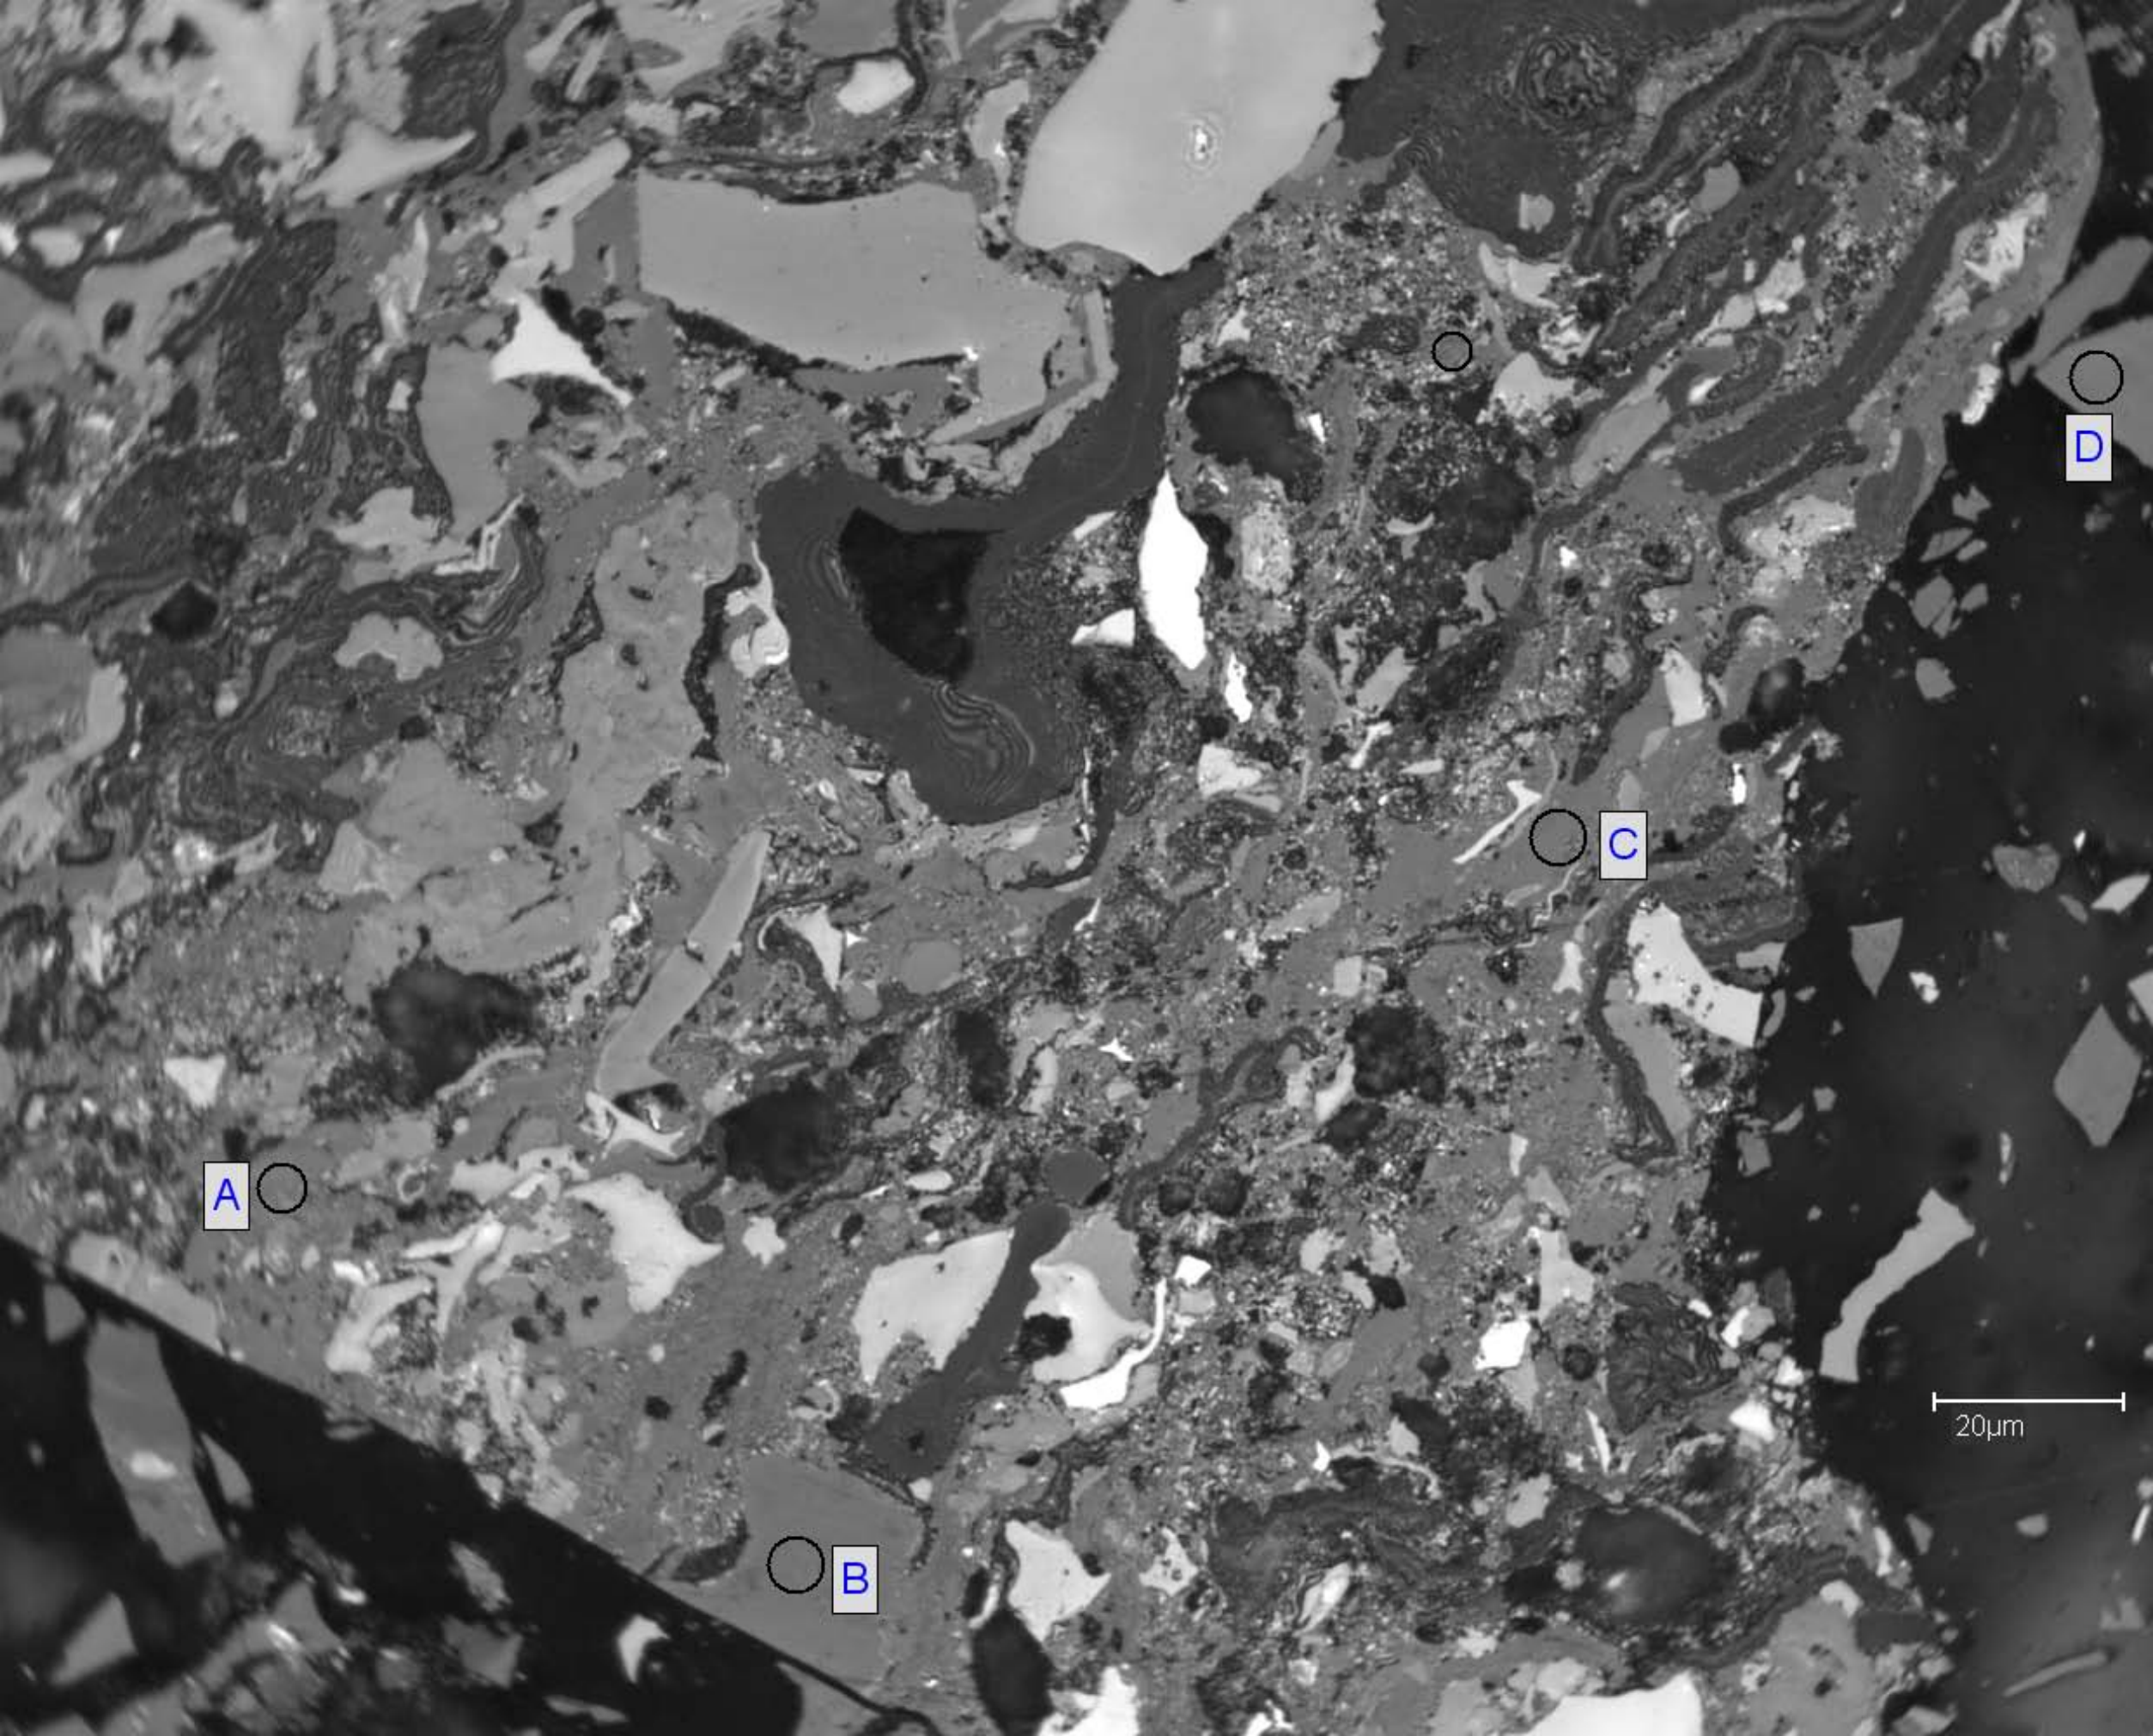


A

B

C

D

20µm

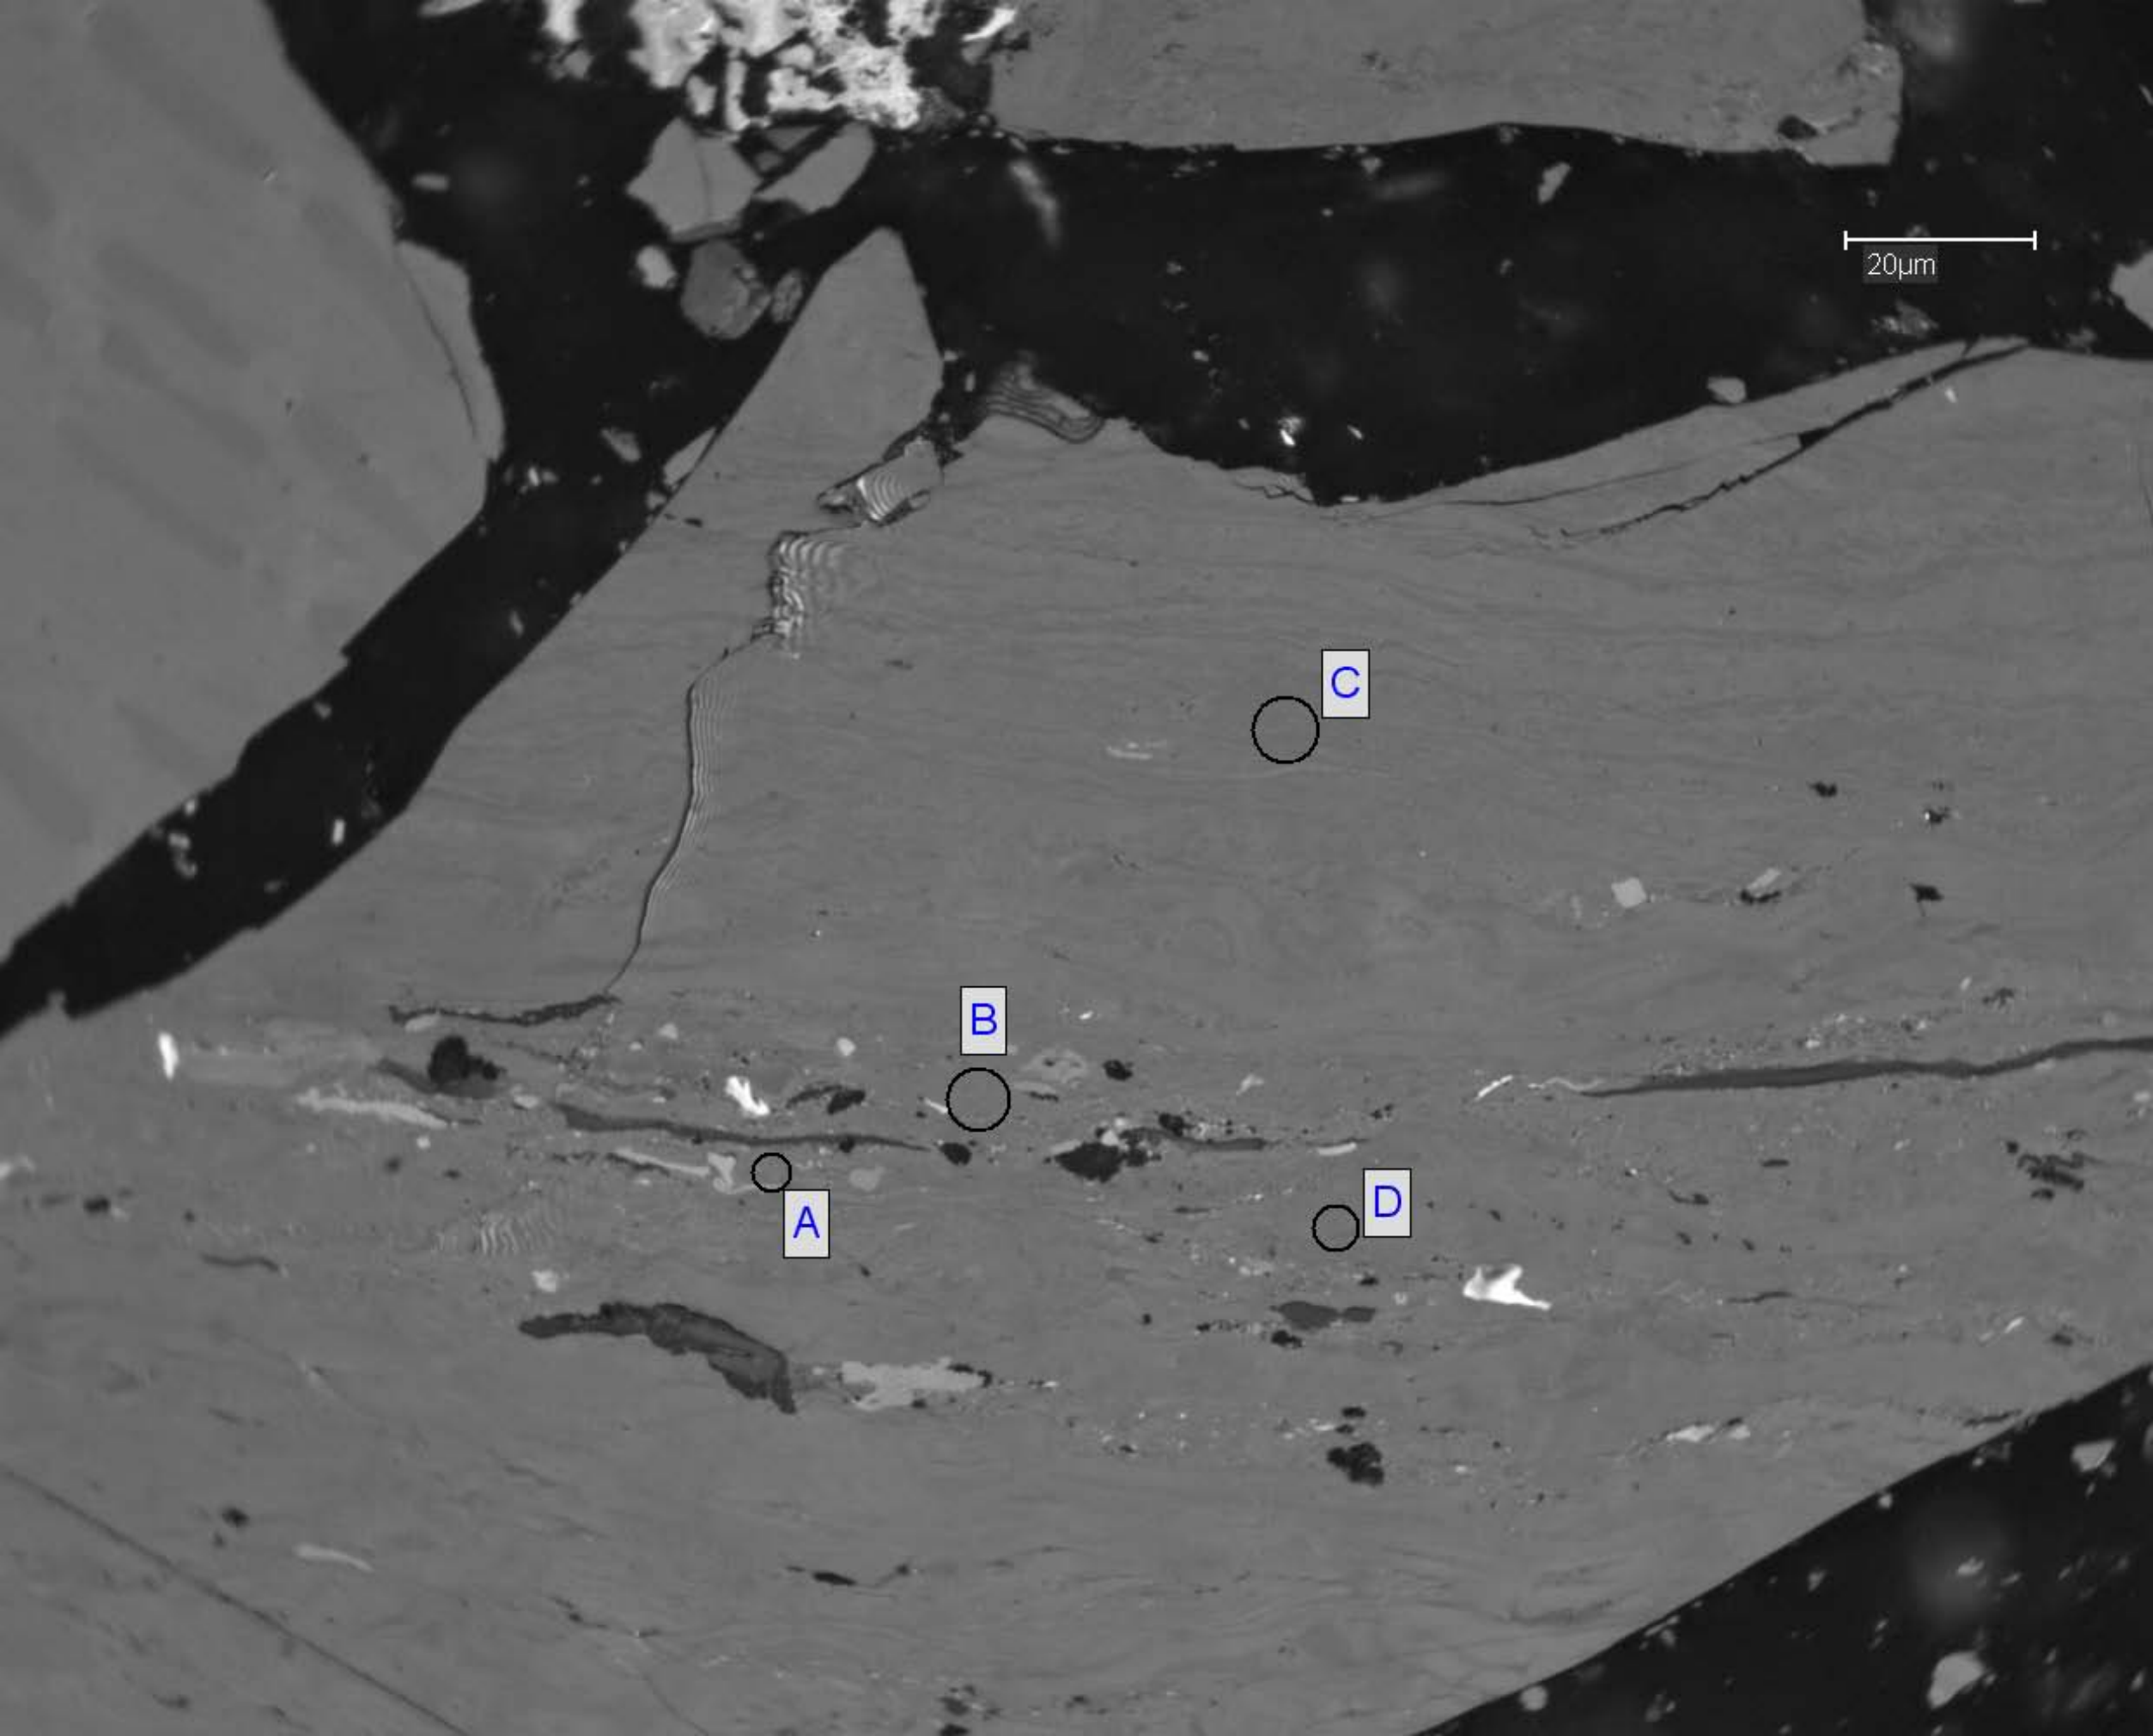

20µm

C

B

A

D

20µm

A

B

C


D


E

F

G

H

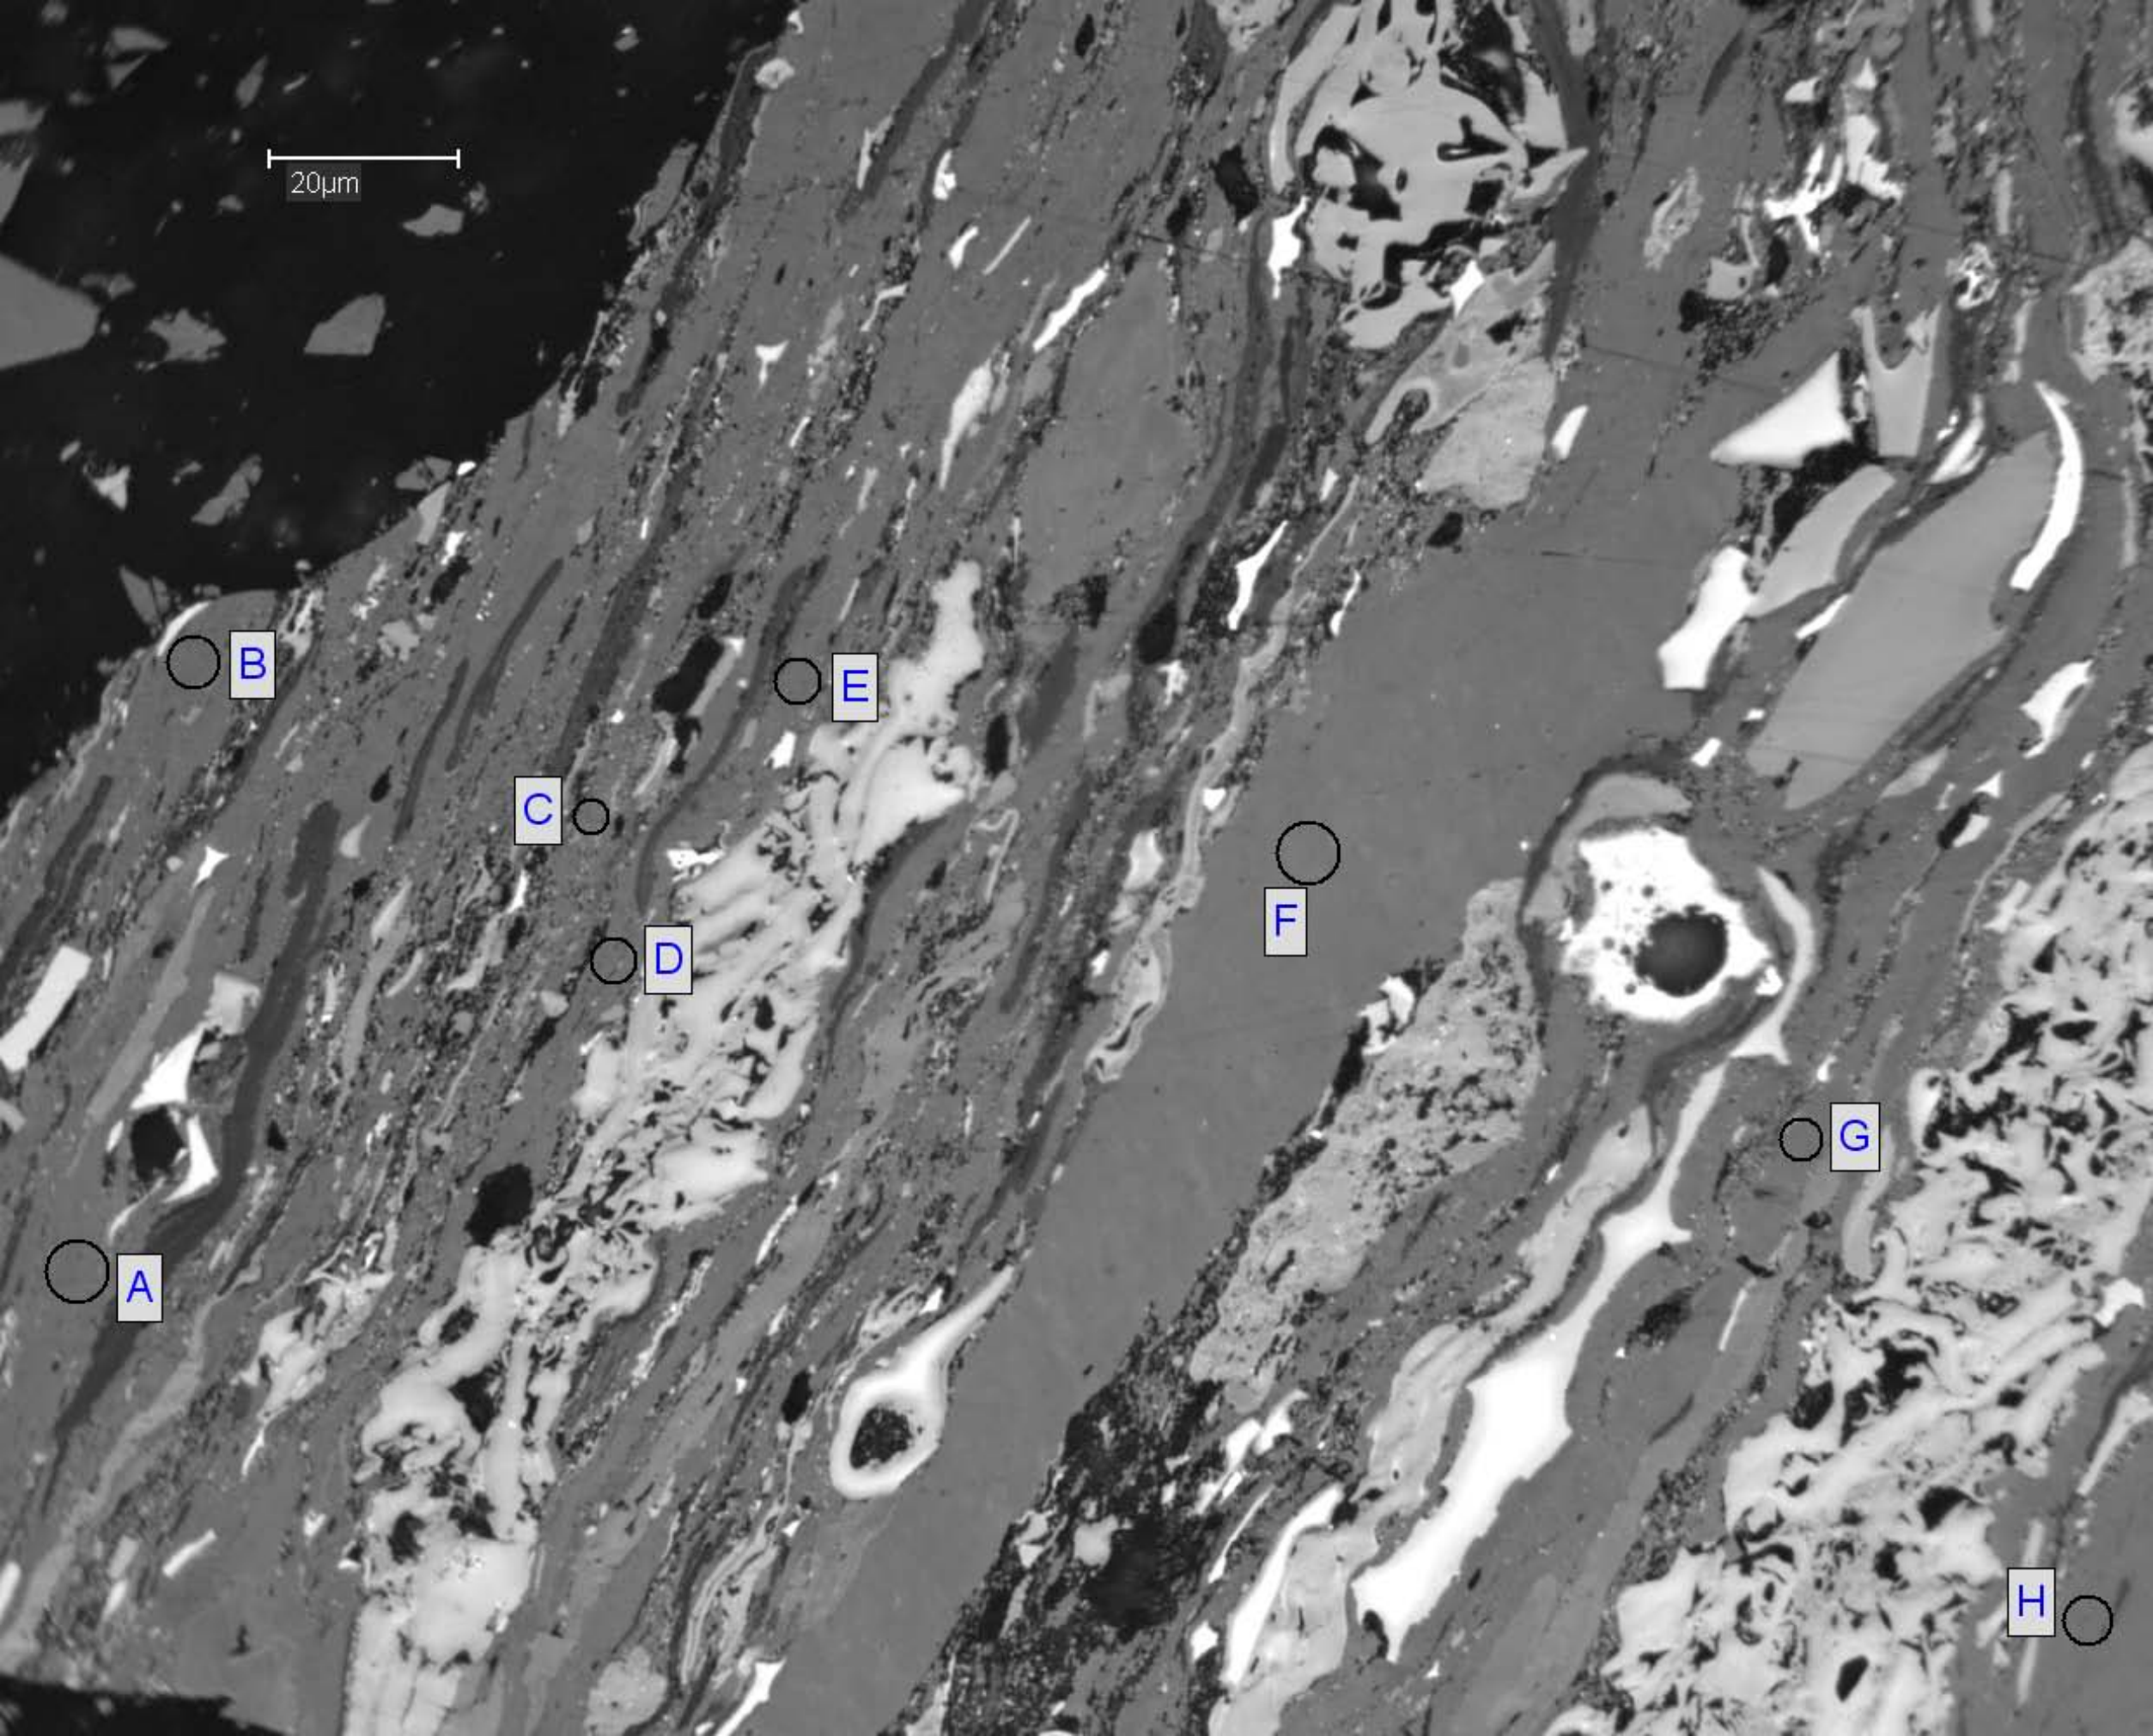

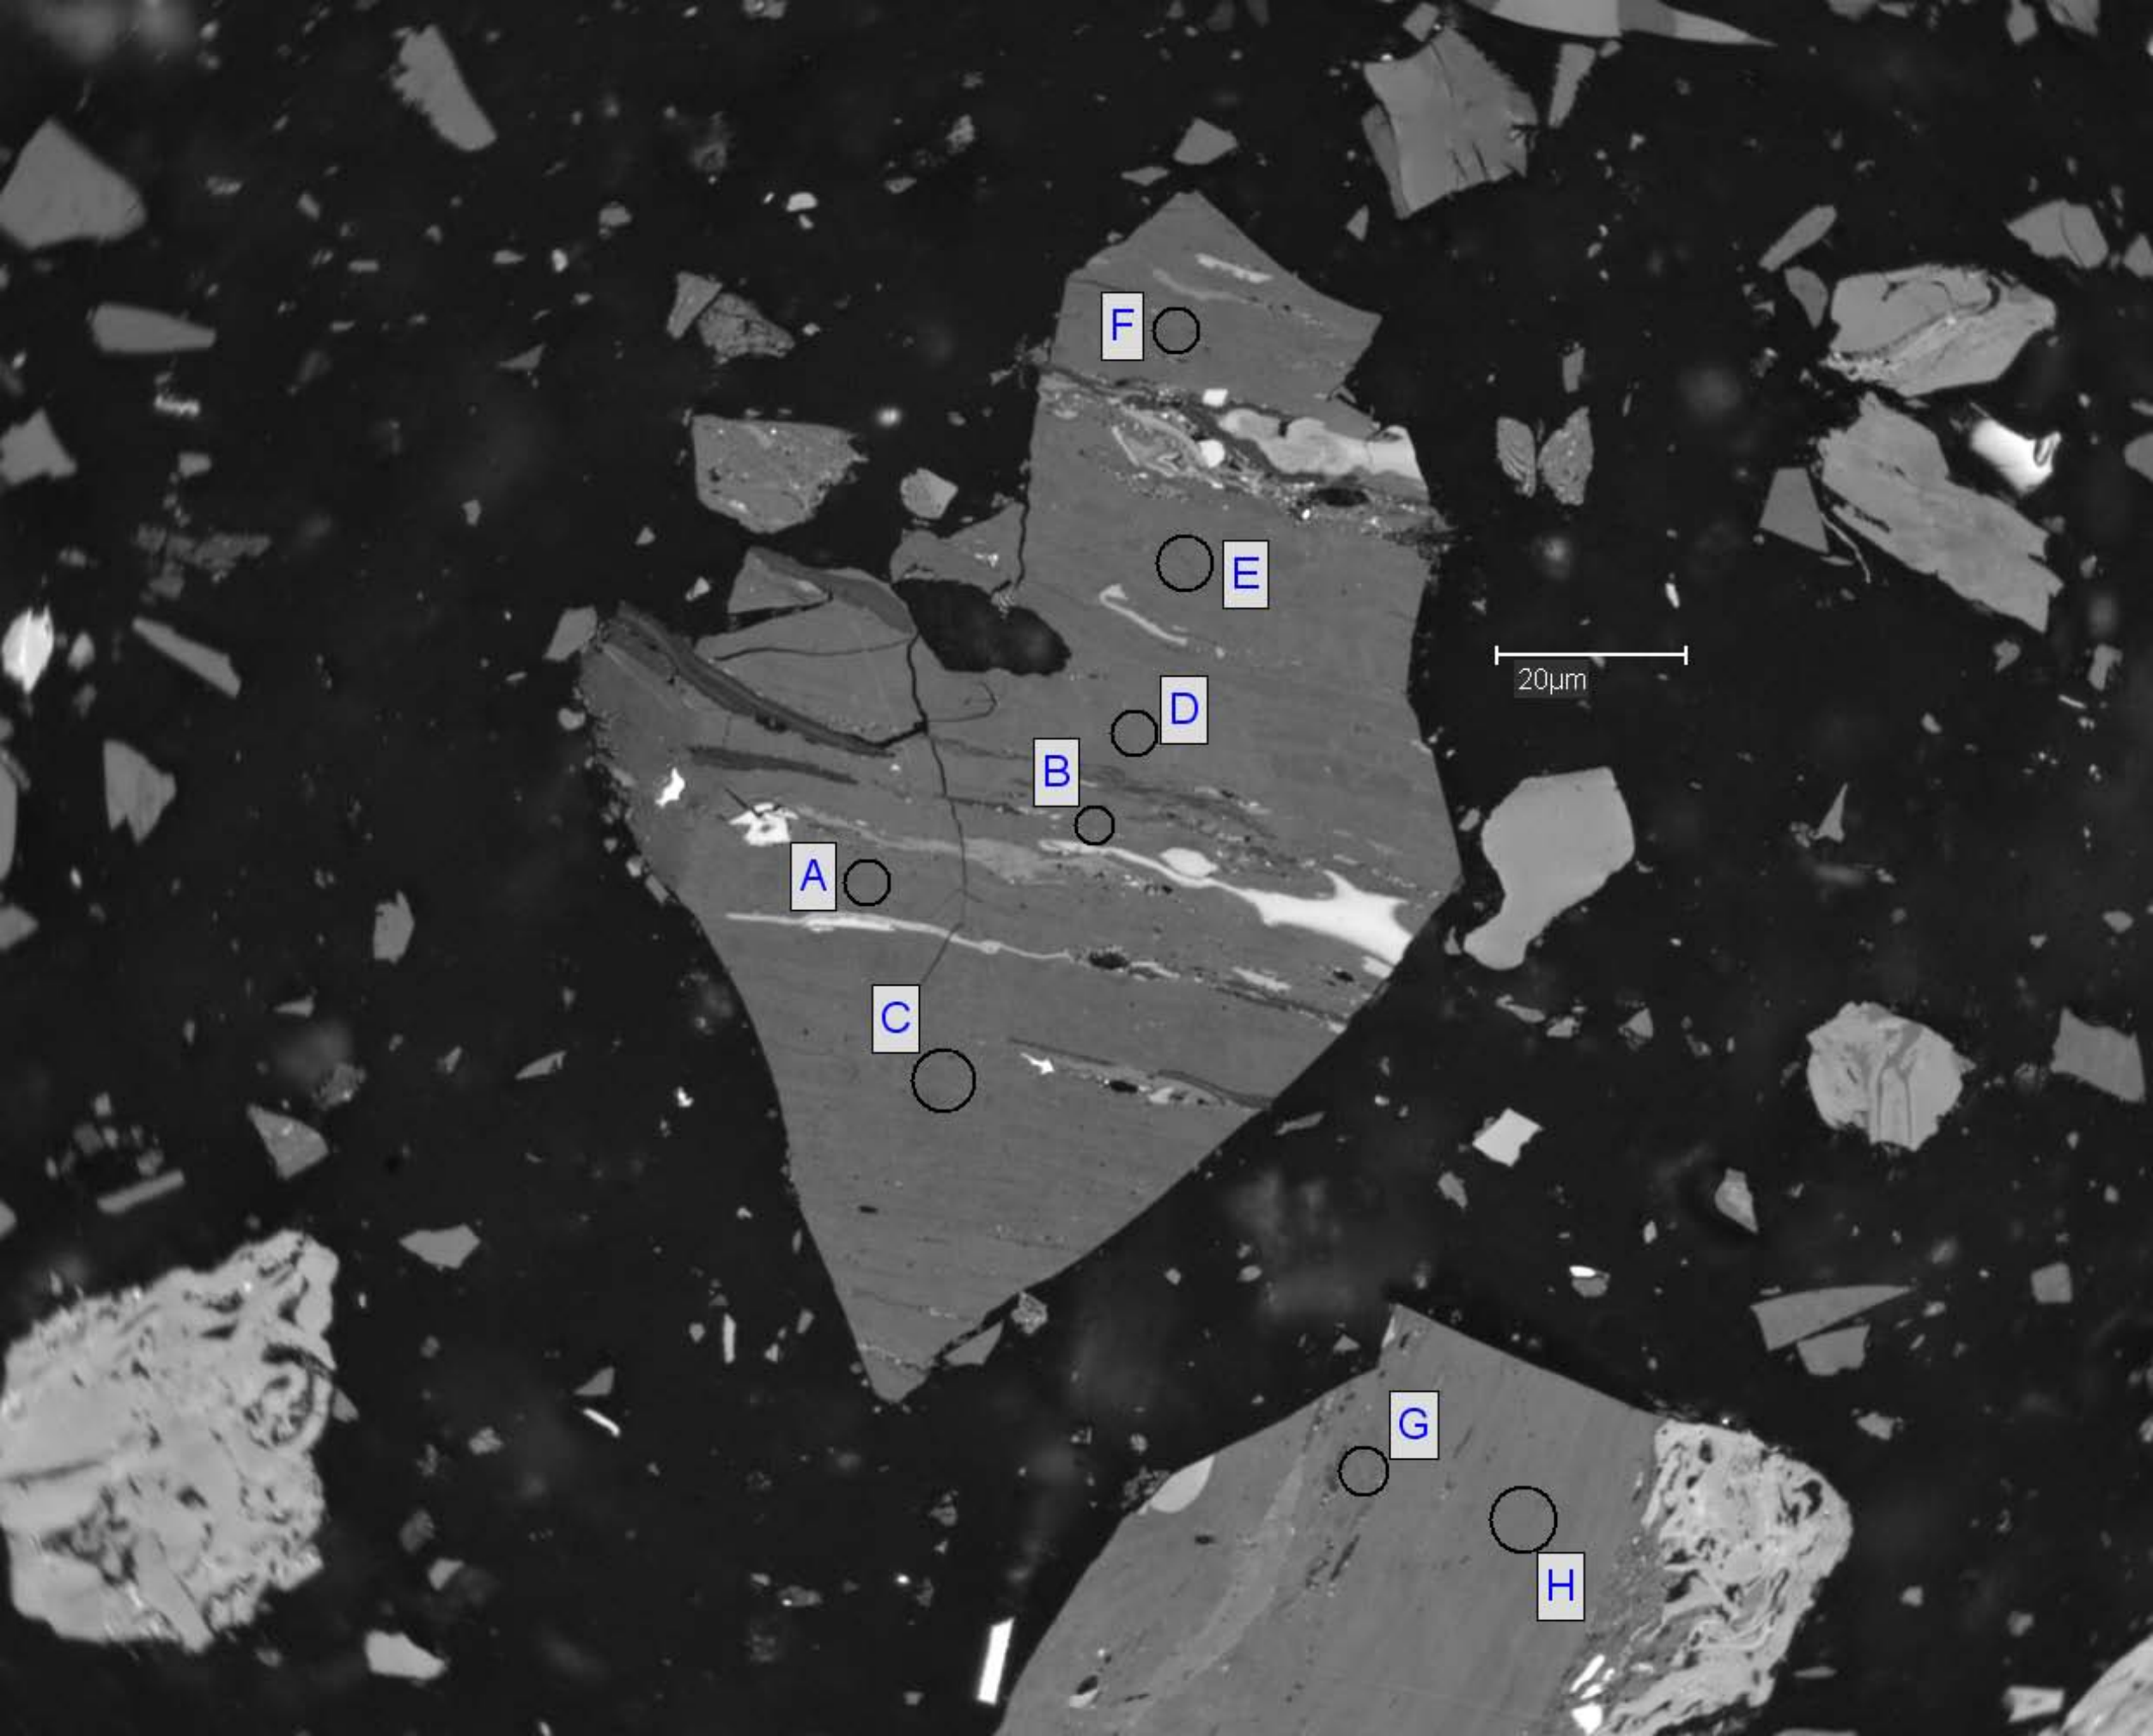

F



E



D



B



A



C




20µm

G



H



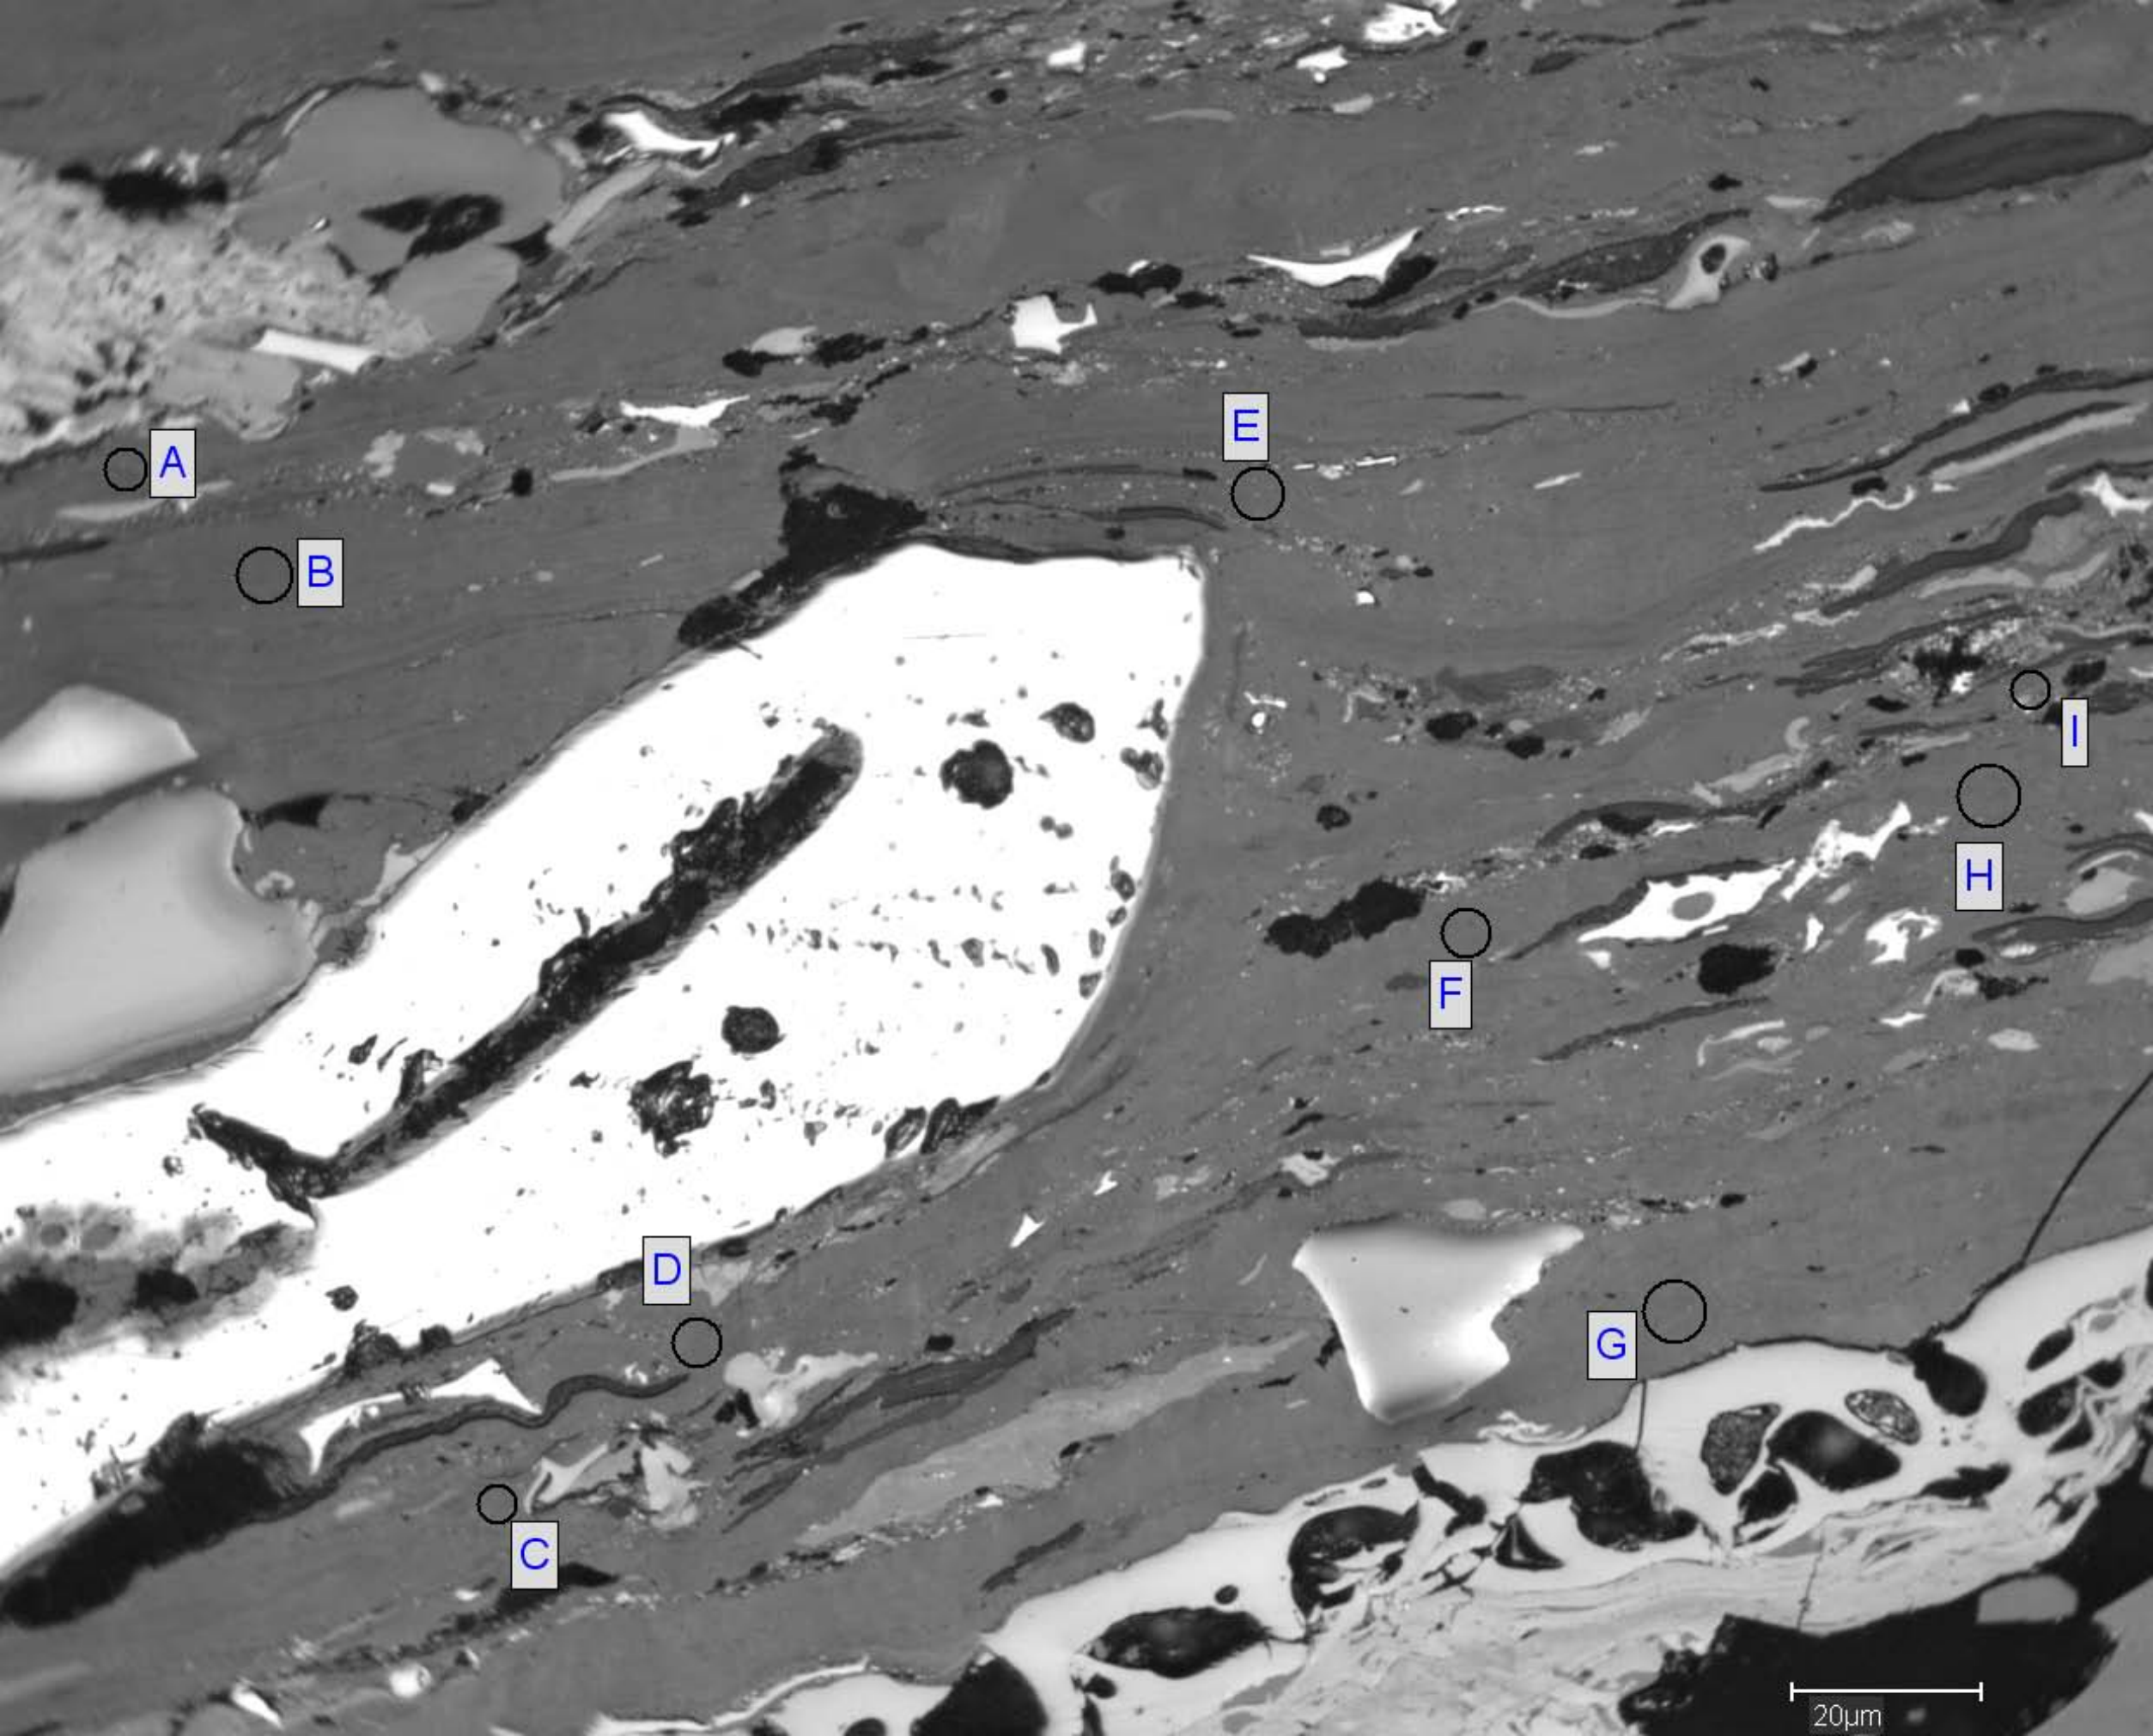

A

B

E

D

C


F

G

H

I

20µm

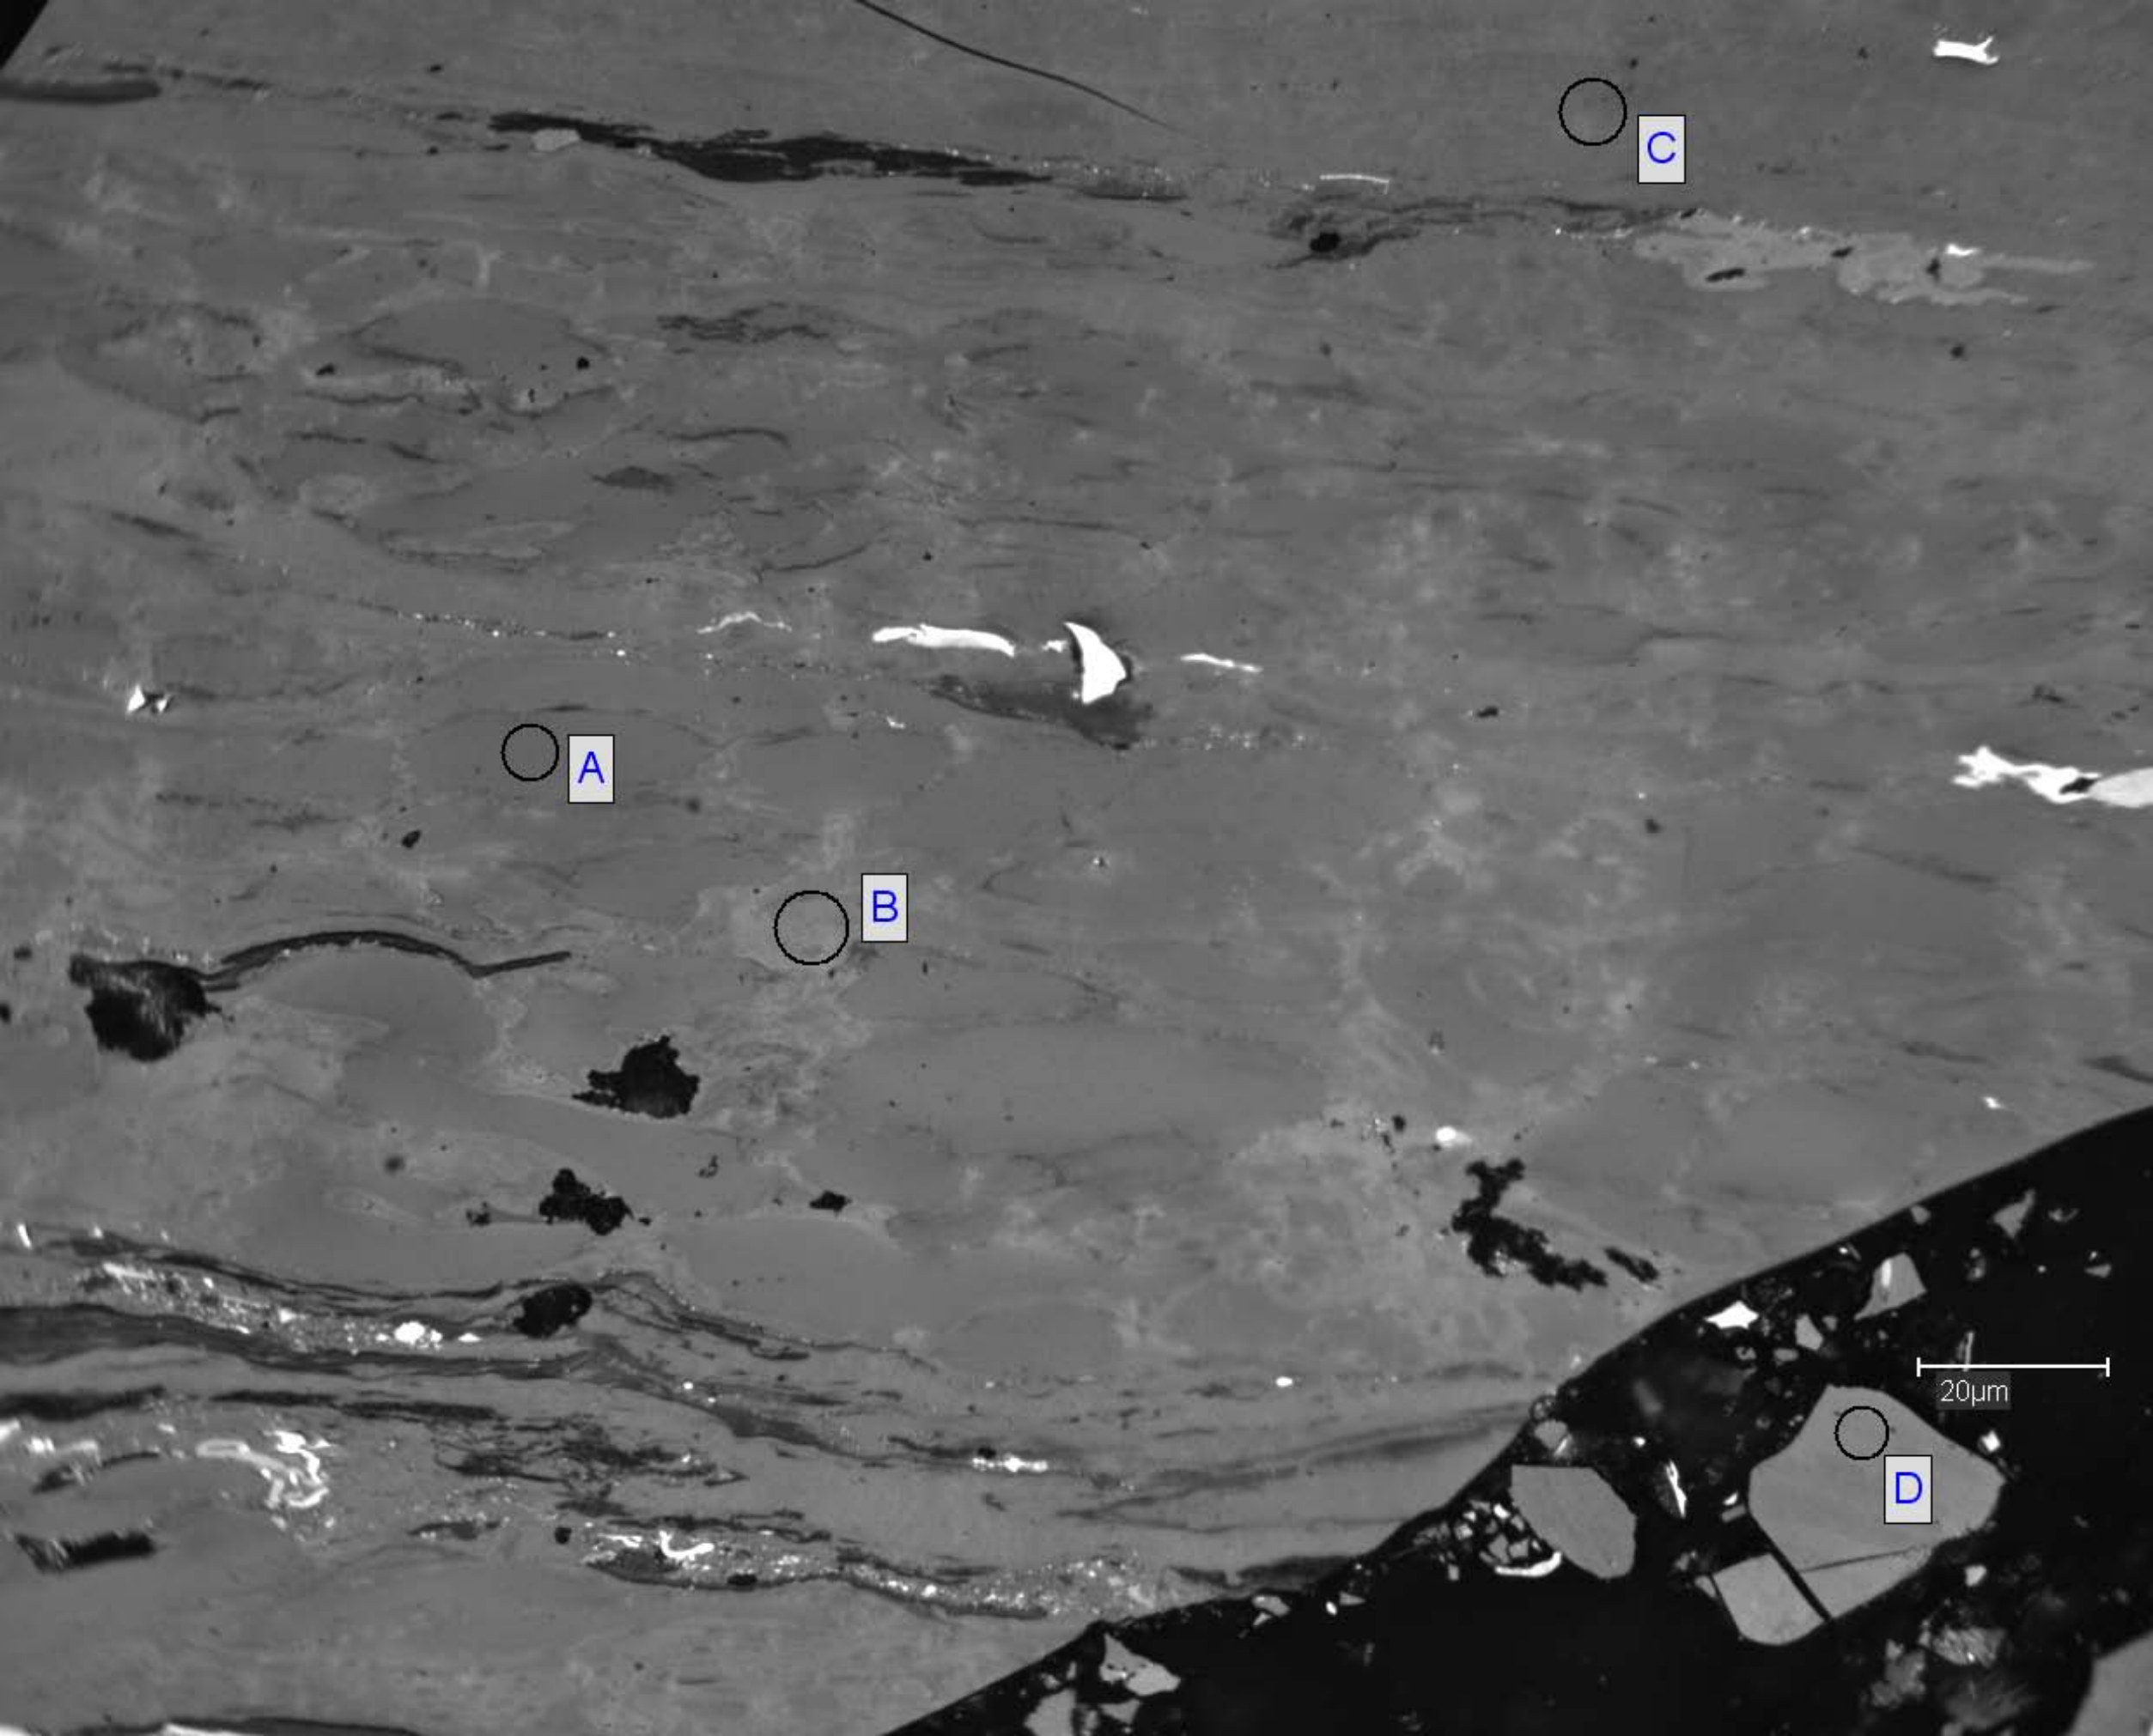


A

B

C

D

20µm

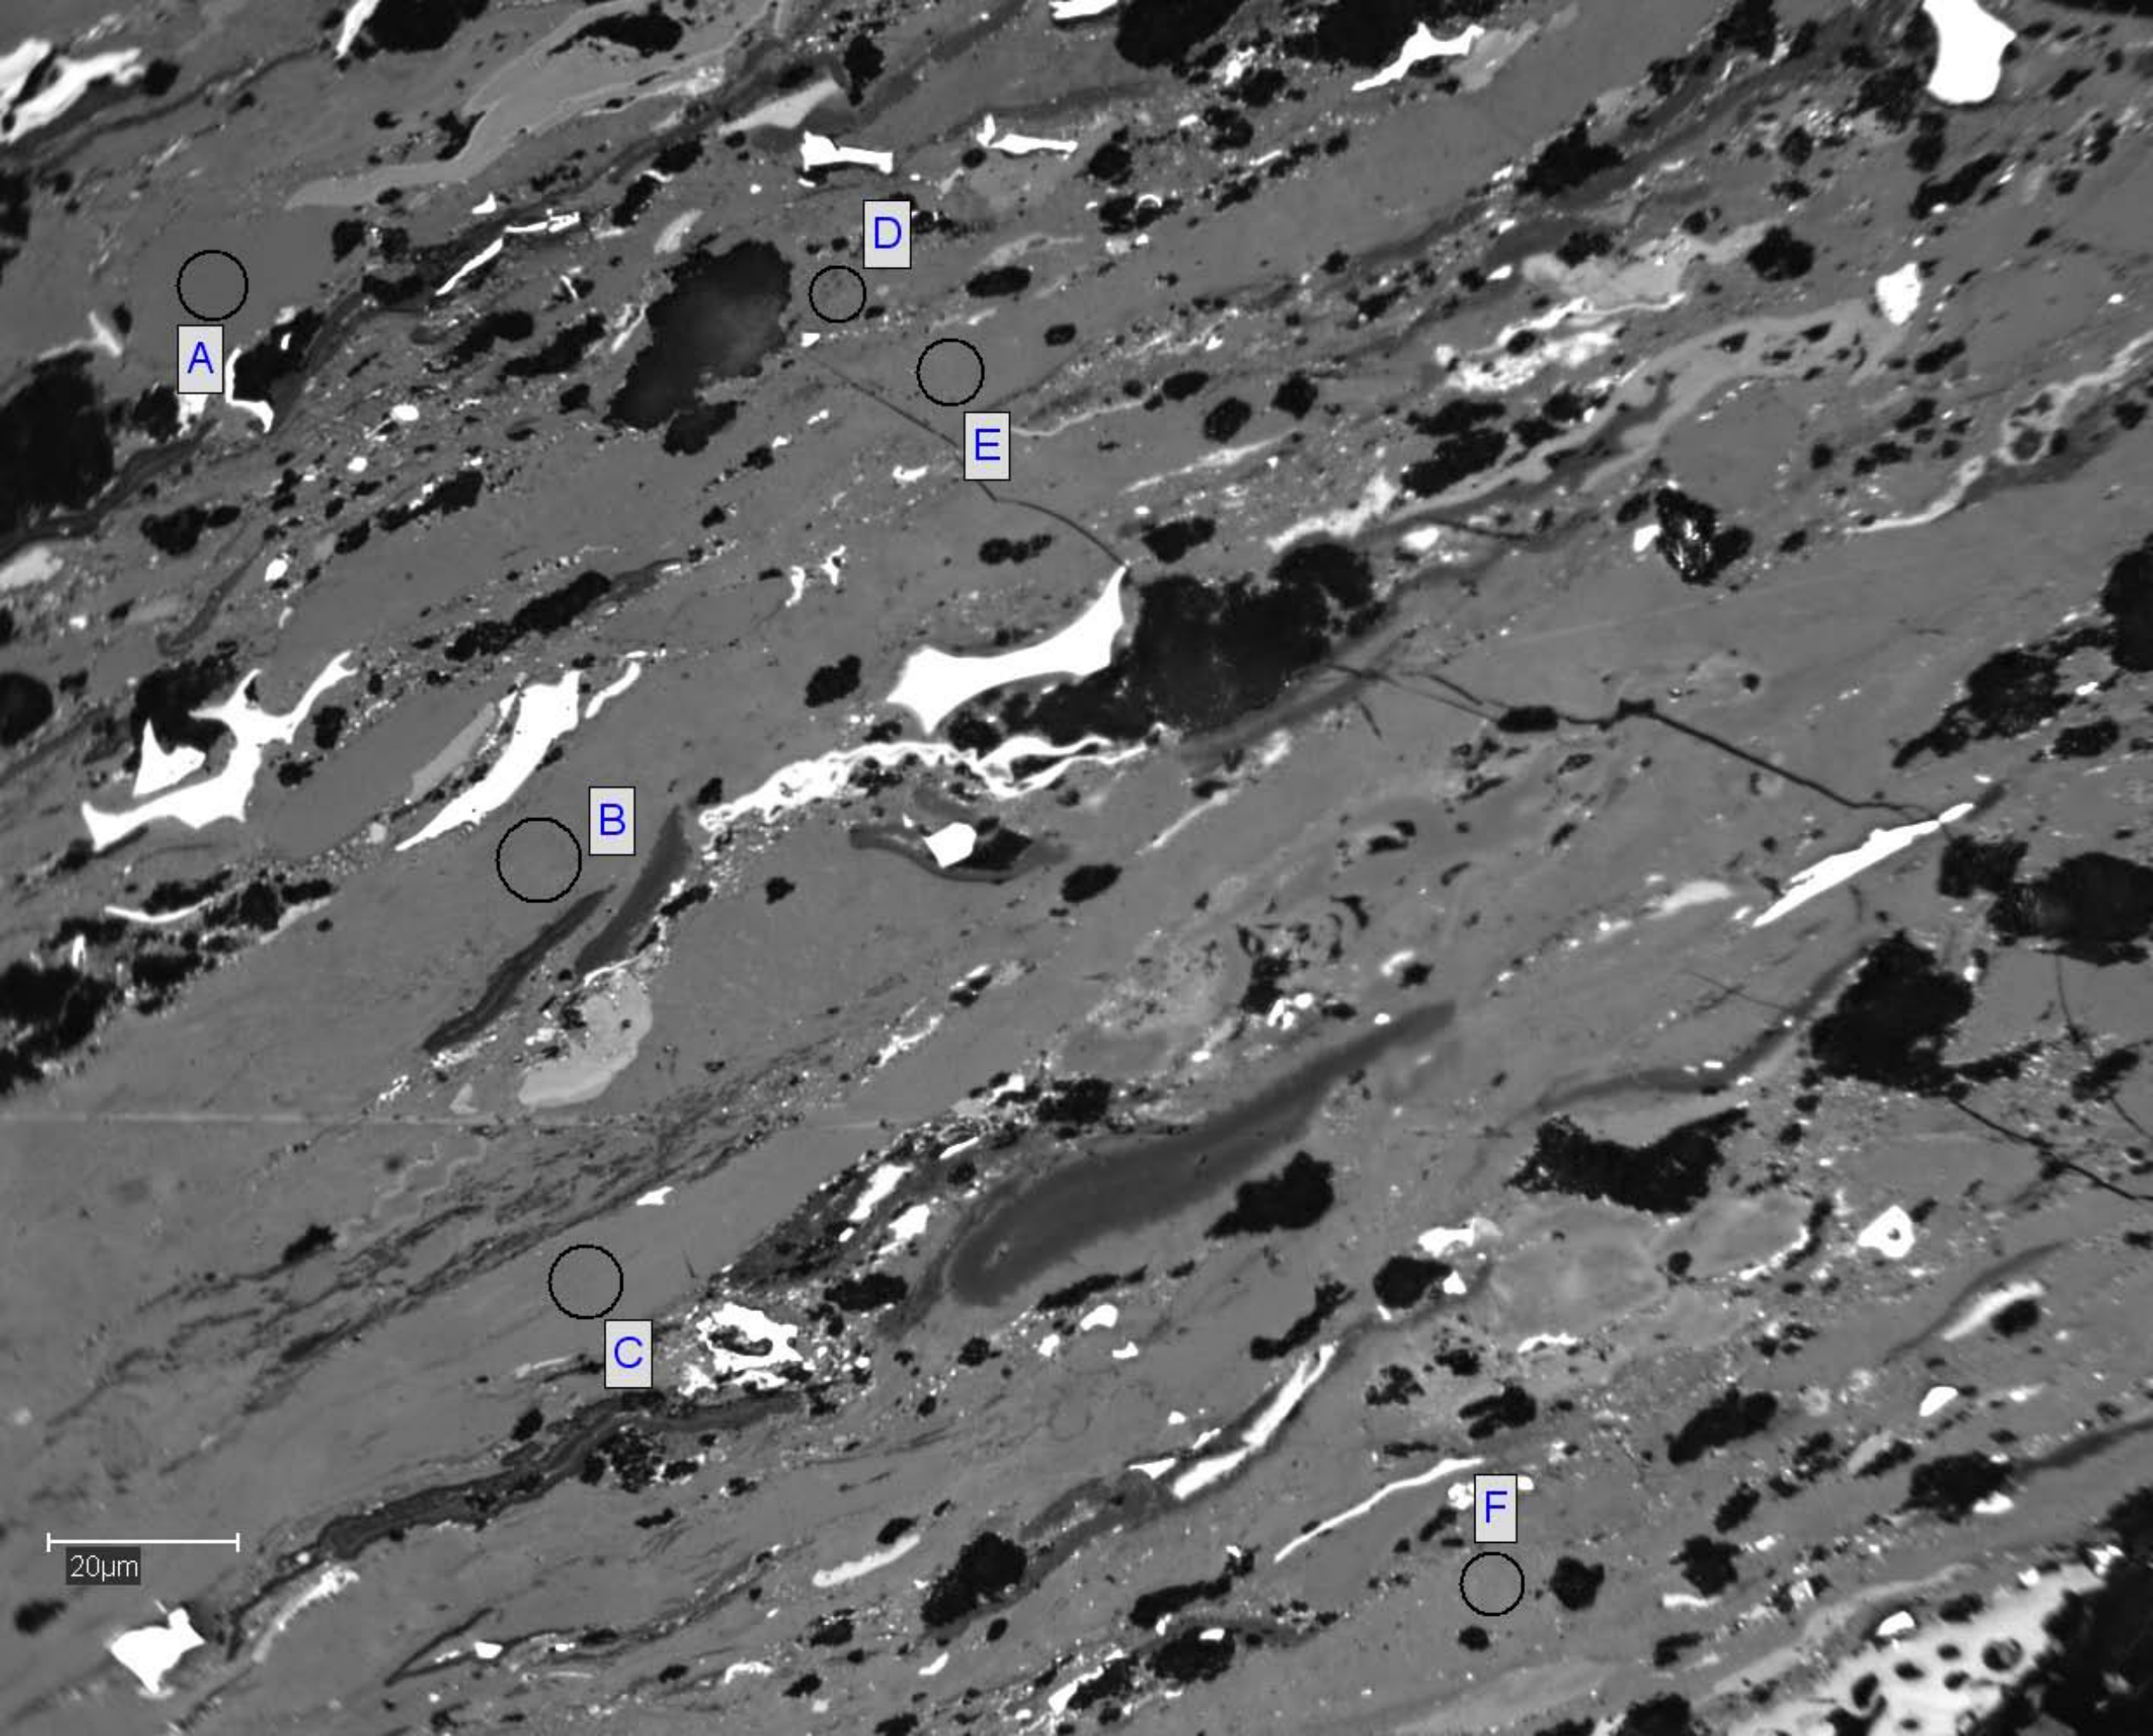

A



D



E



B




C



F

20µm

20µm

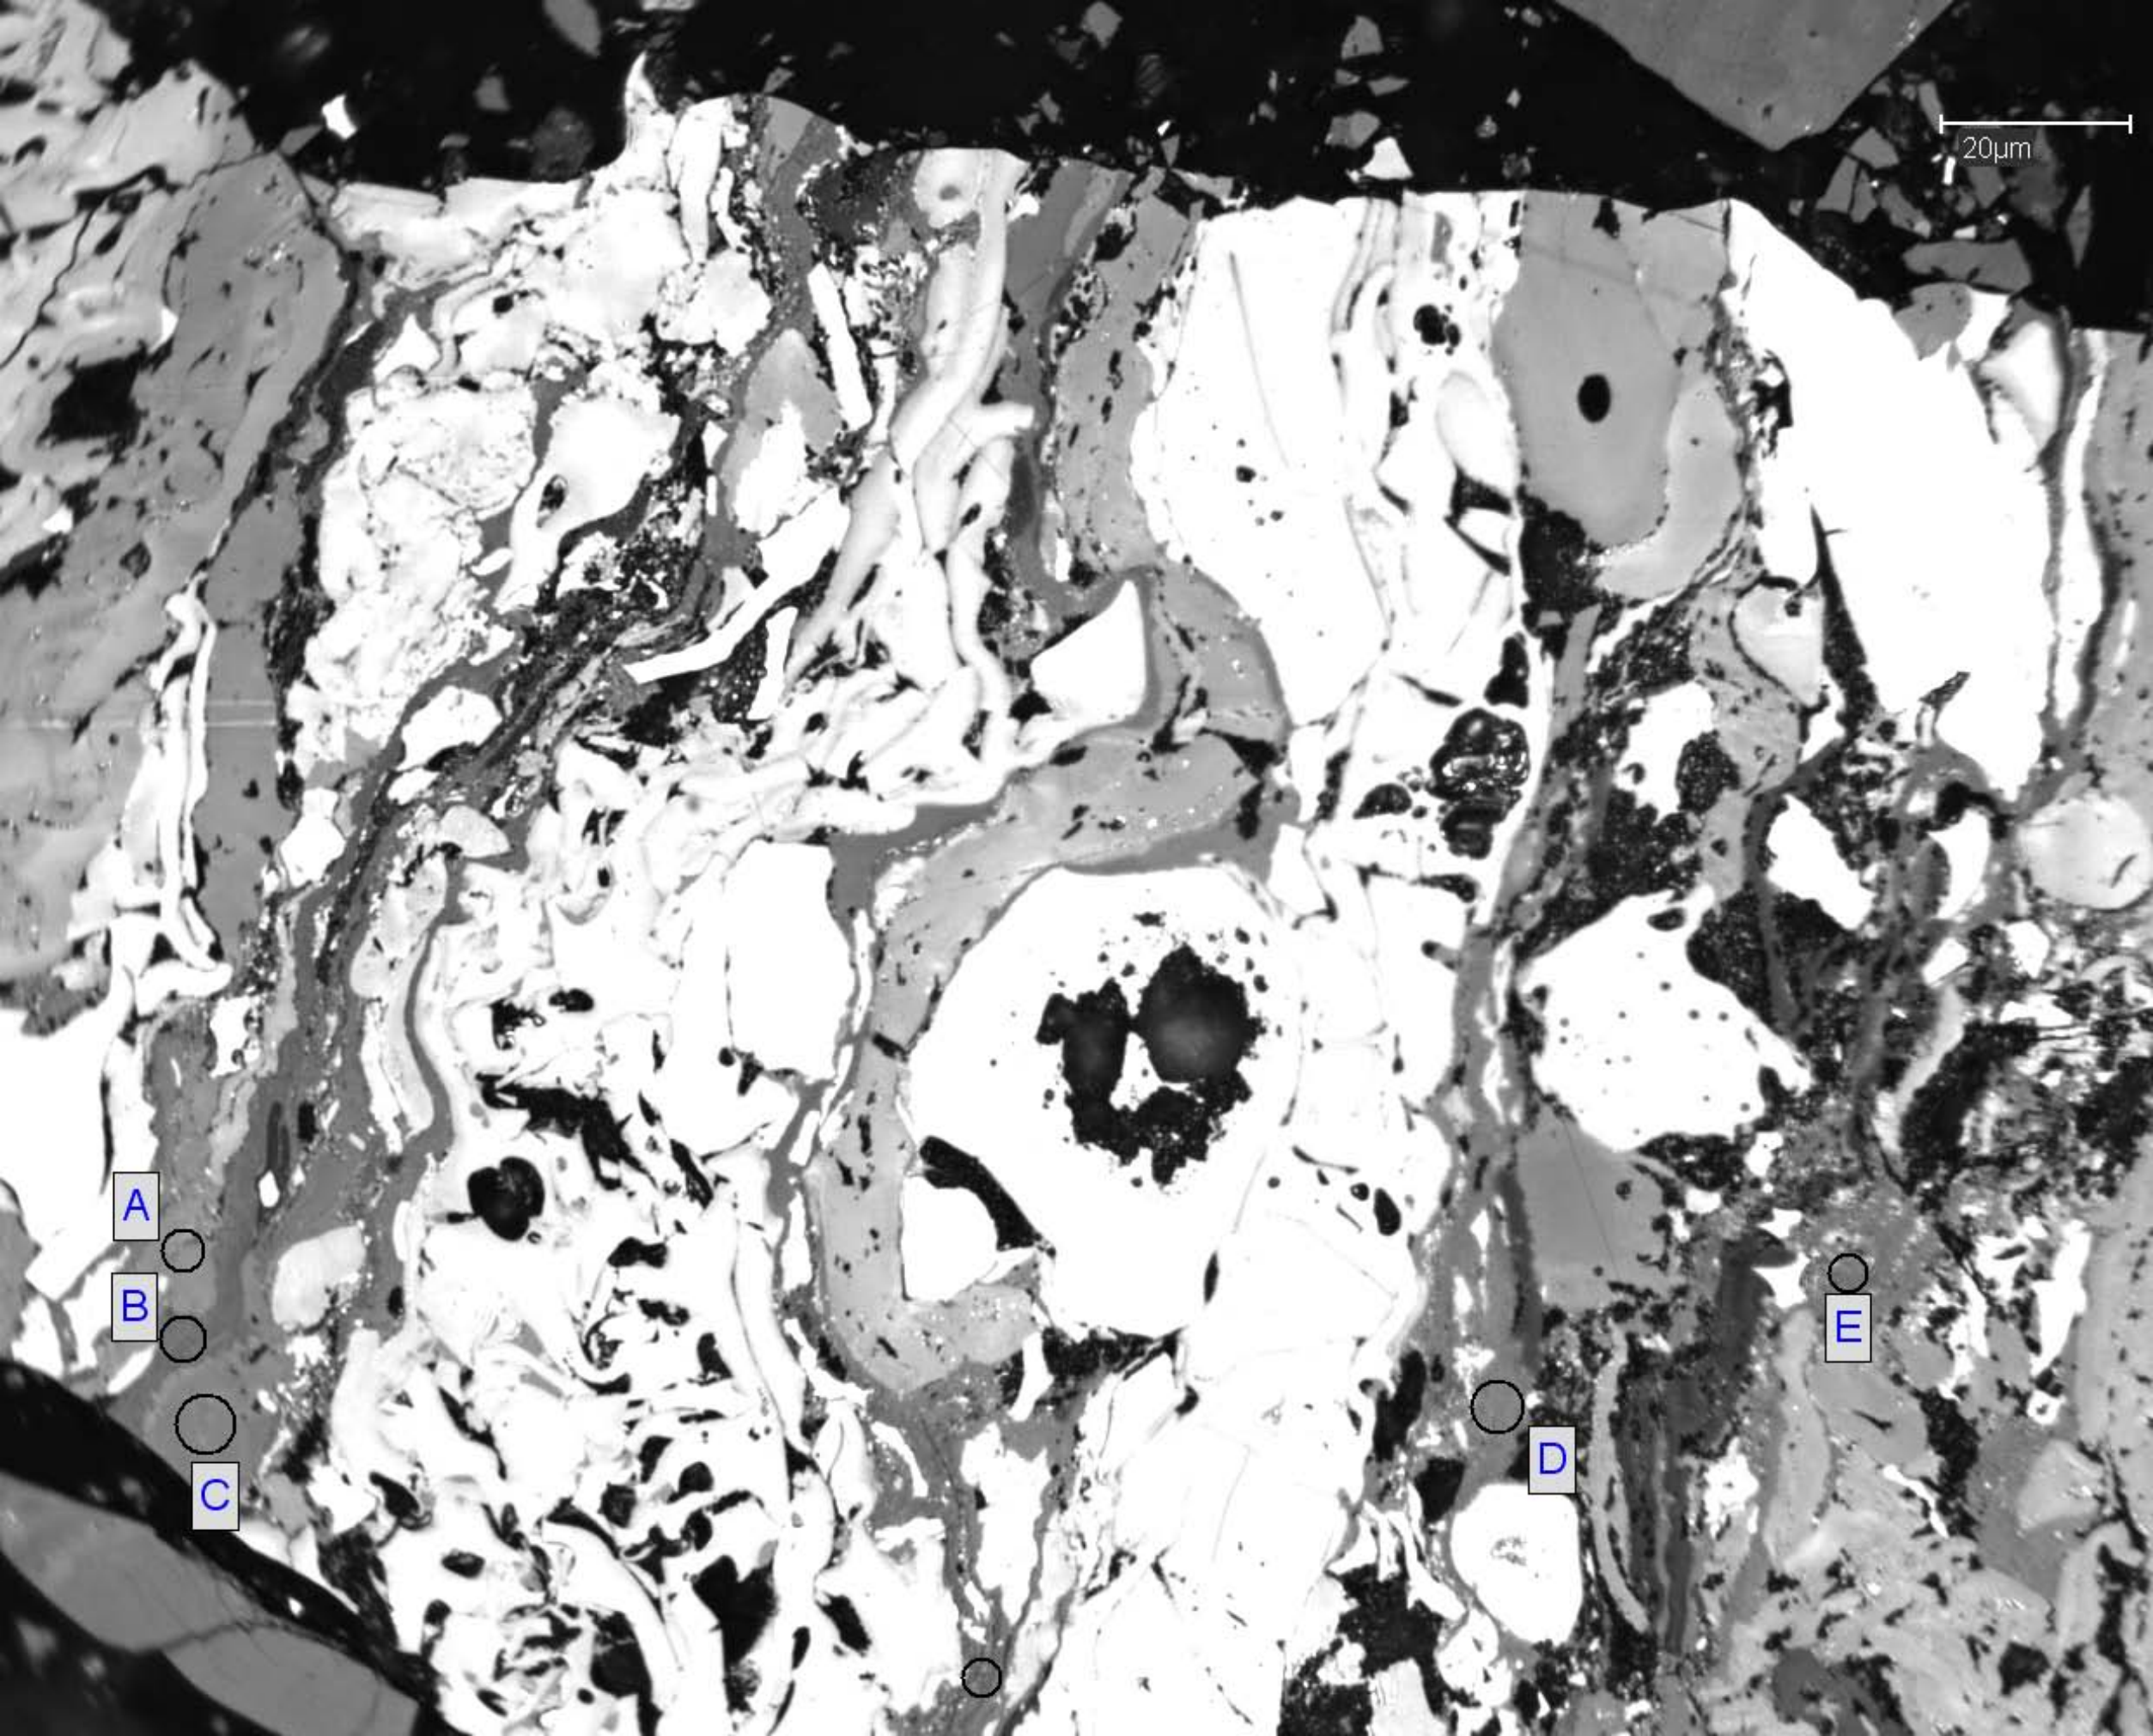


A

B

C

D

E

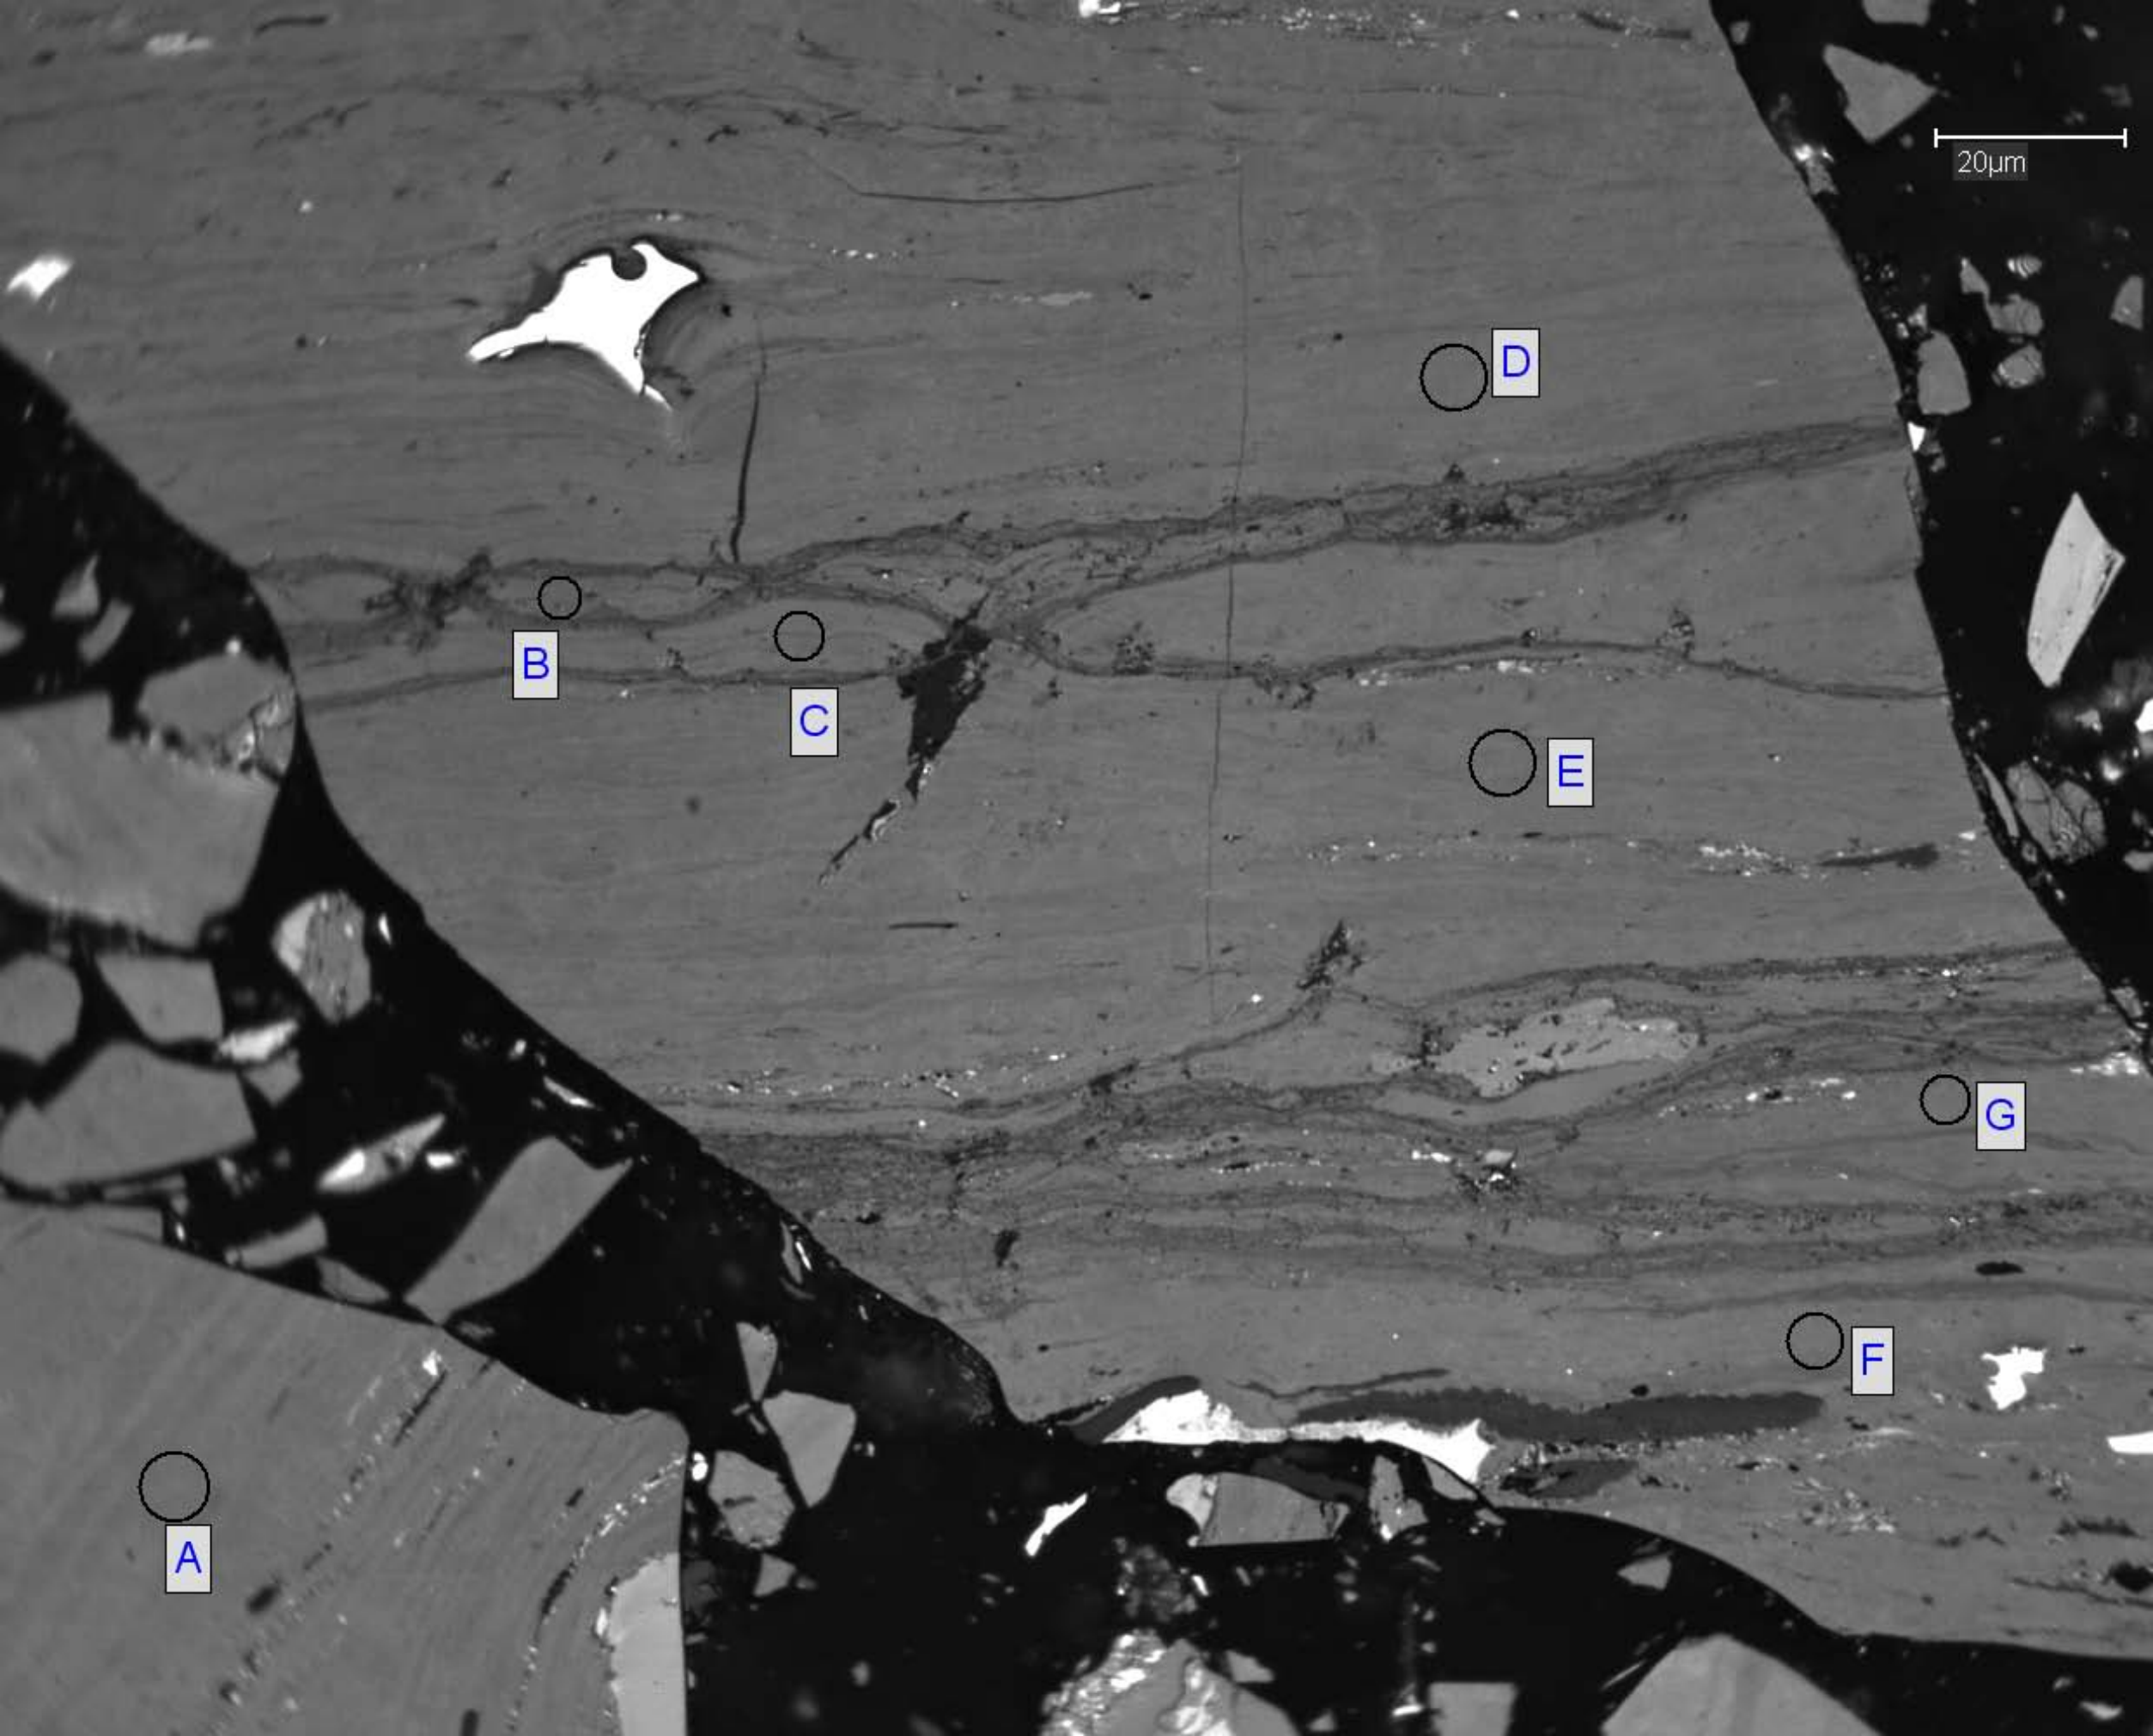

20μm

A

B

C


D


E

G

F

20µm

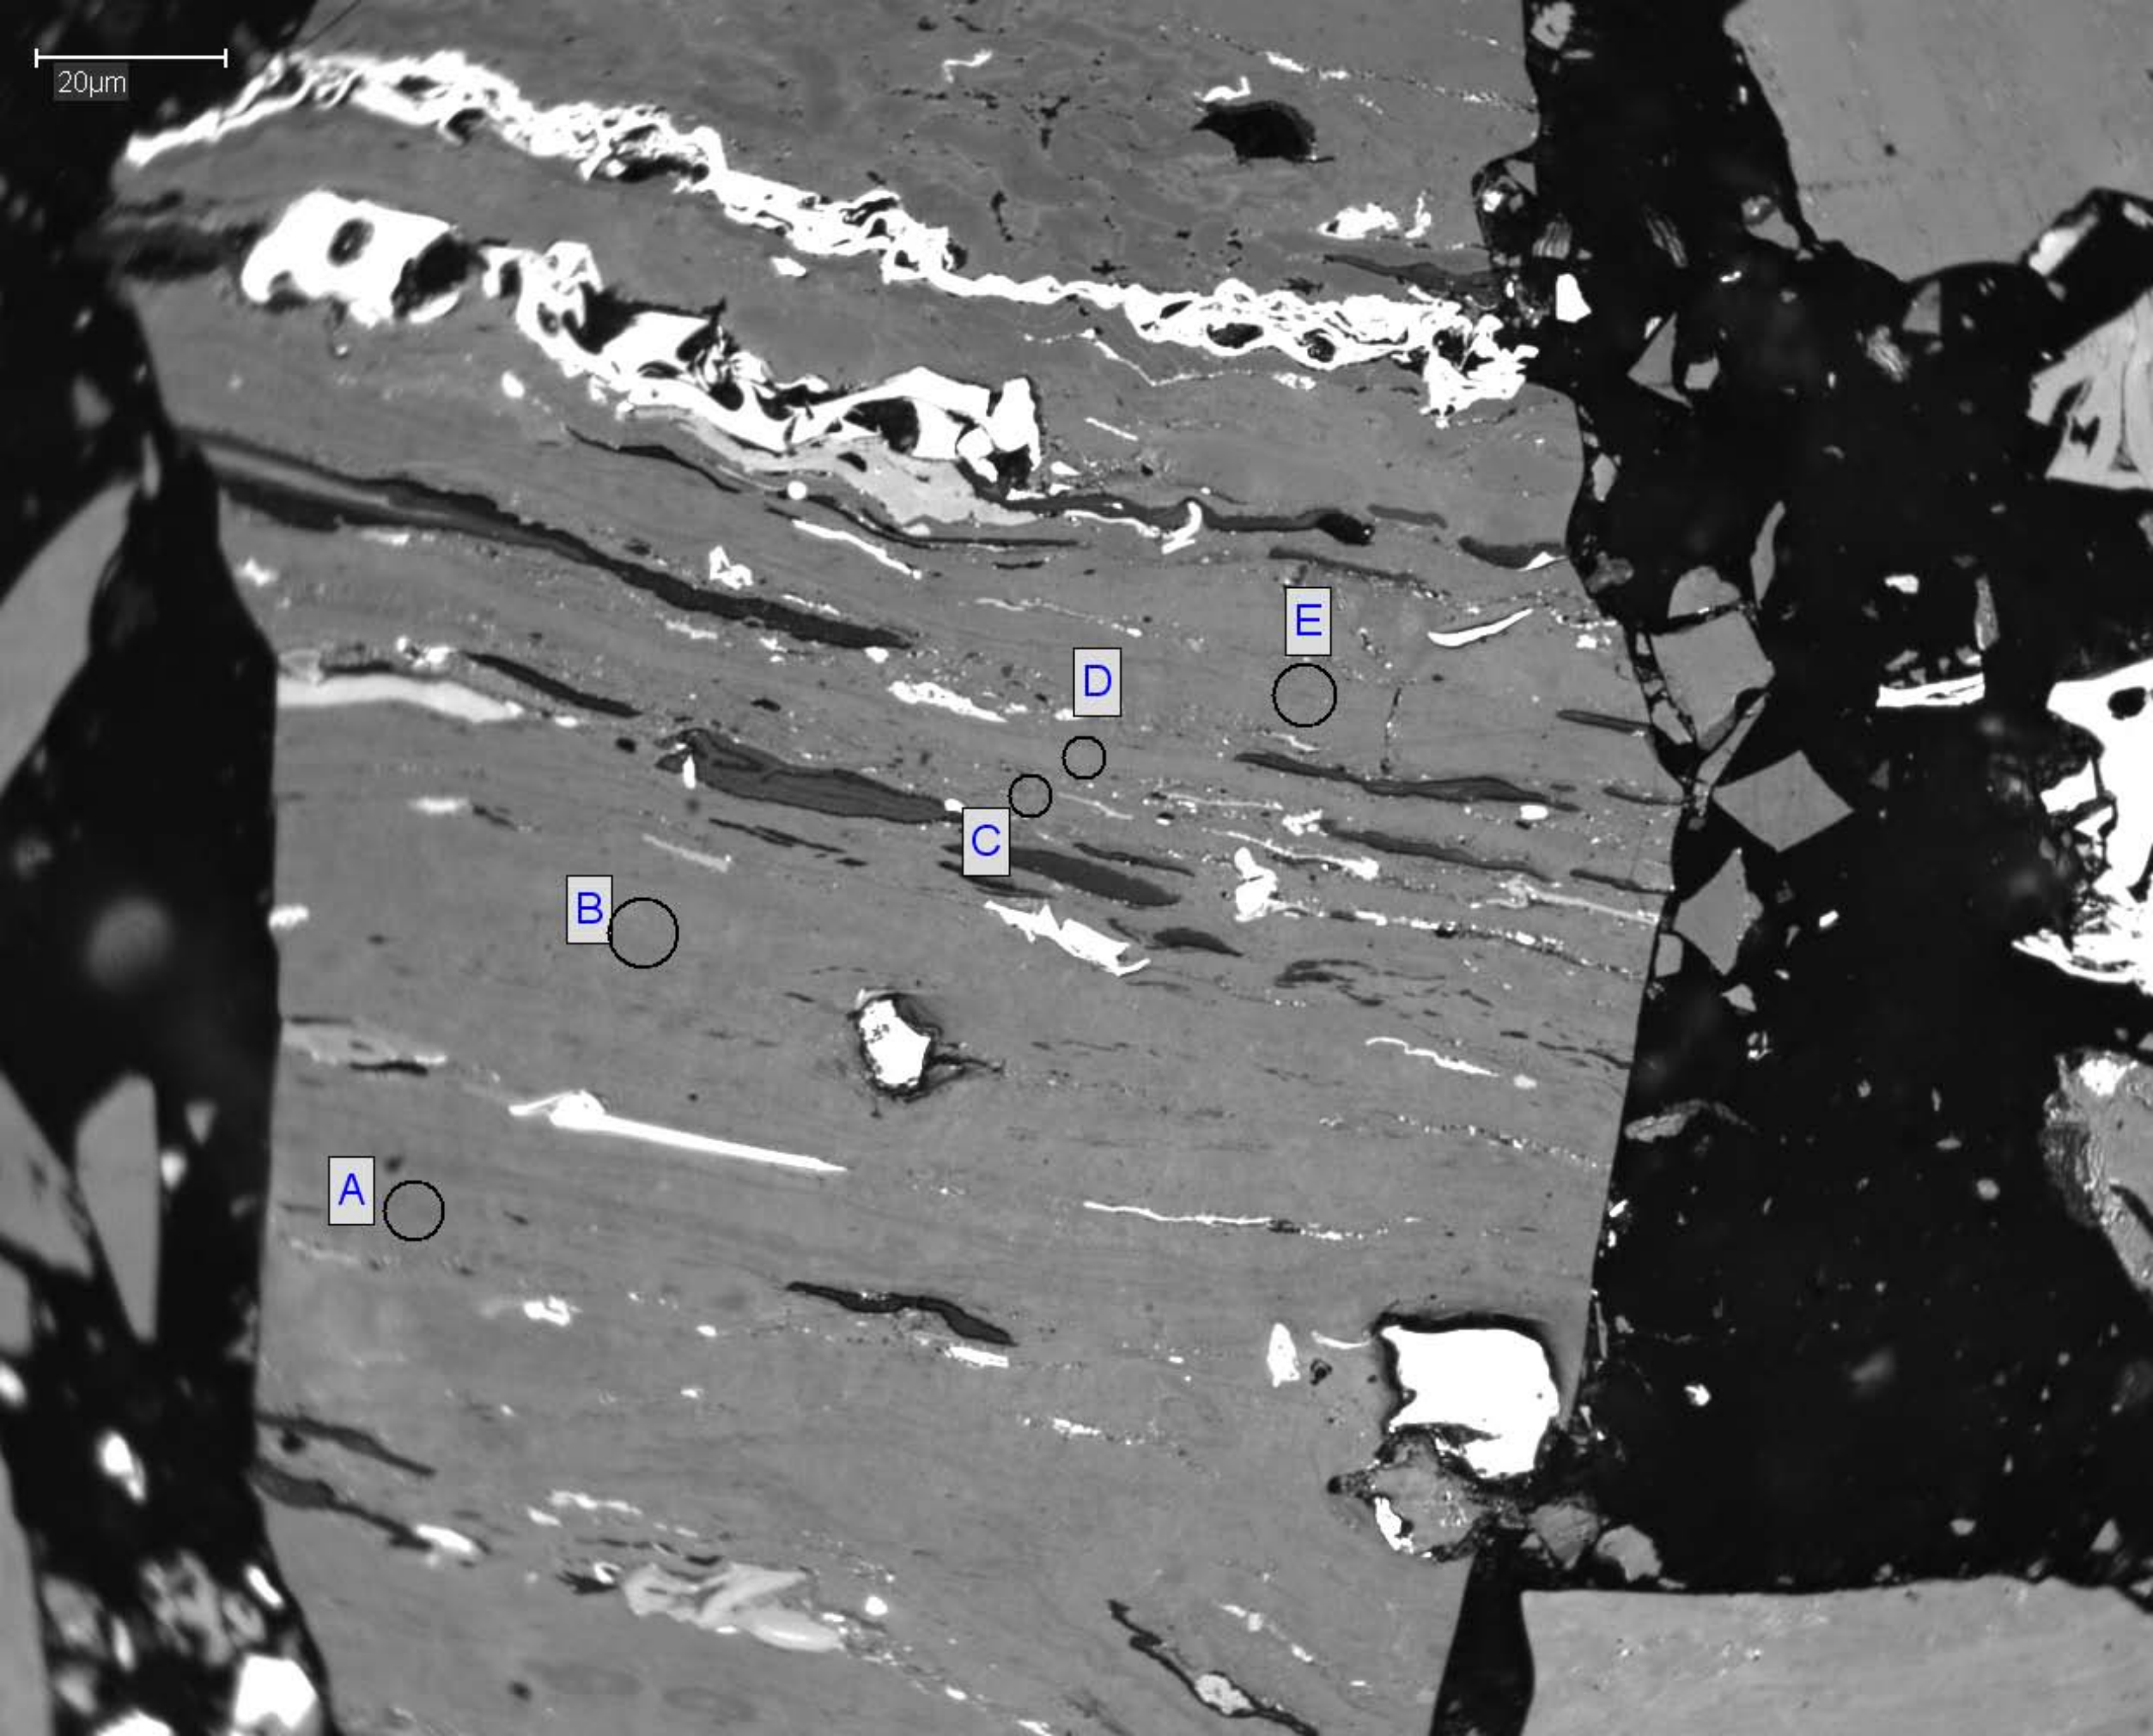

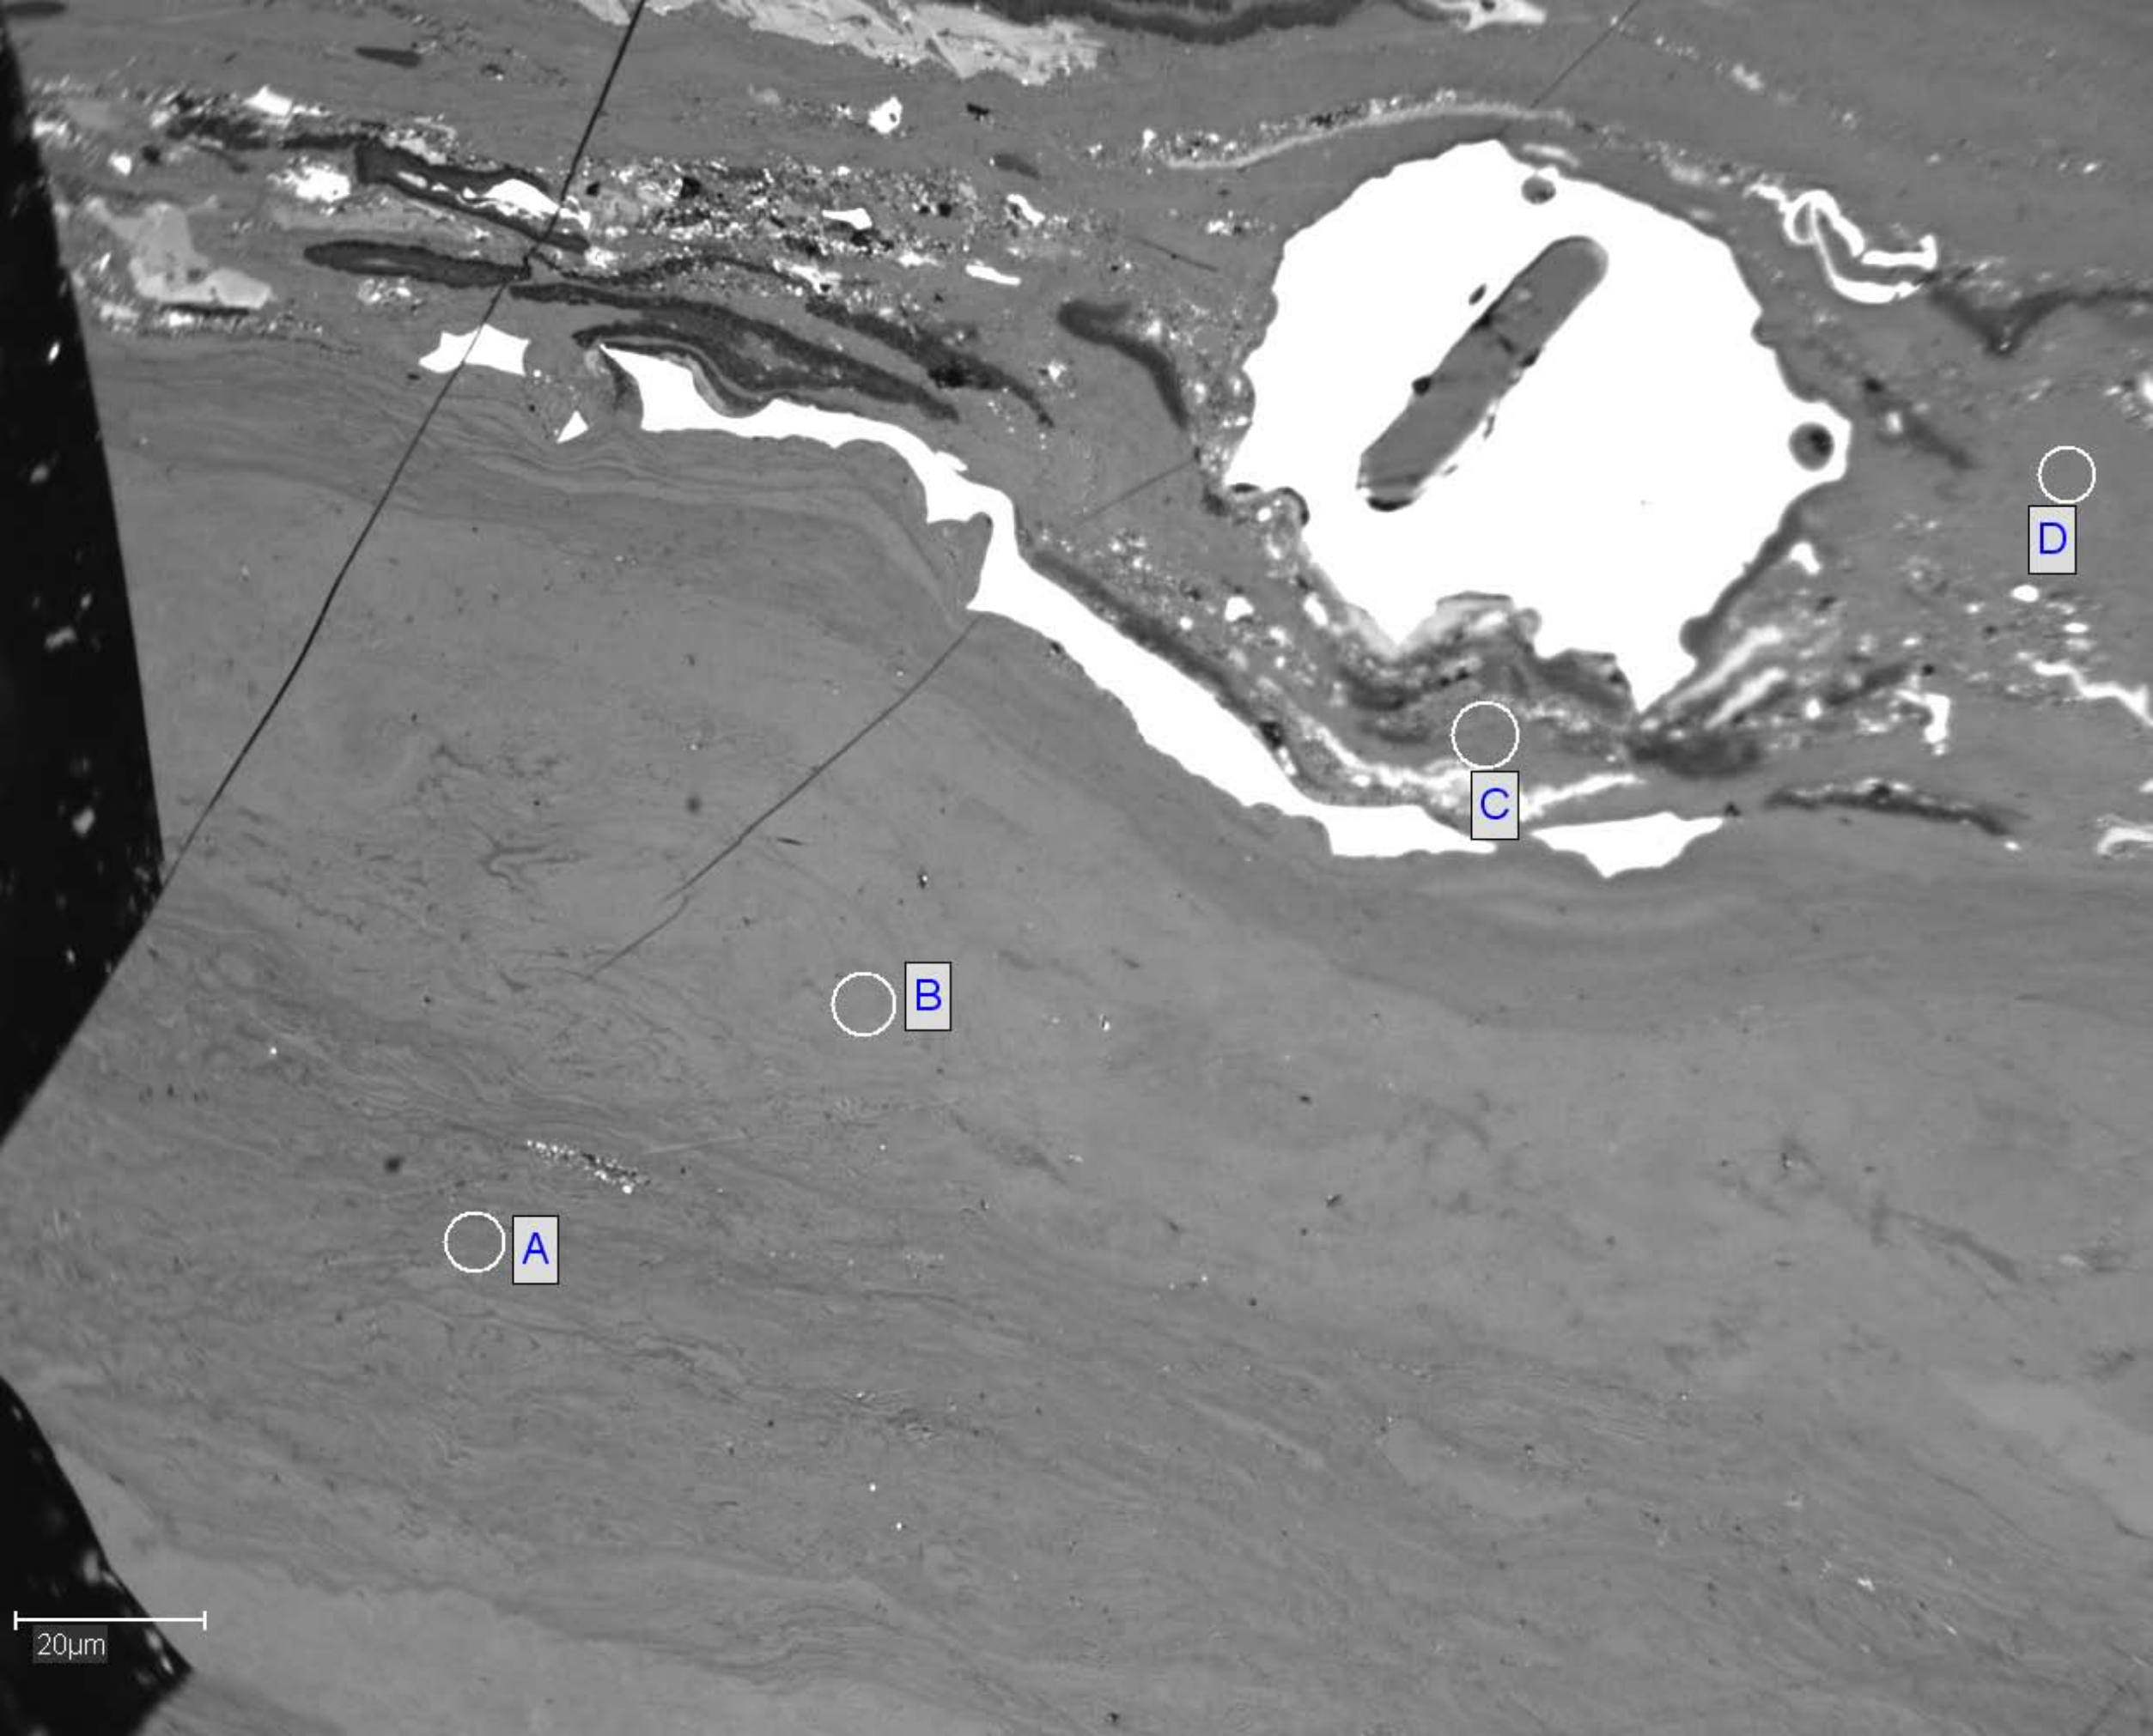


A

B

C

D

20µm

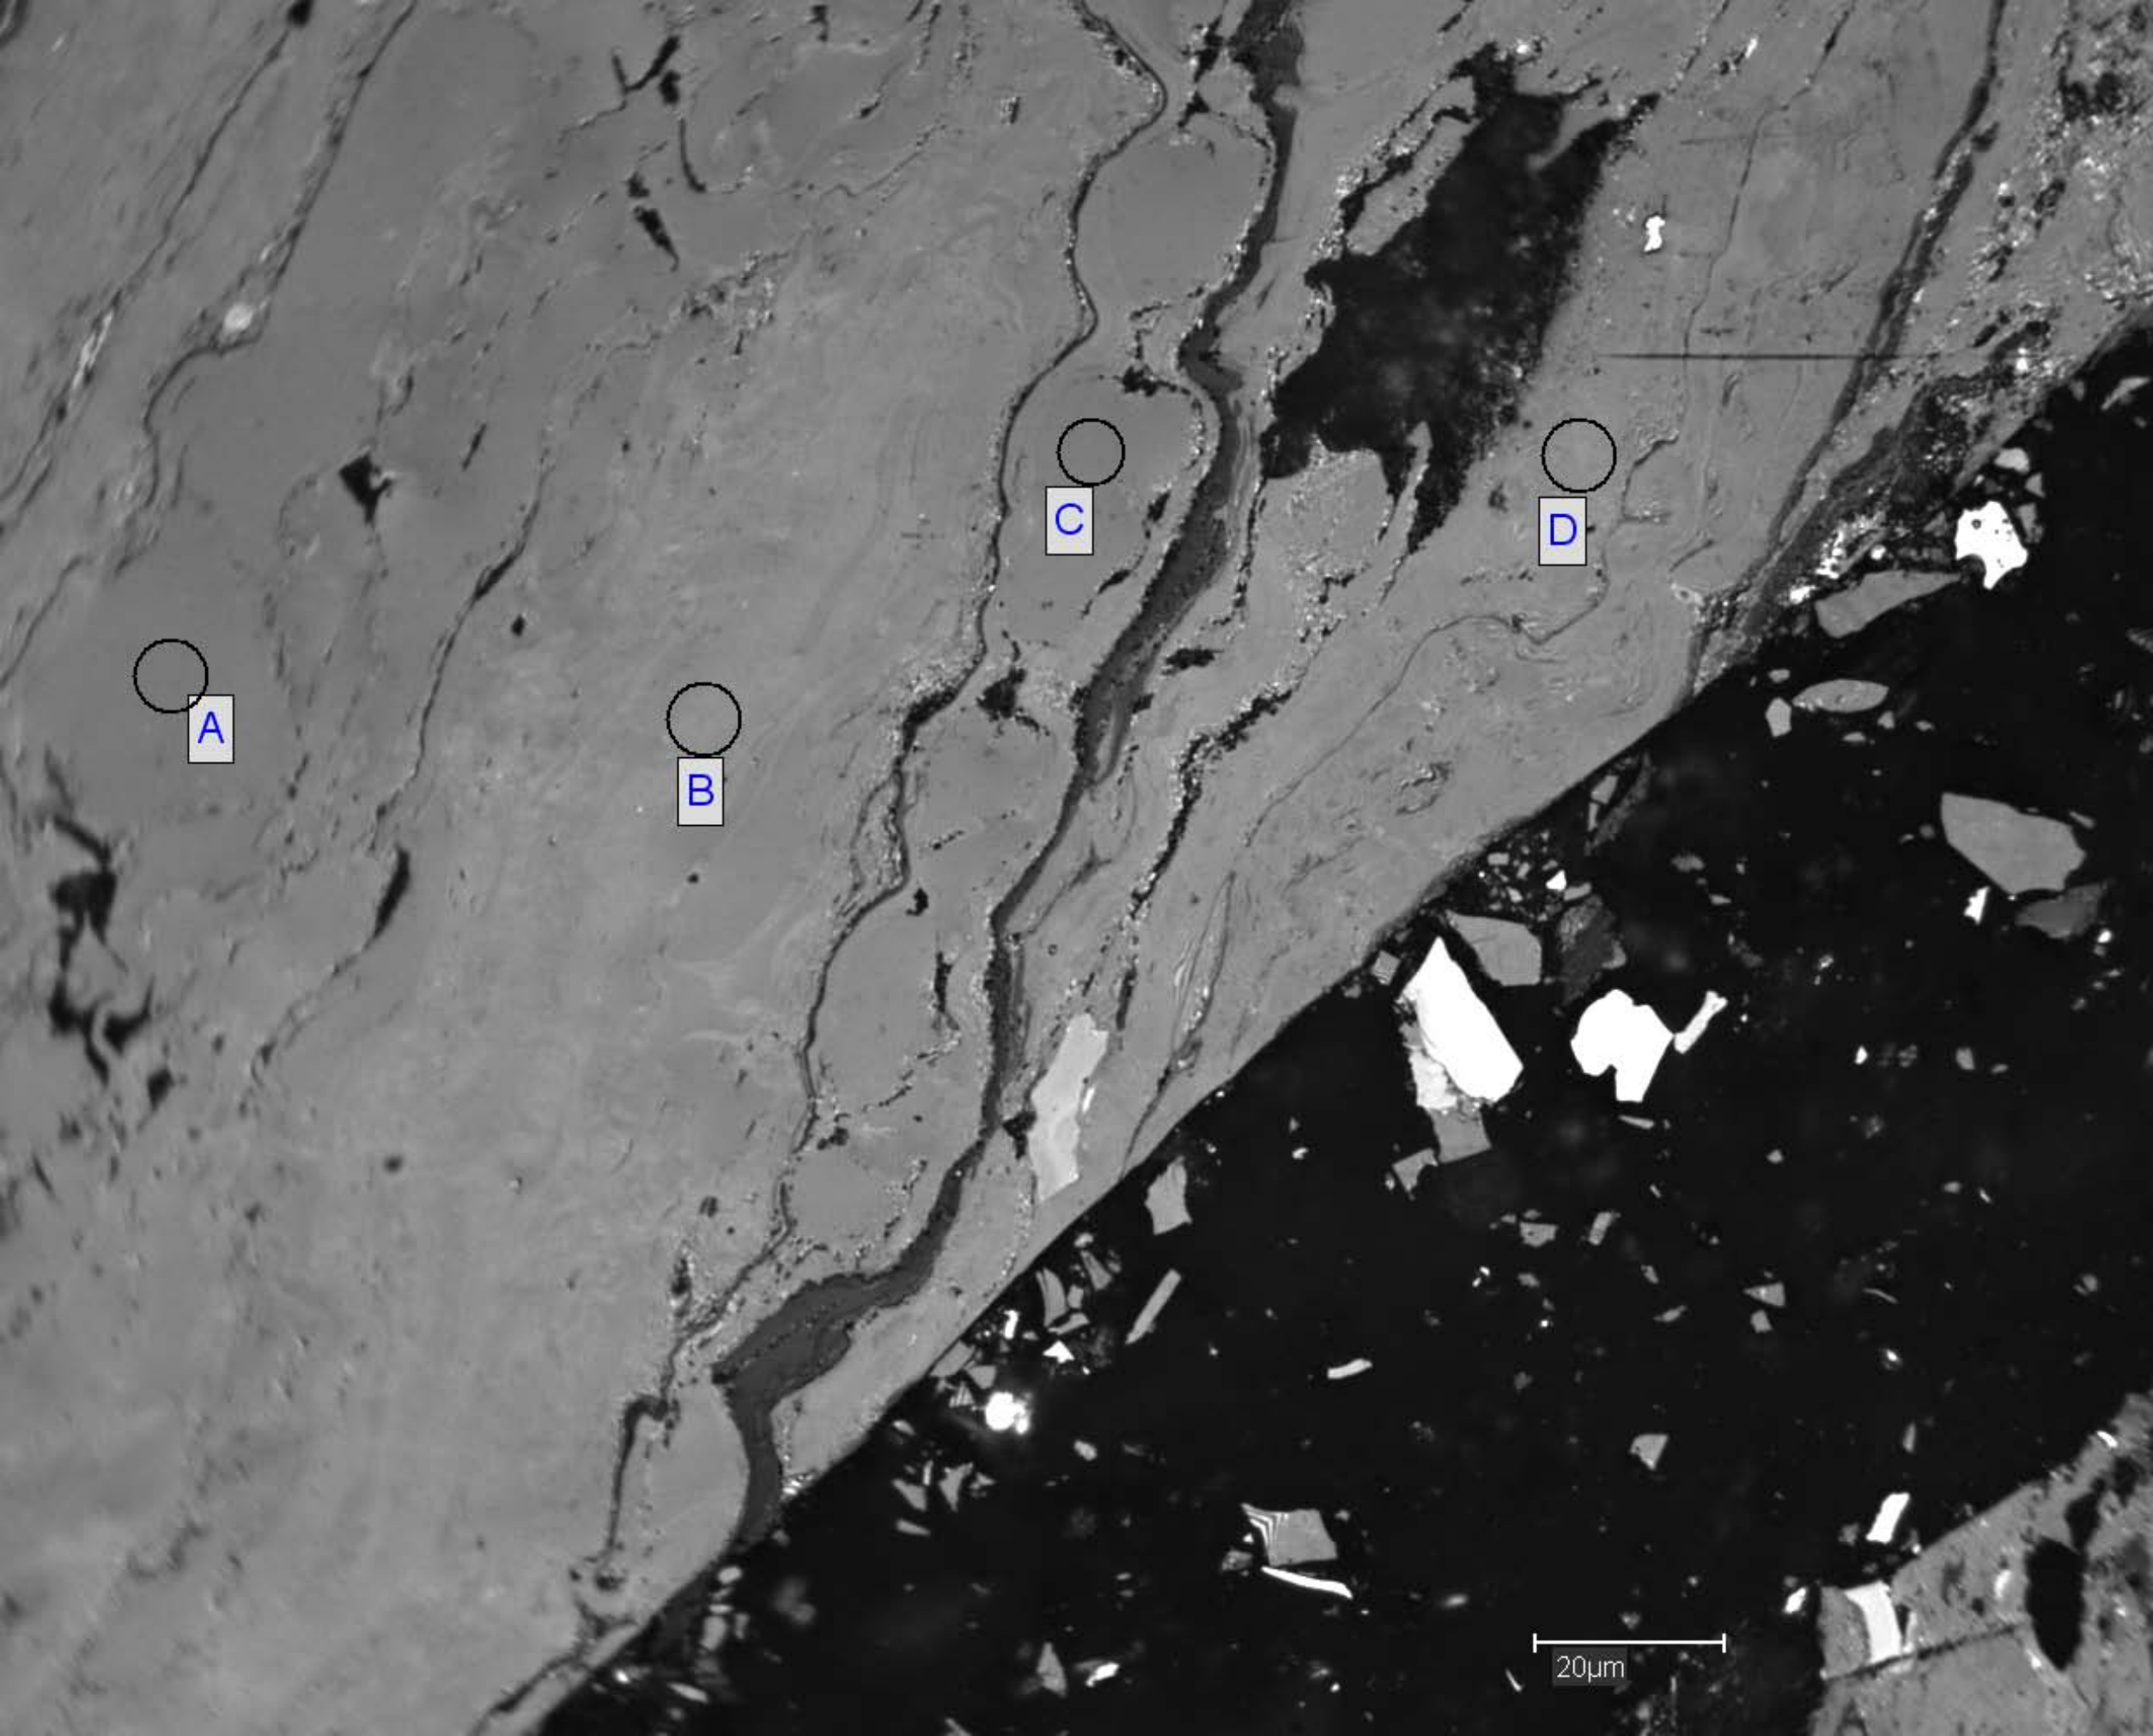

A

B

C

D

20µm

20µm


A


B

C

D

E

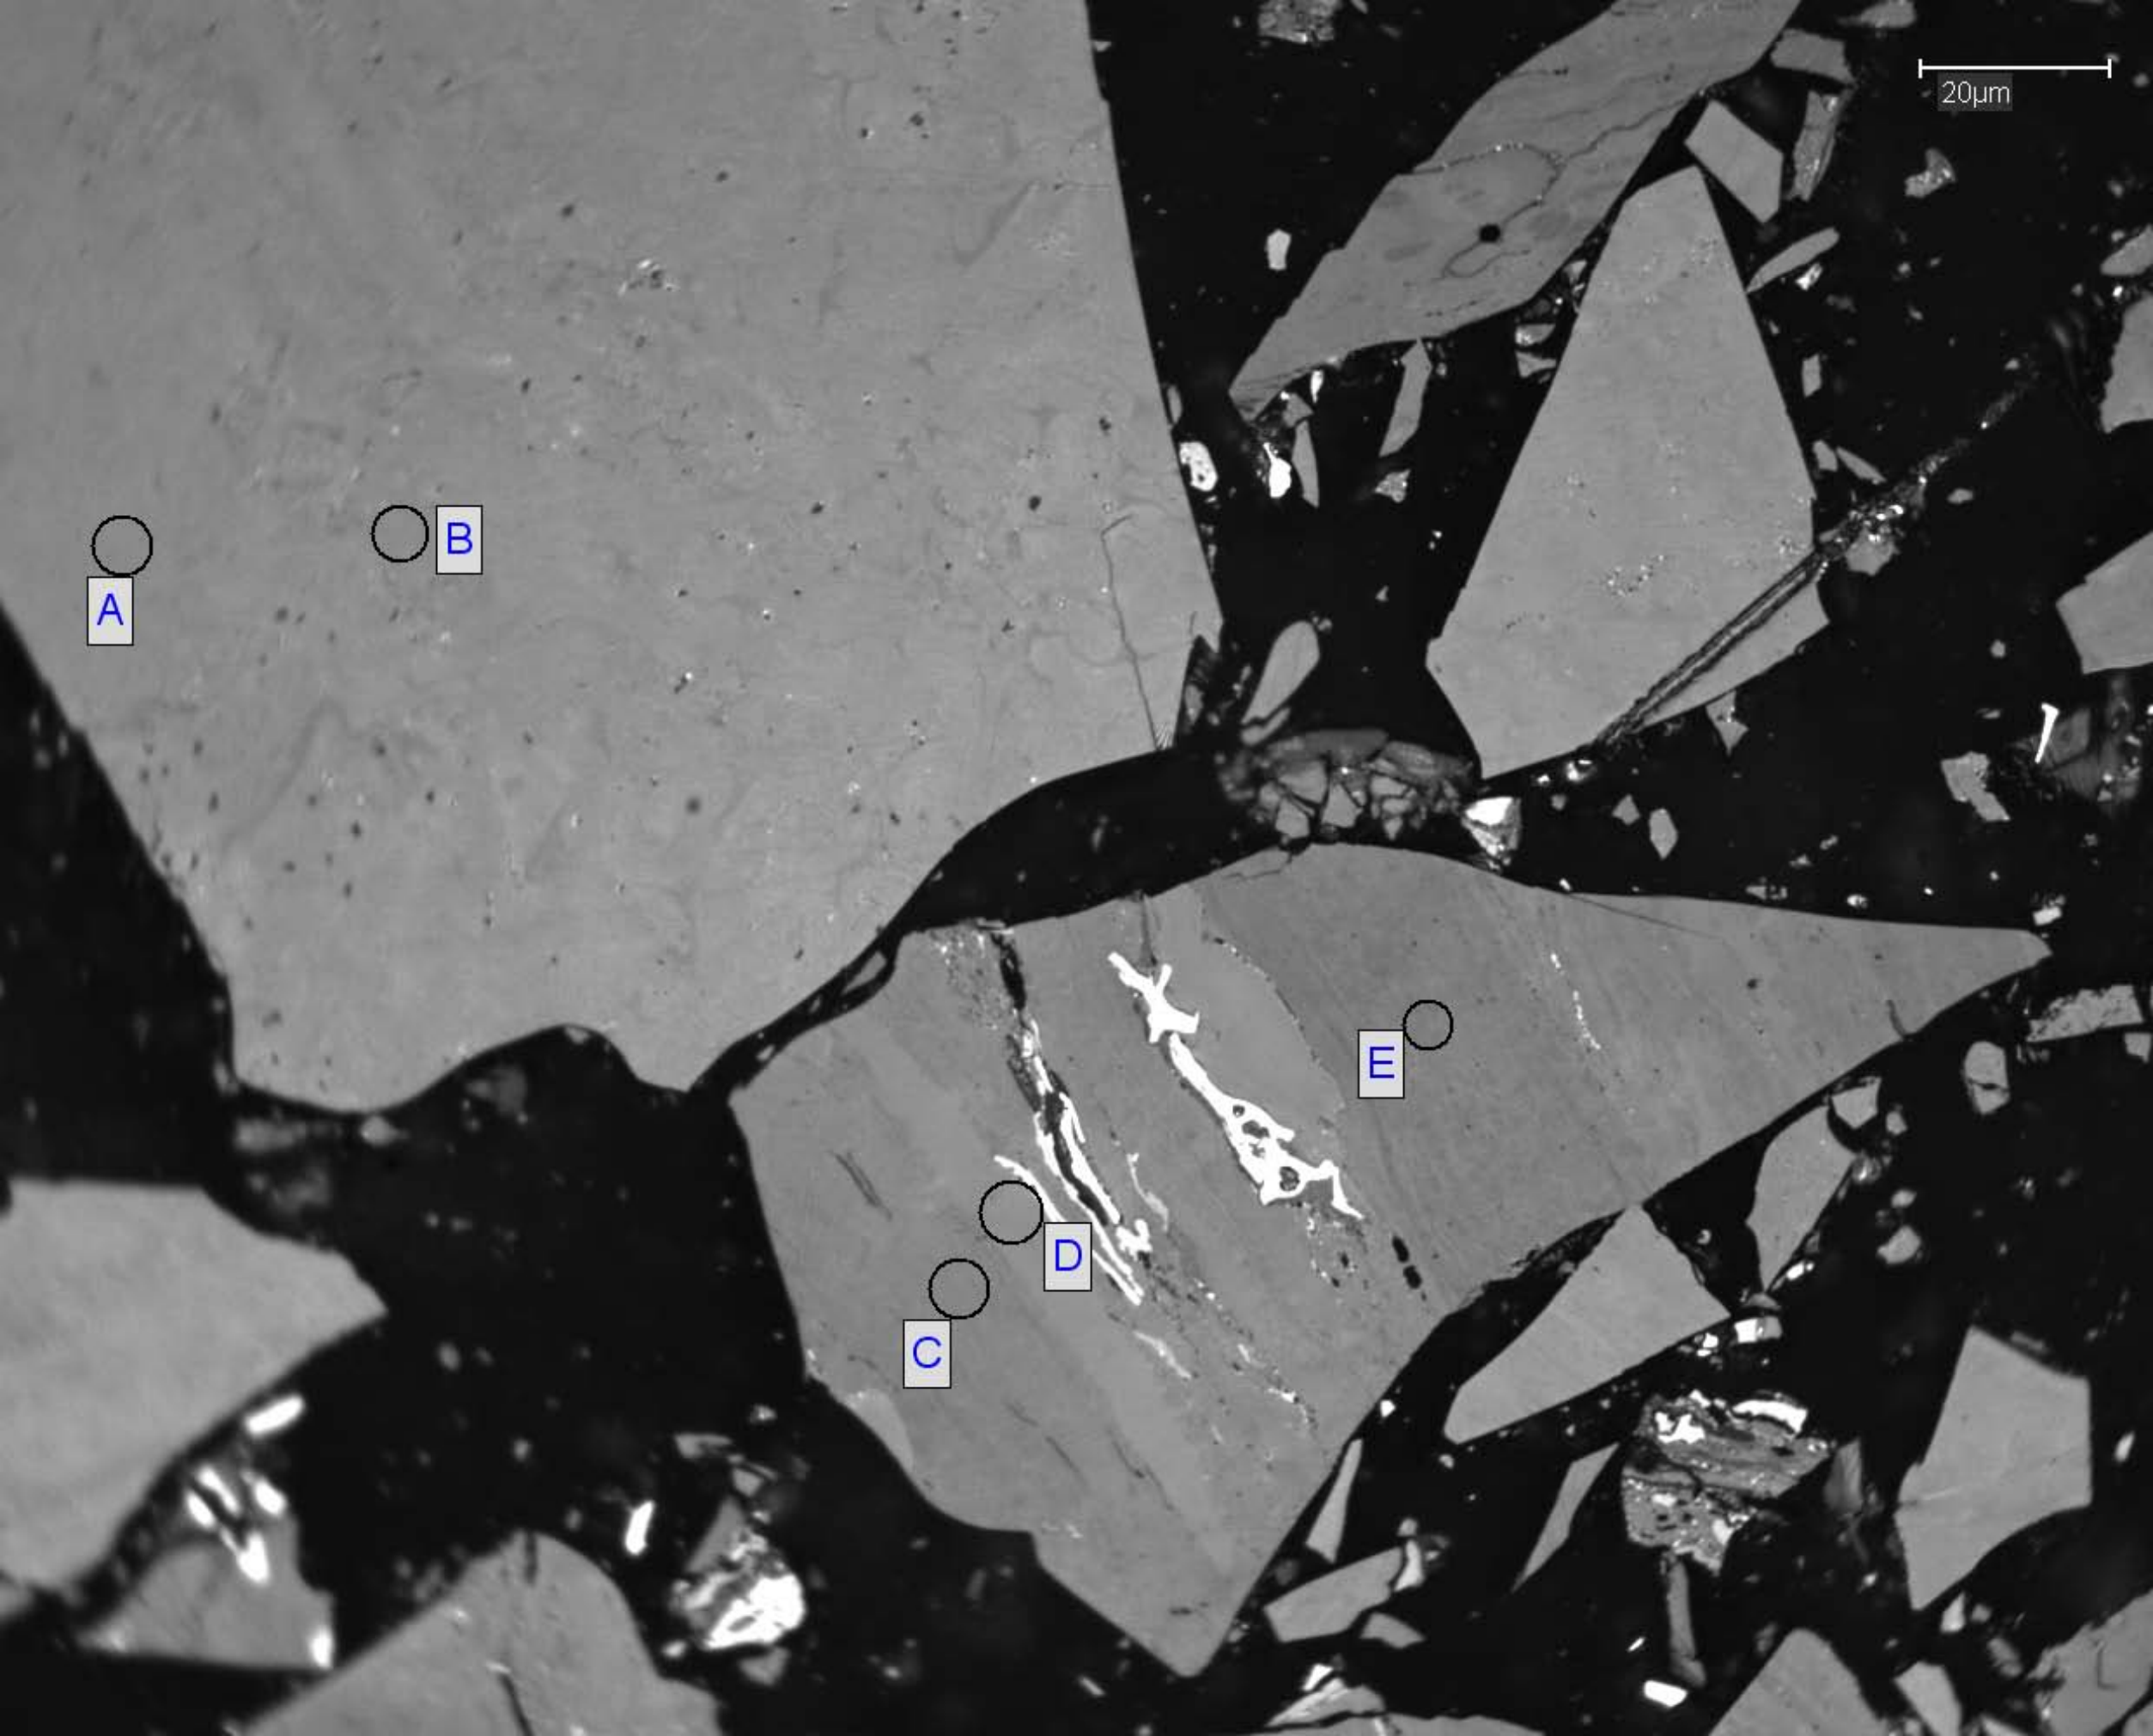

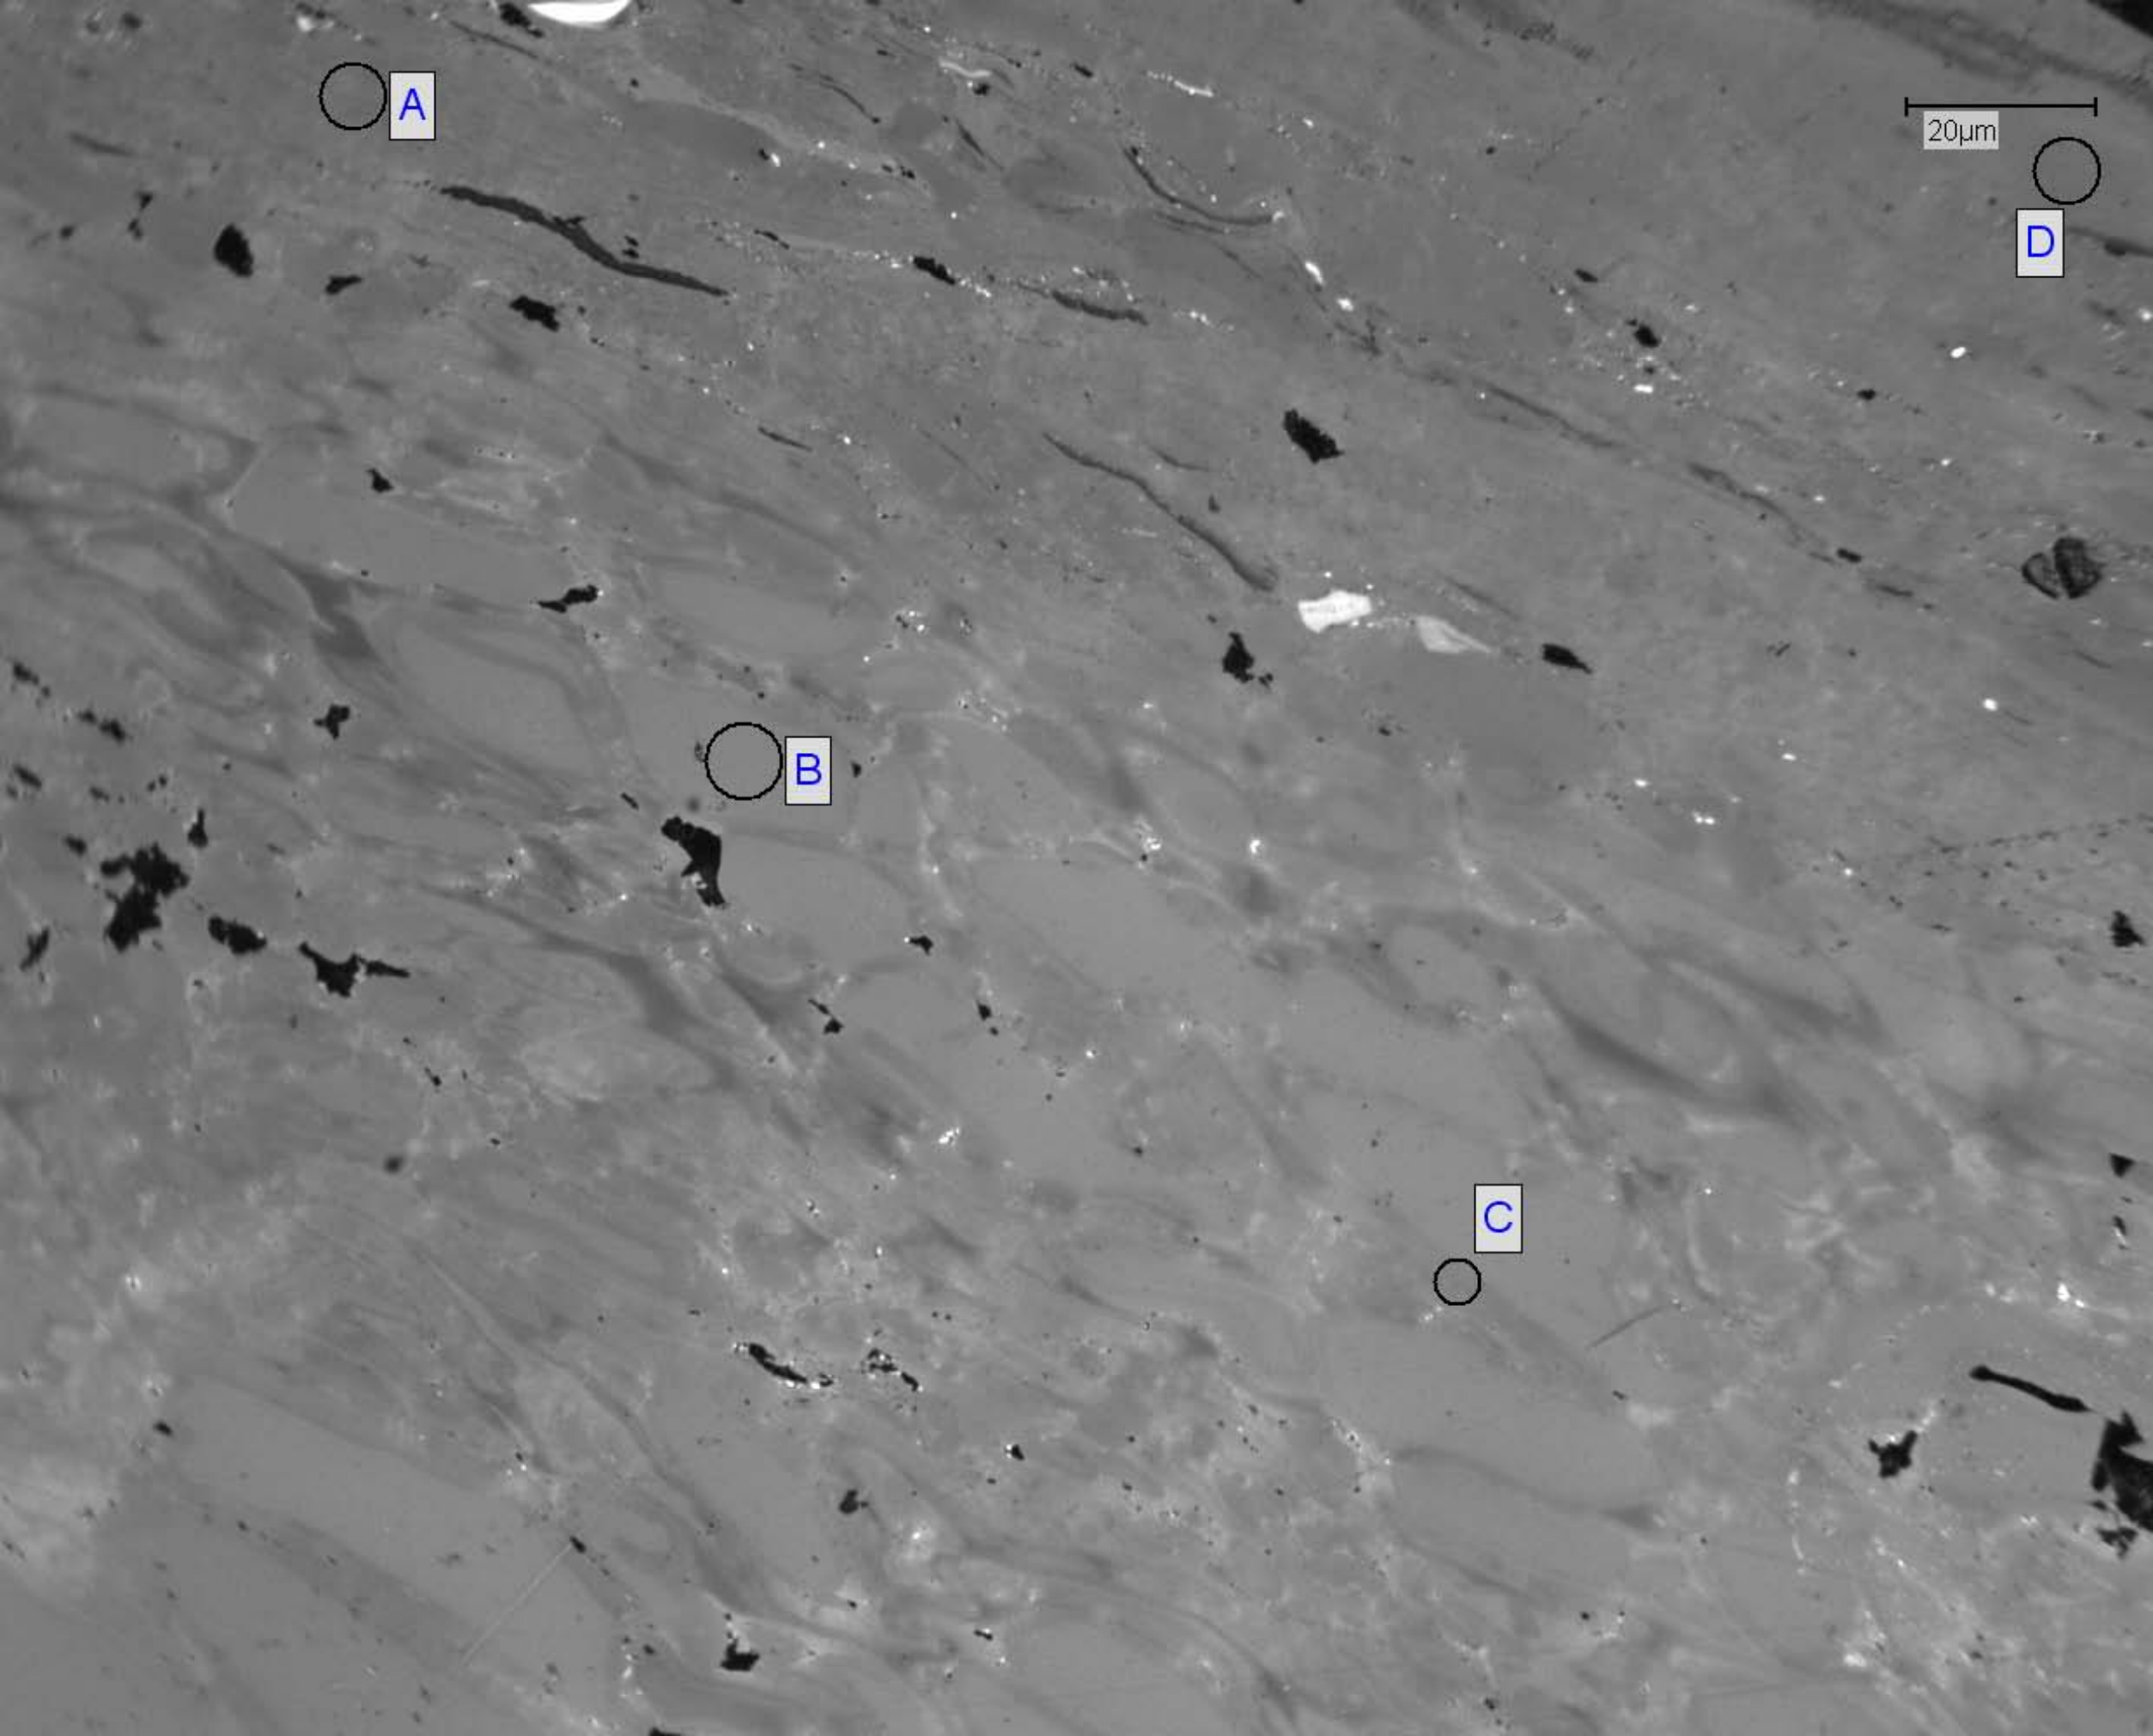


A

20µm

D

B

C

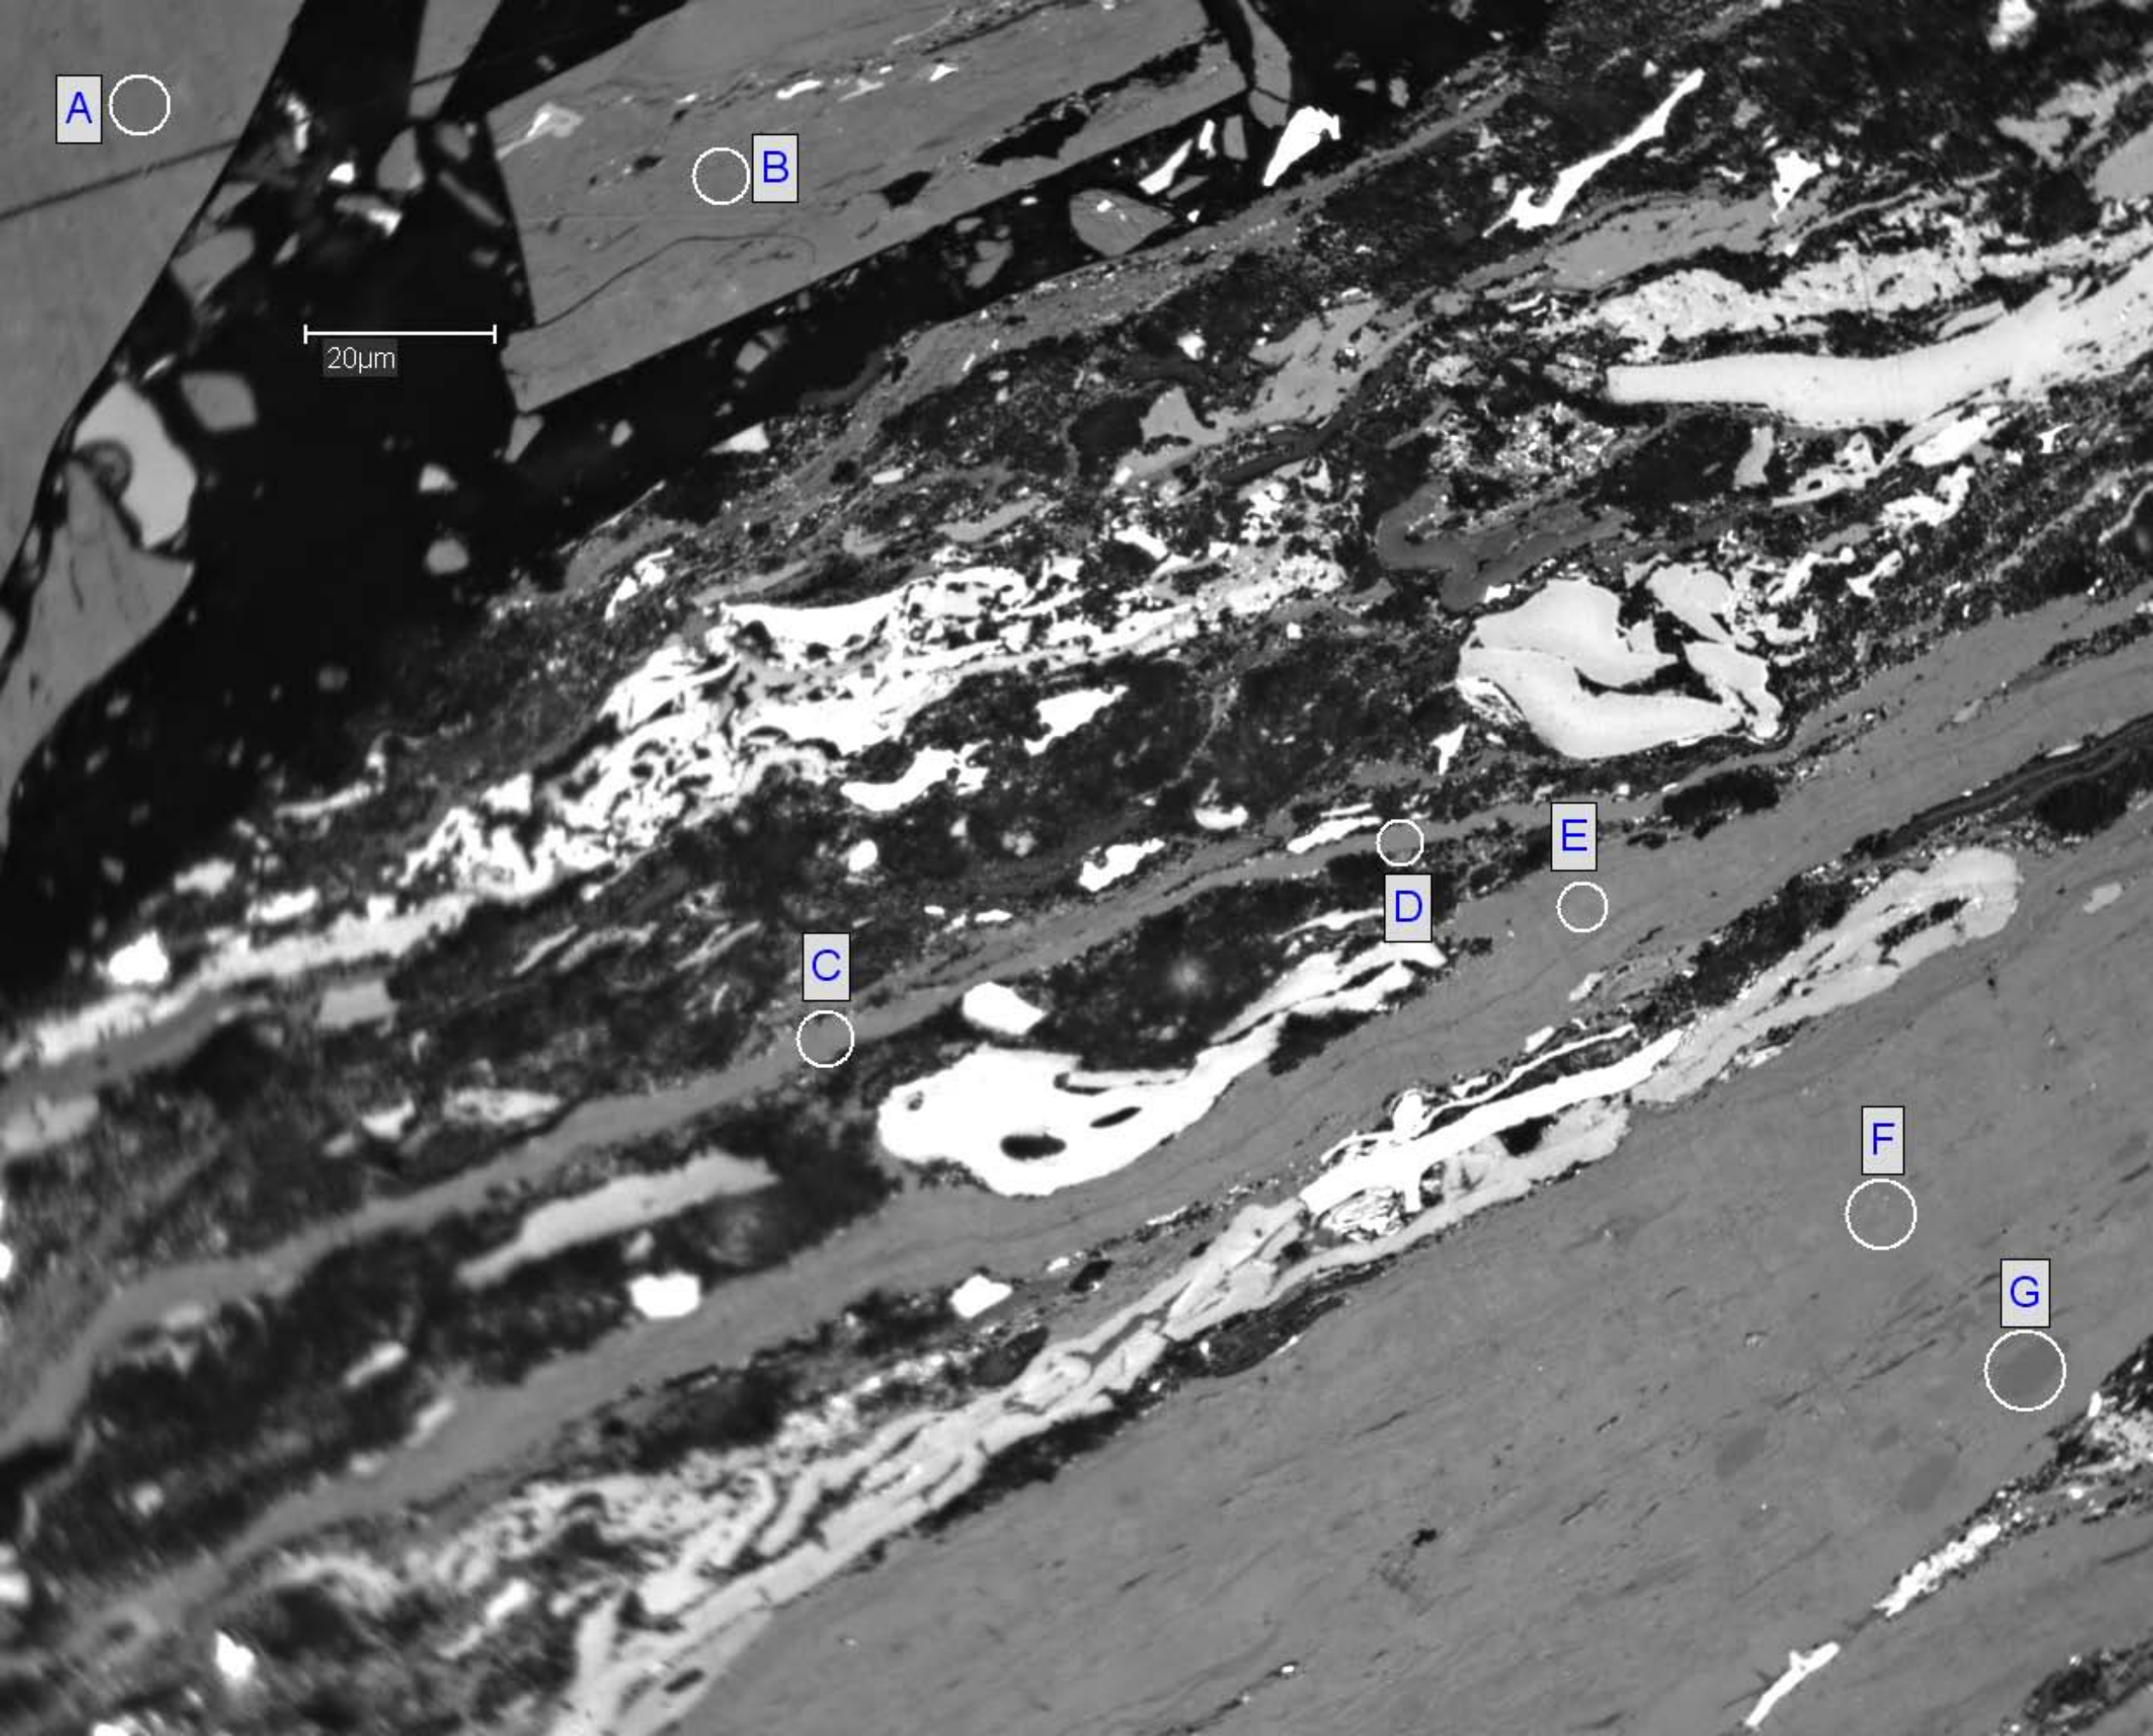

A

B

20µm


C

D

E

F

G

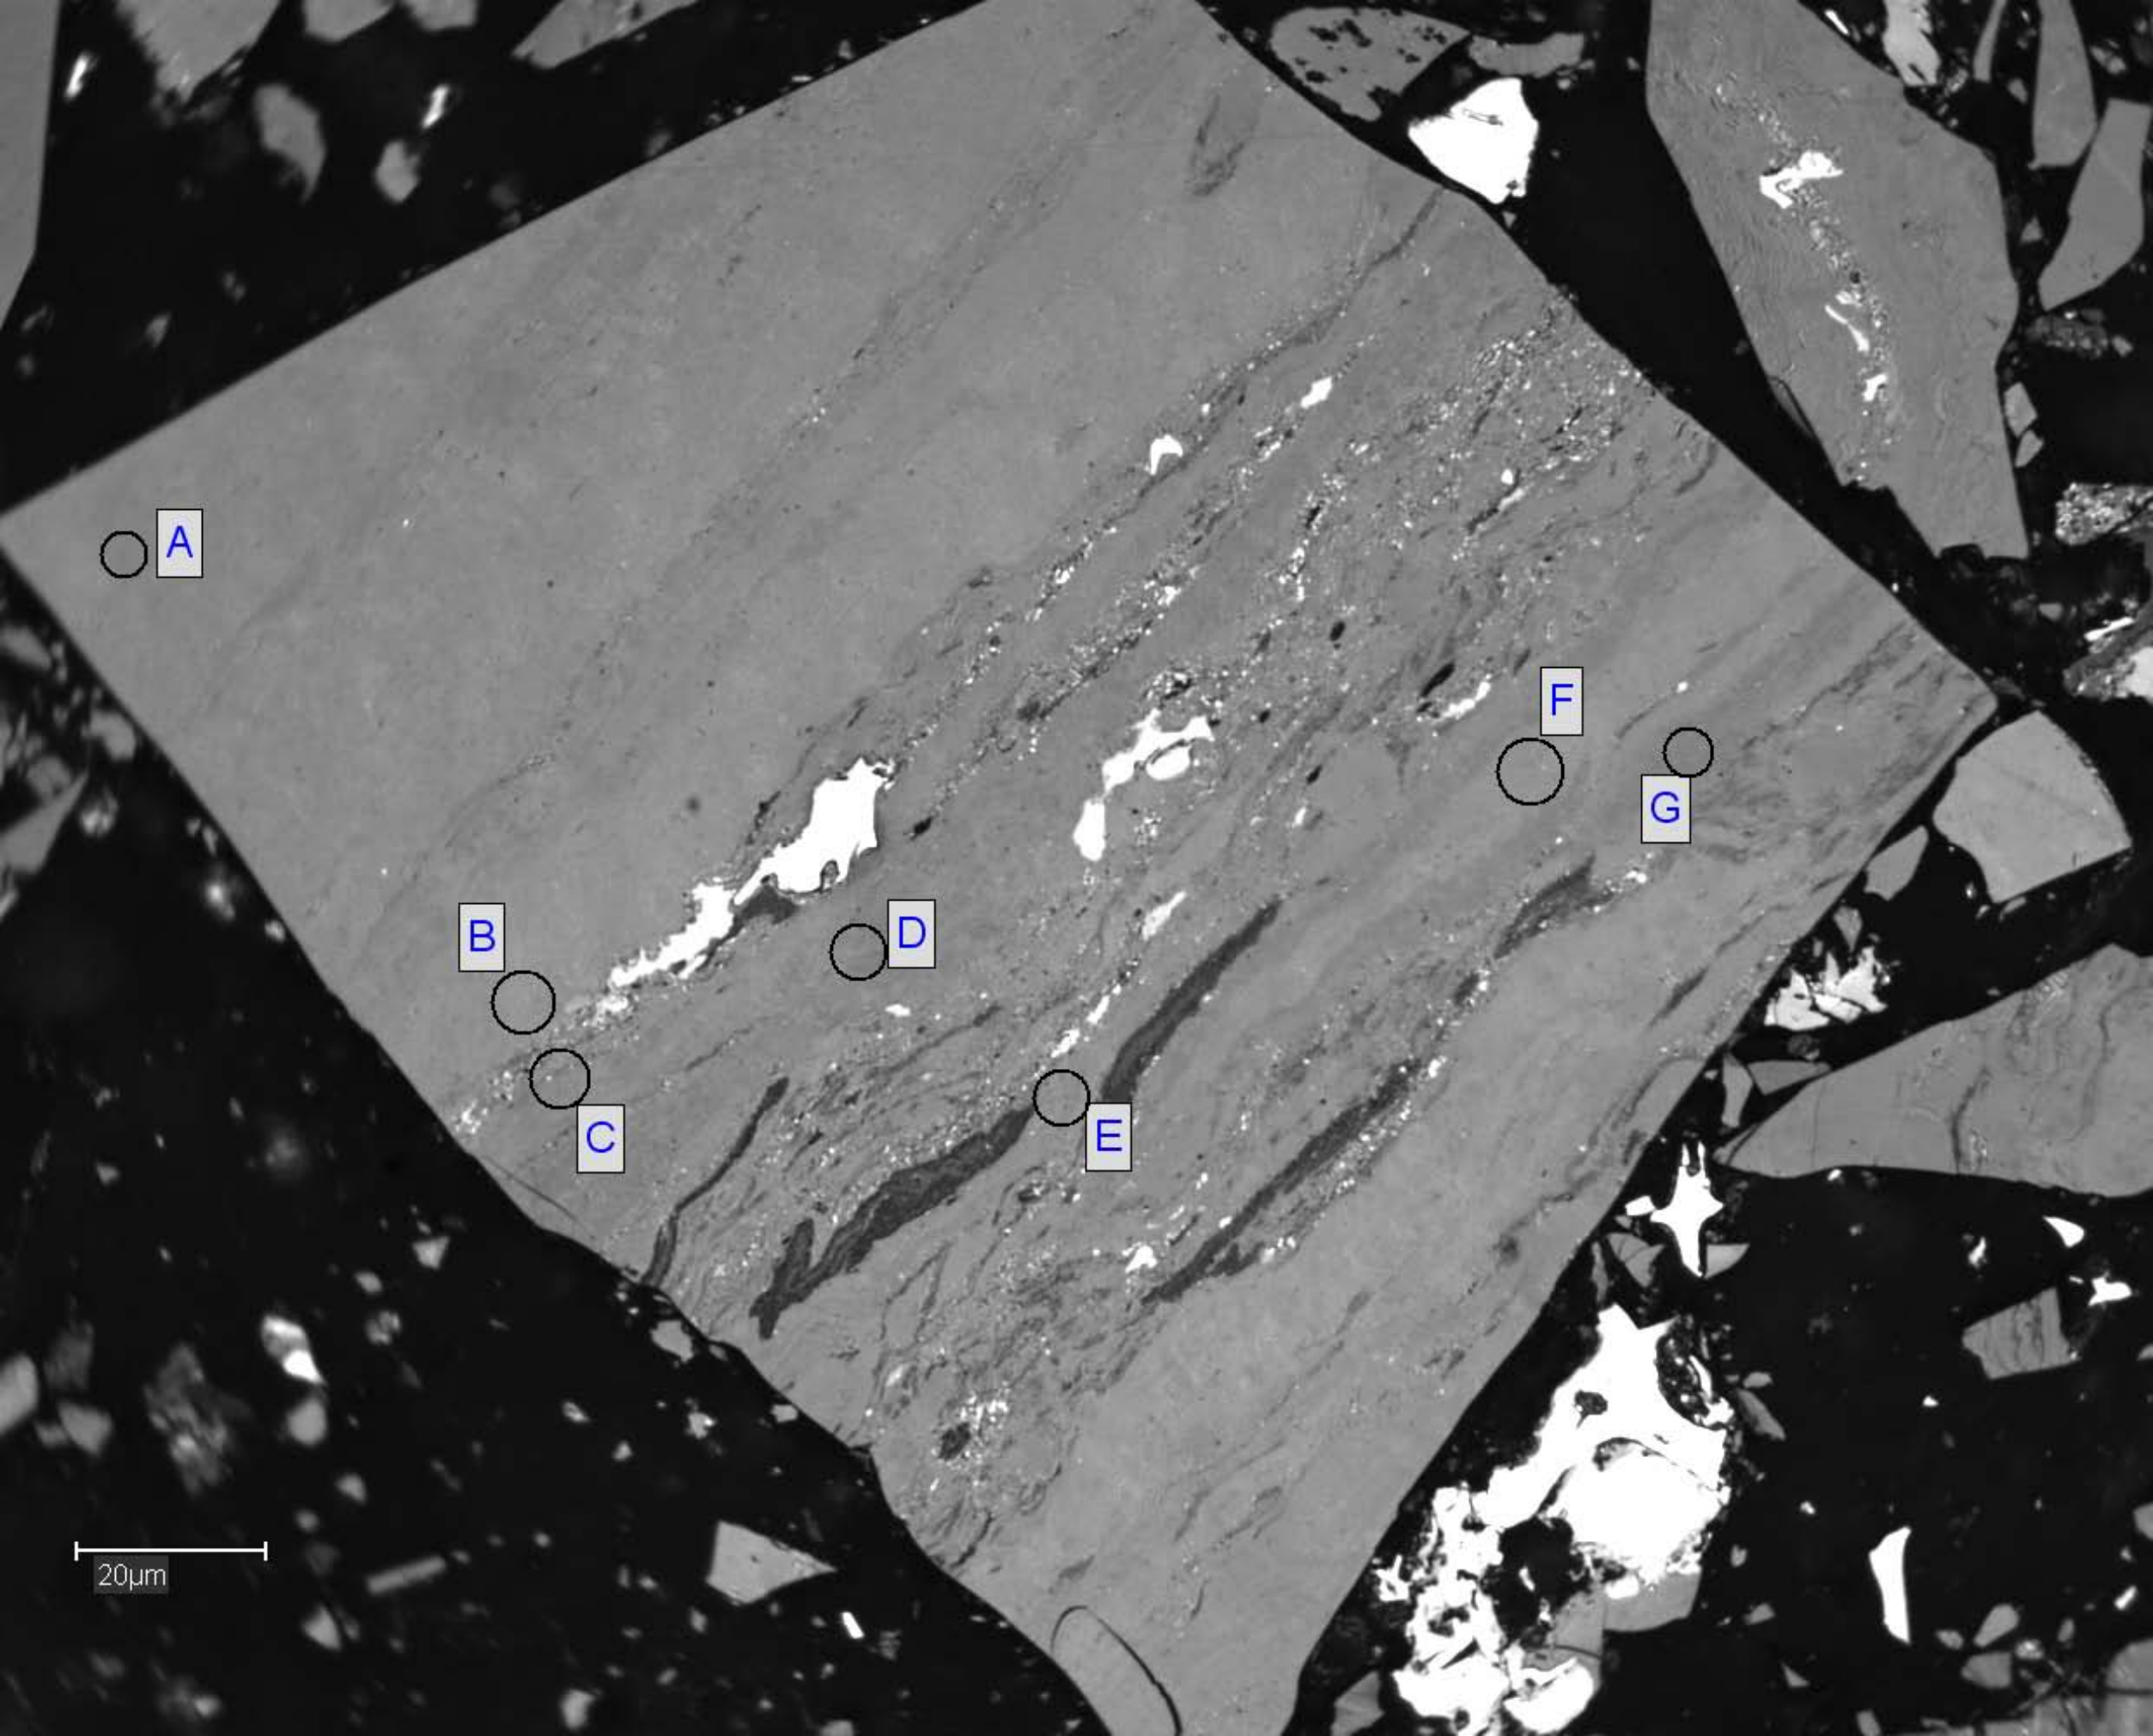

A

B

C

D

E

F

G

20µm

20µm

A



B



C



D



E




F




H



G

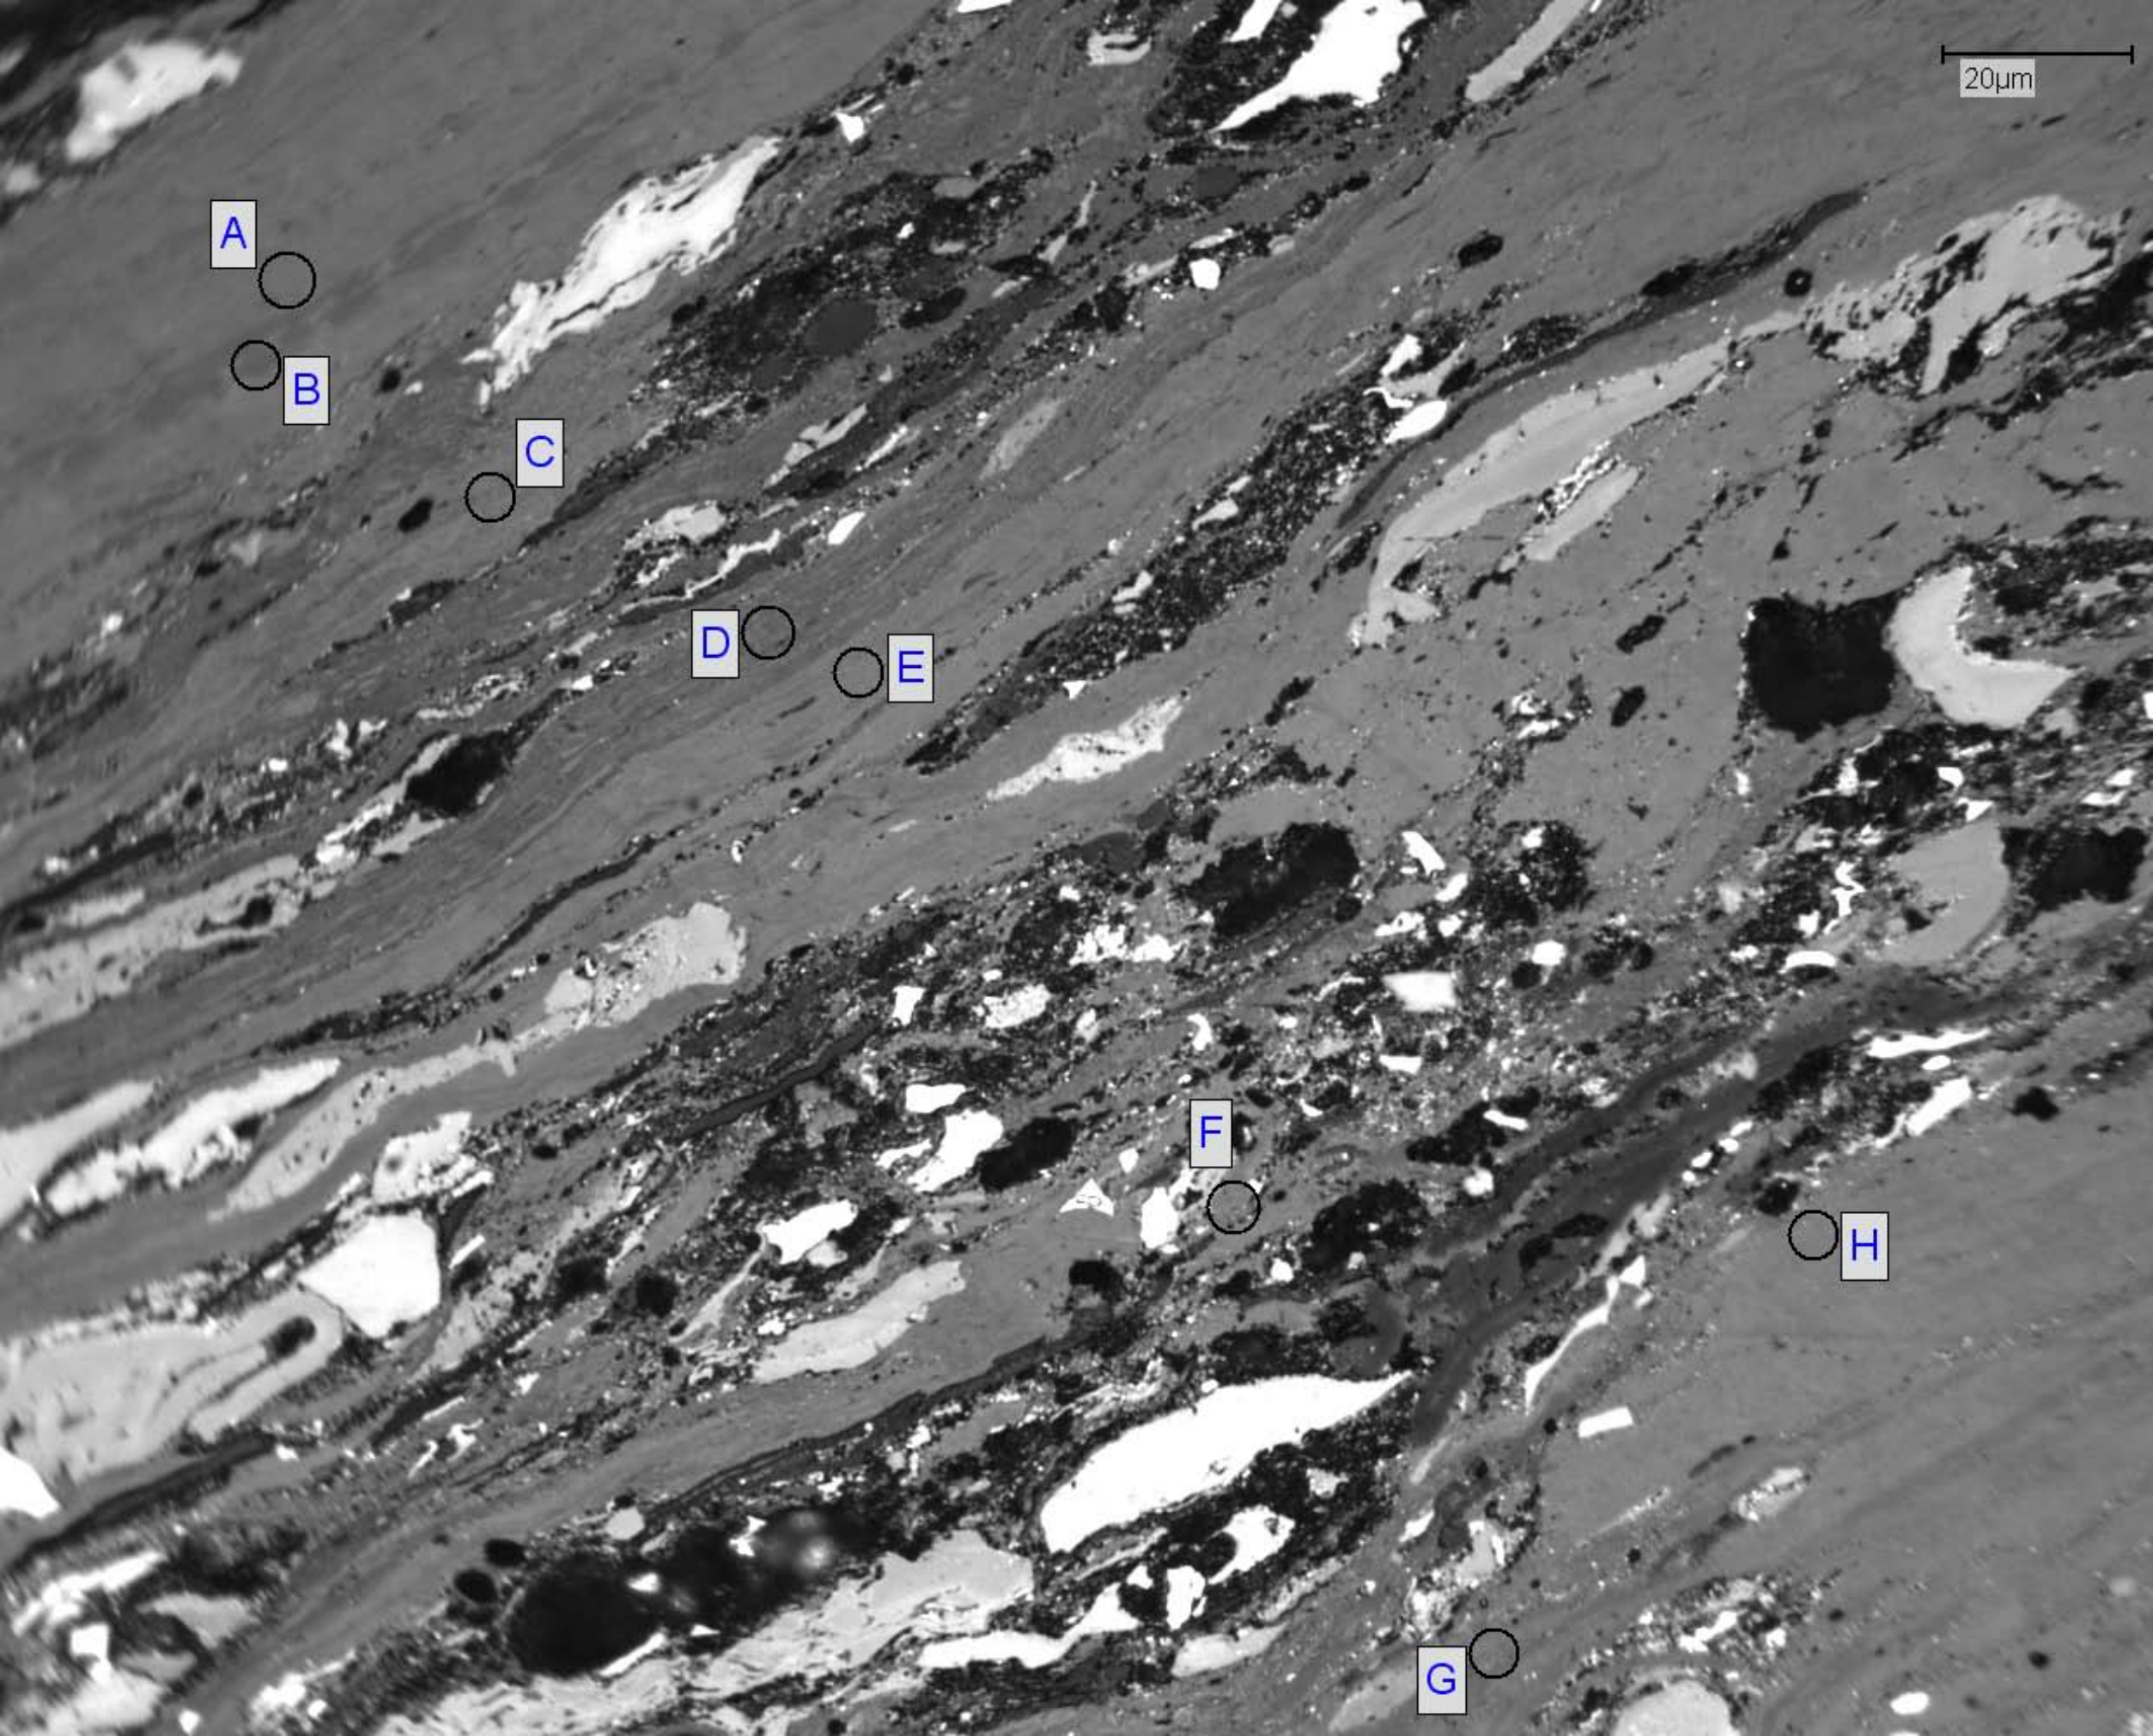

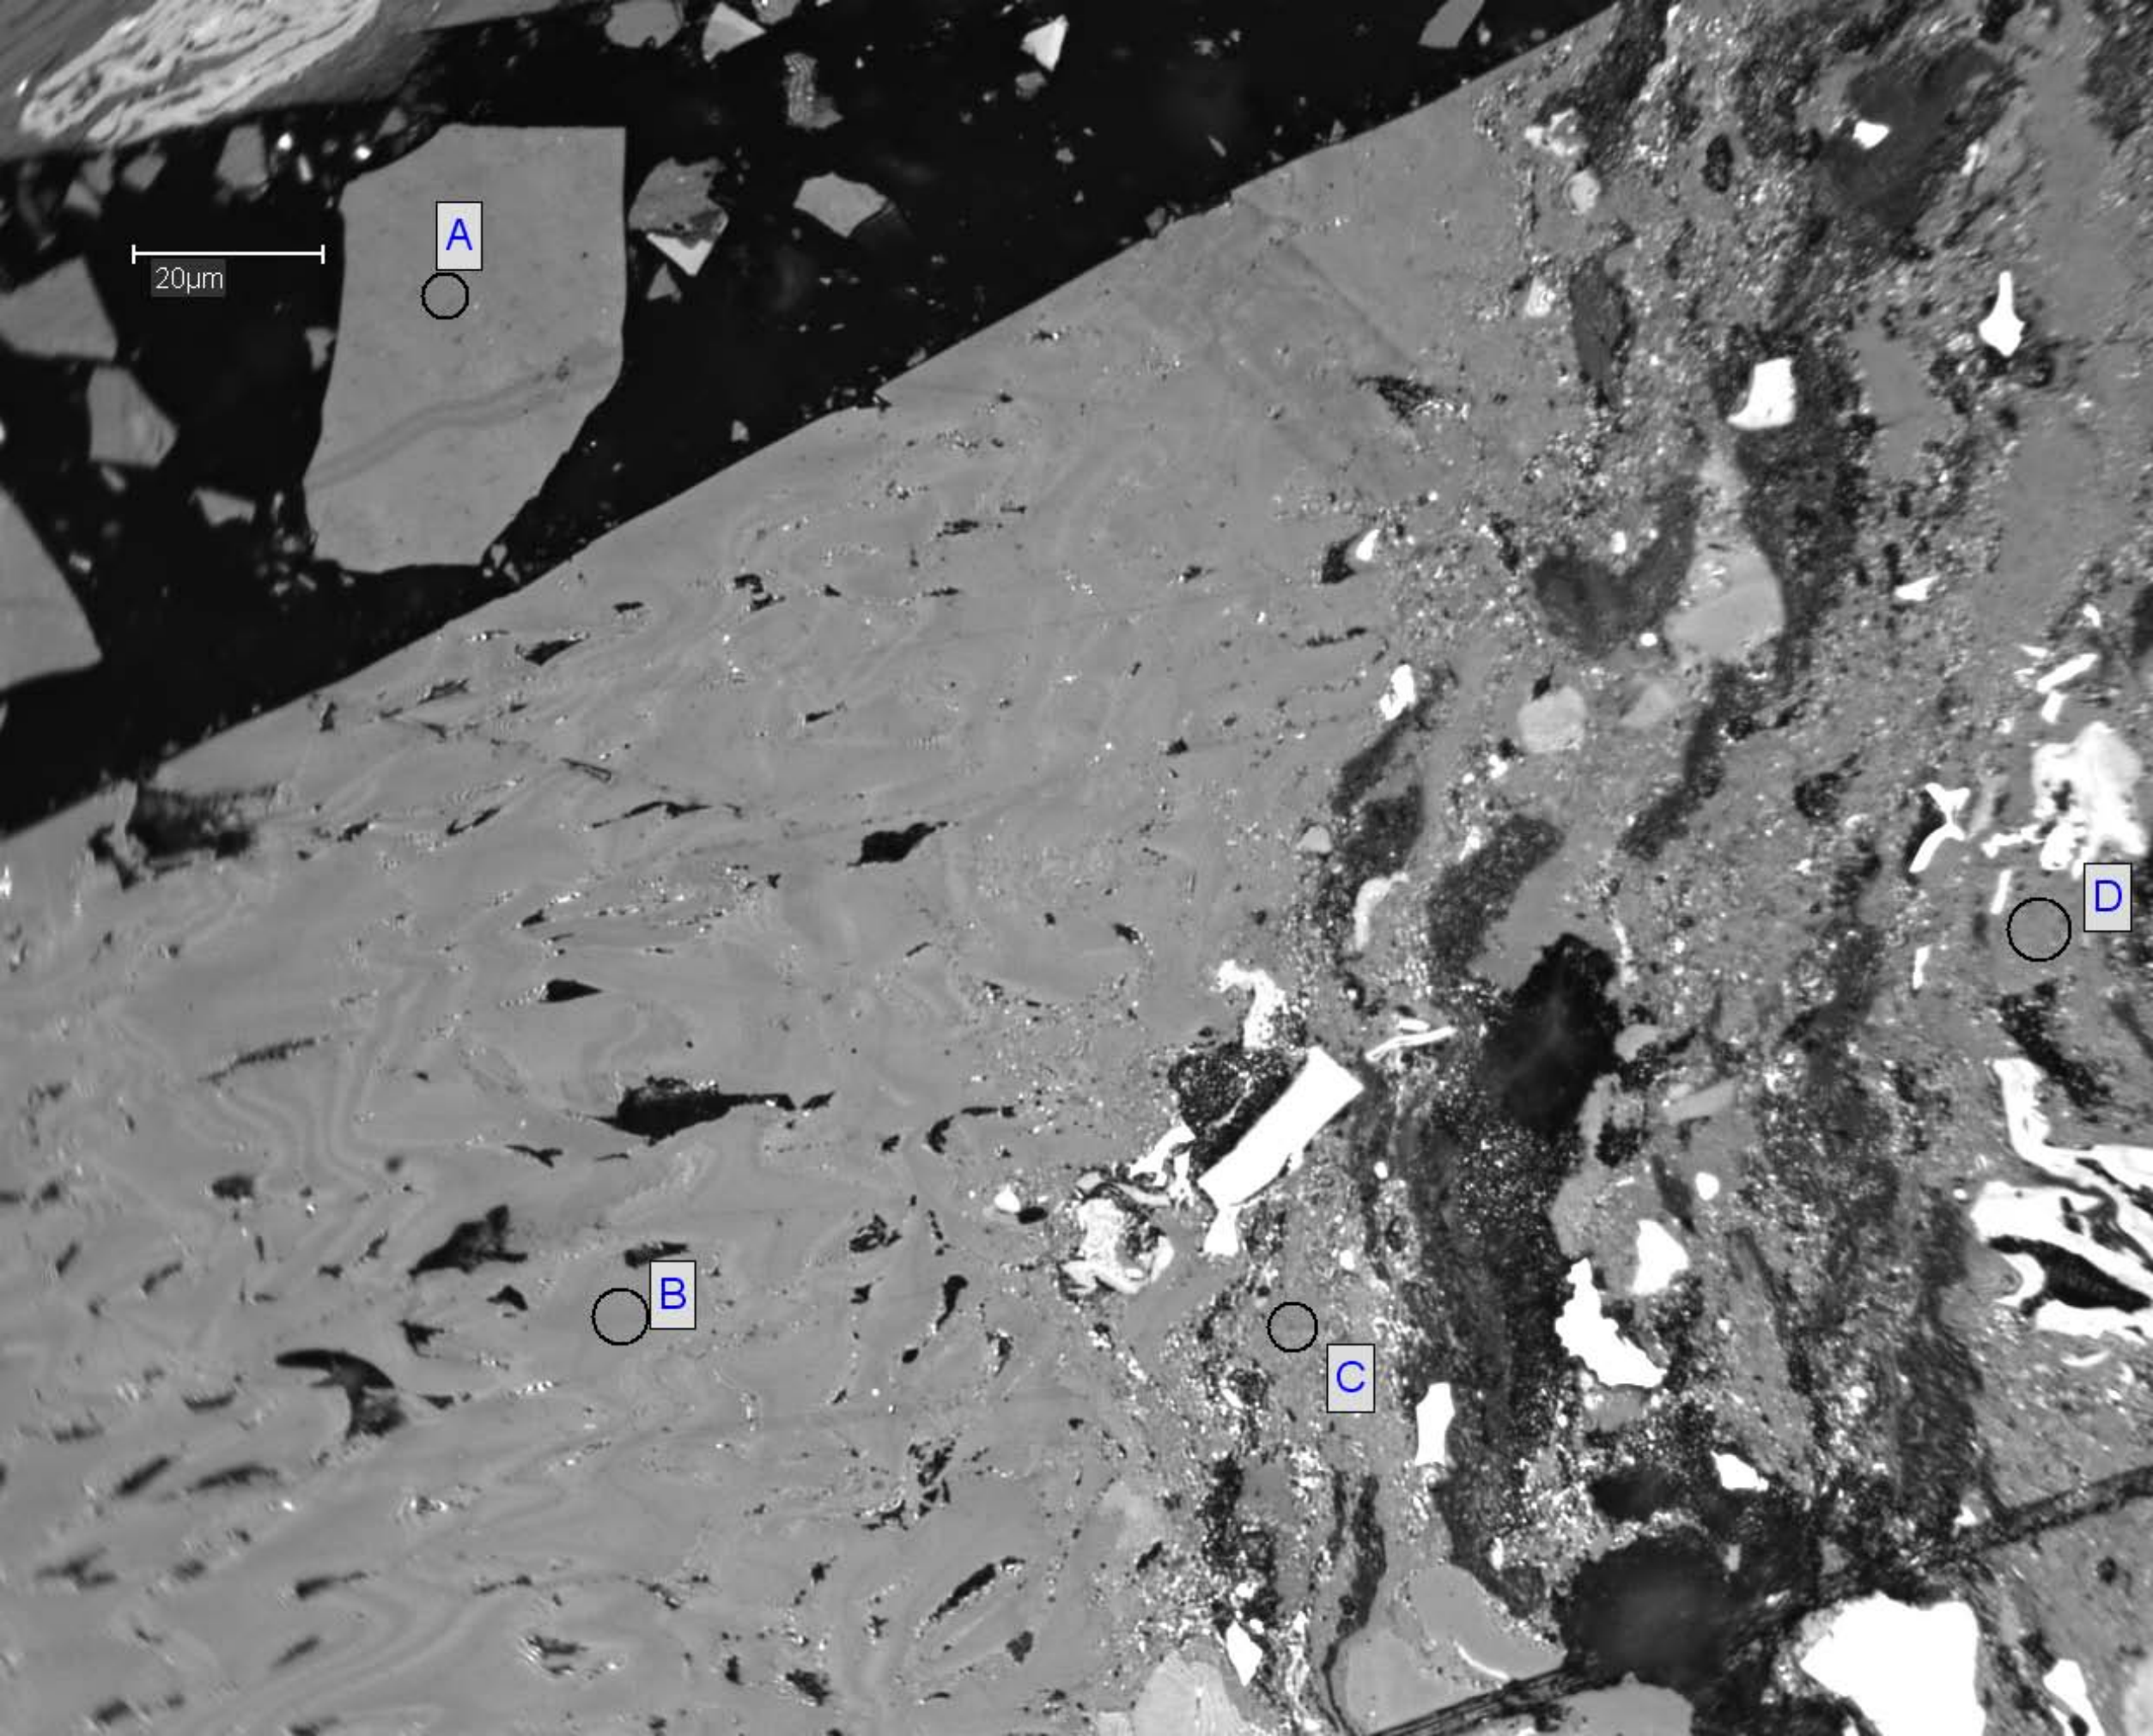

20µm

A

B

C

D

20μm

A



B

20μm

A



B




D



E

C



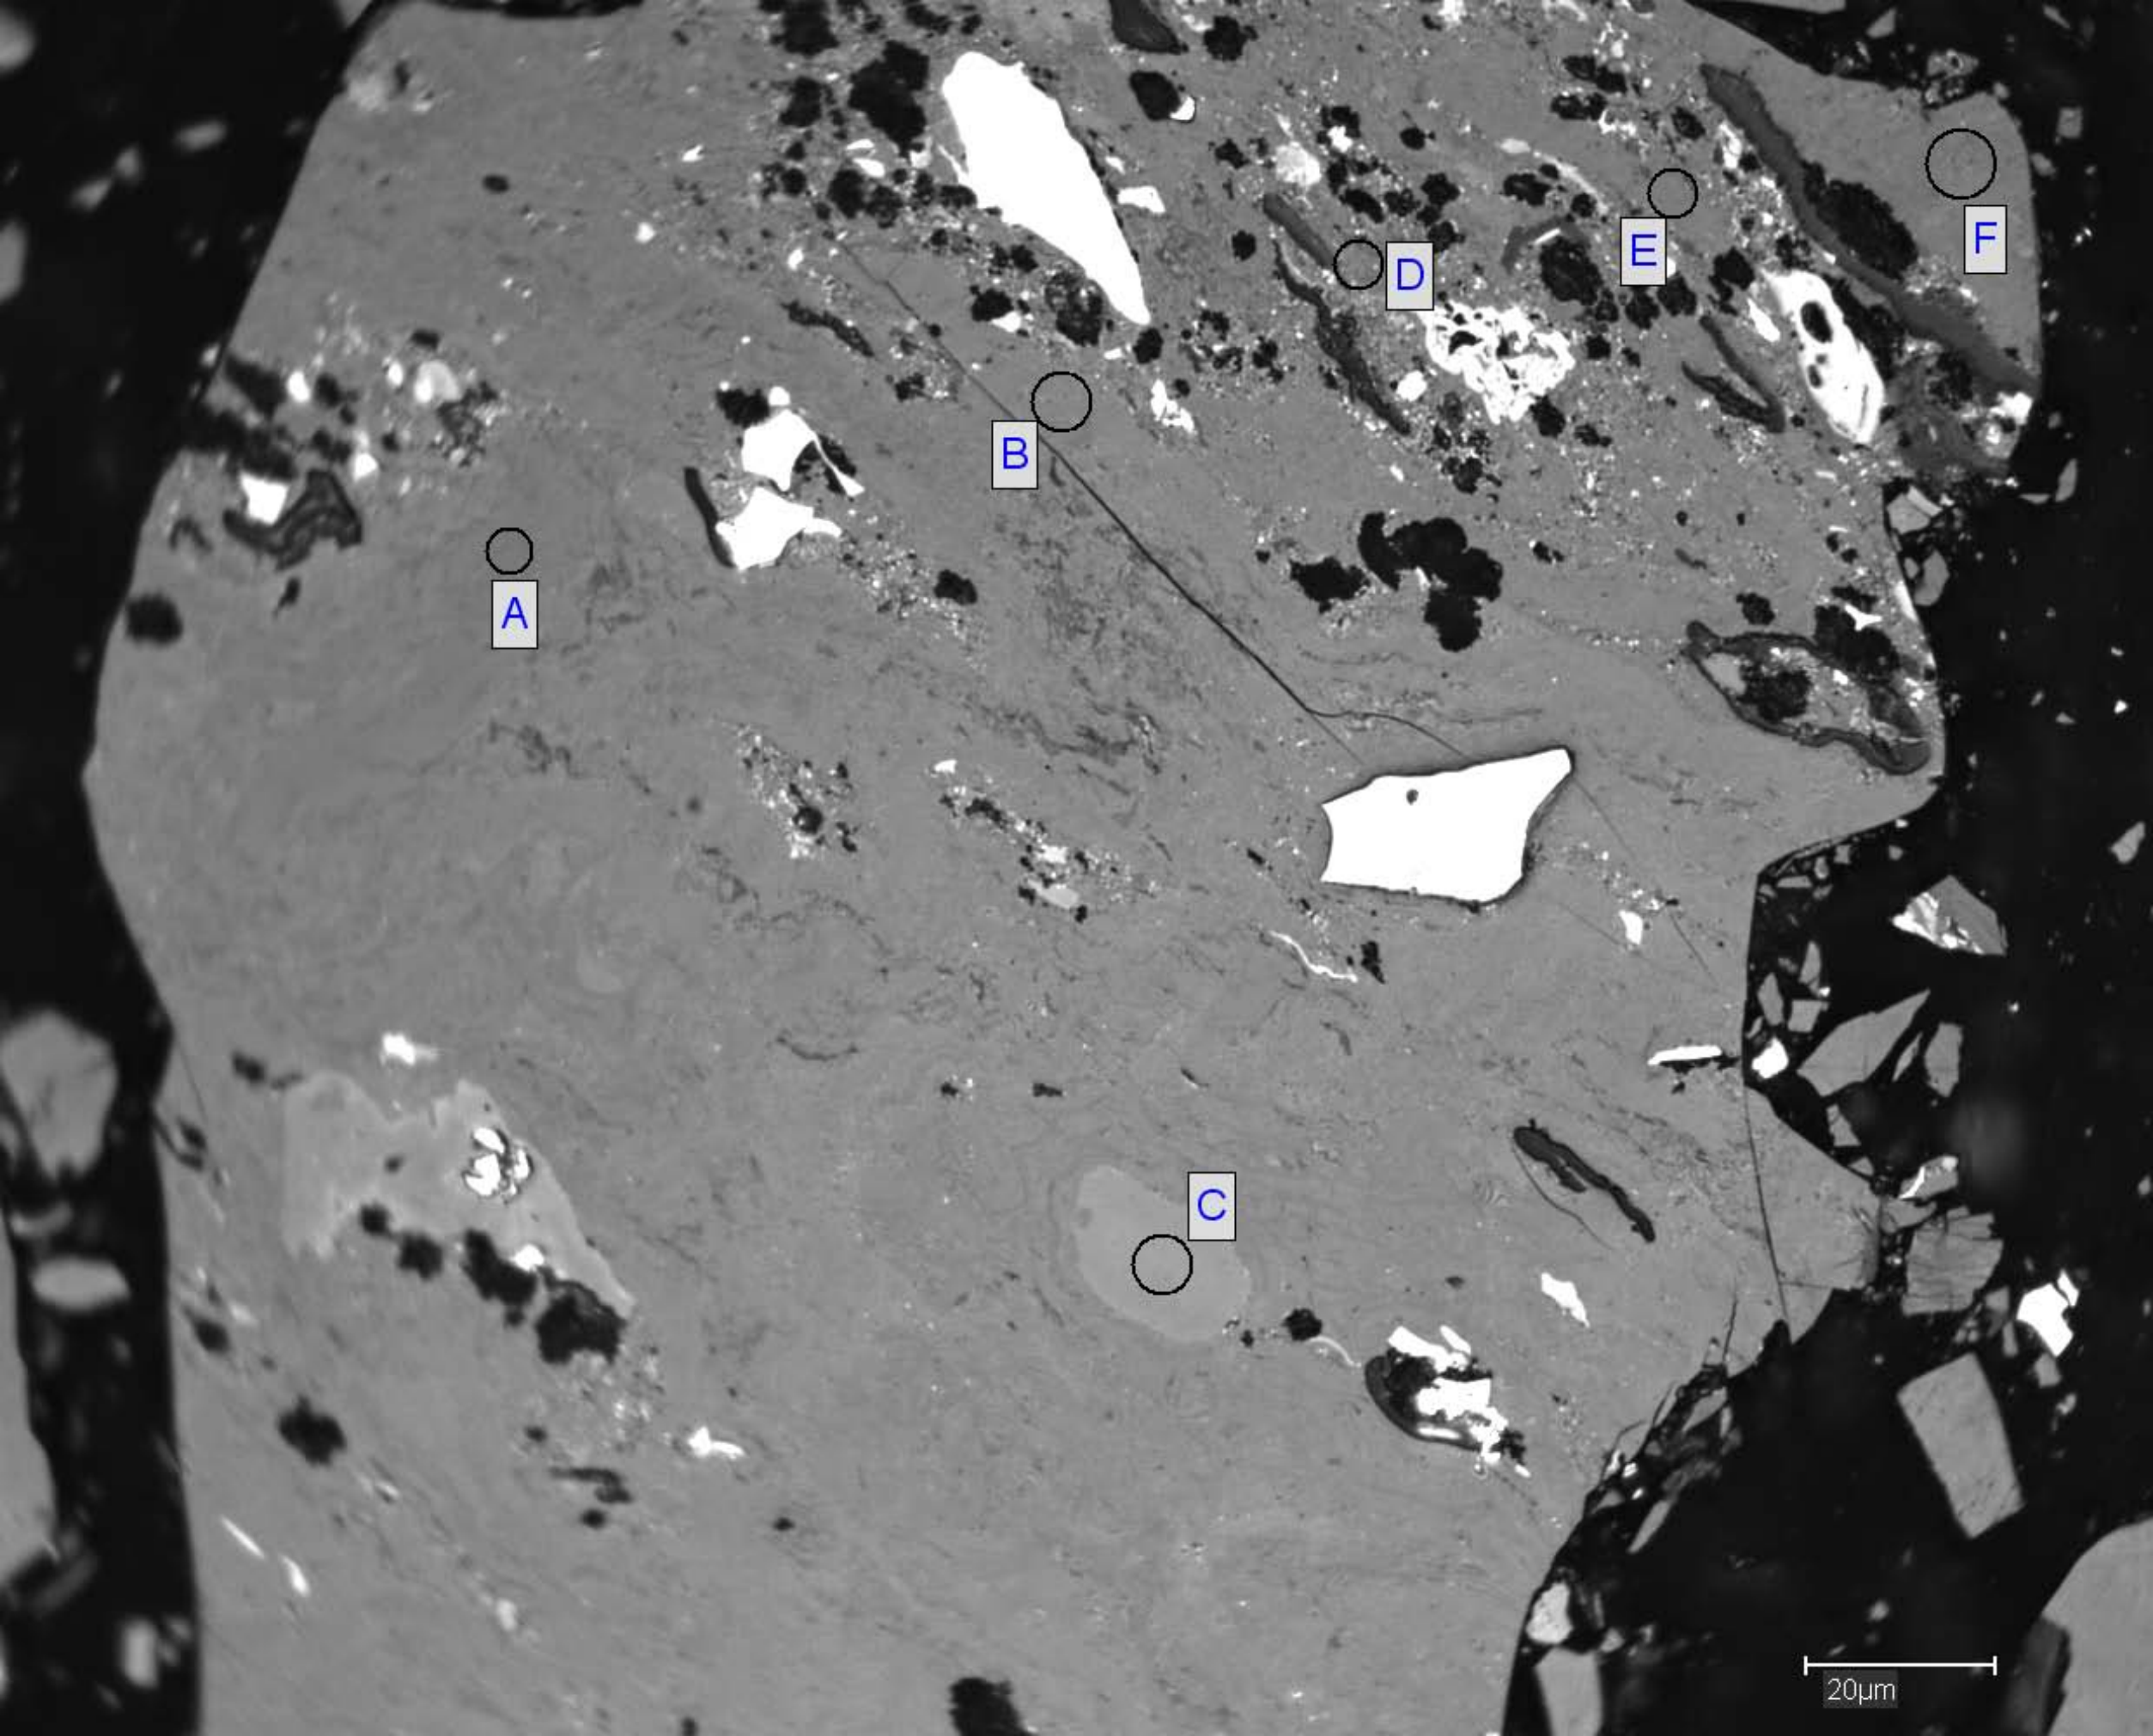

A

B

C

D

E

F

20µm

20μm

A



B




C




D



E

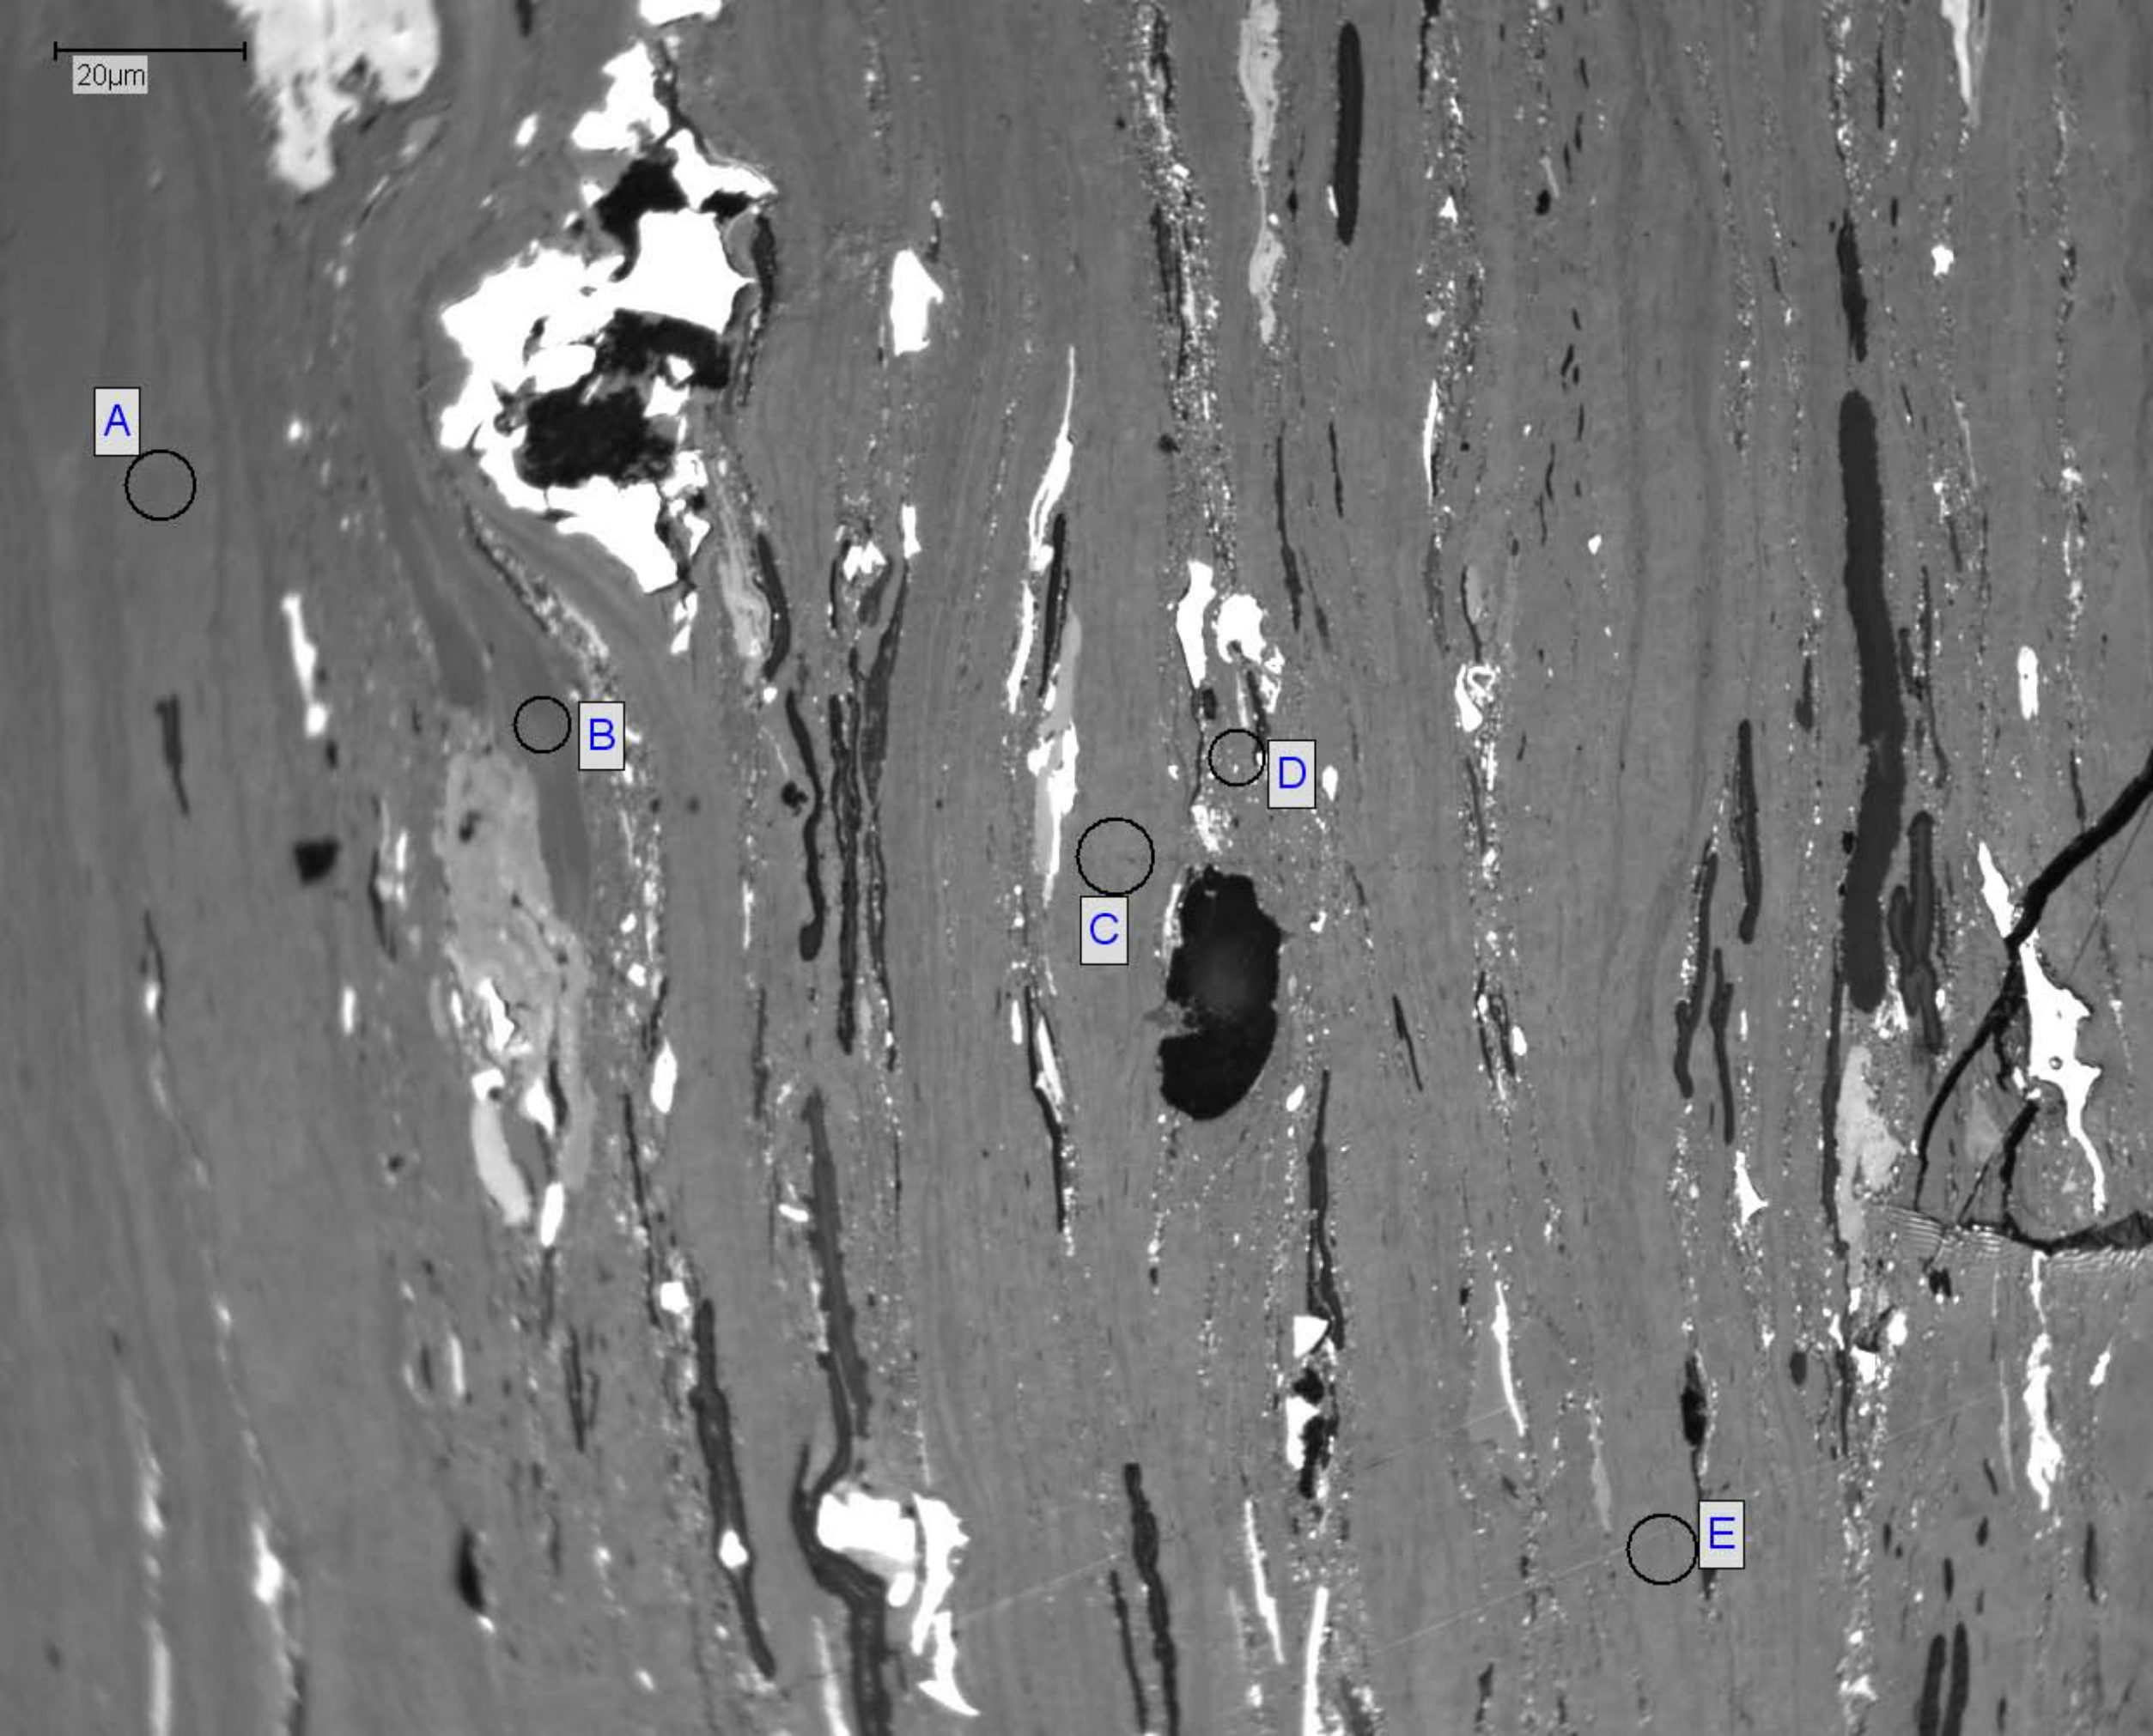

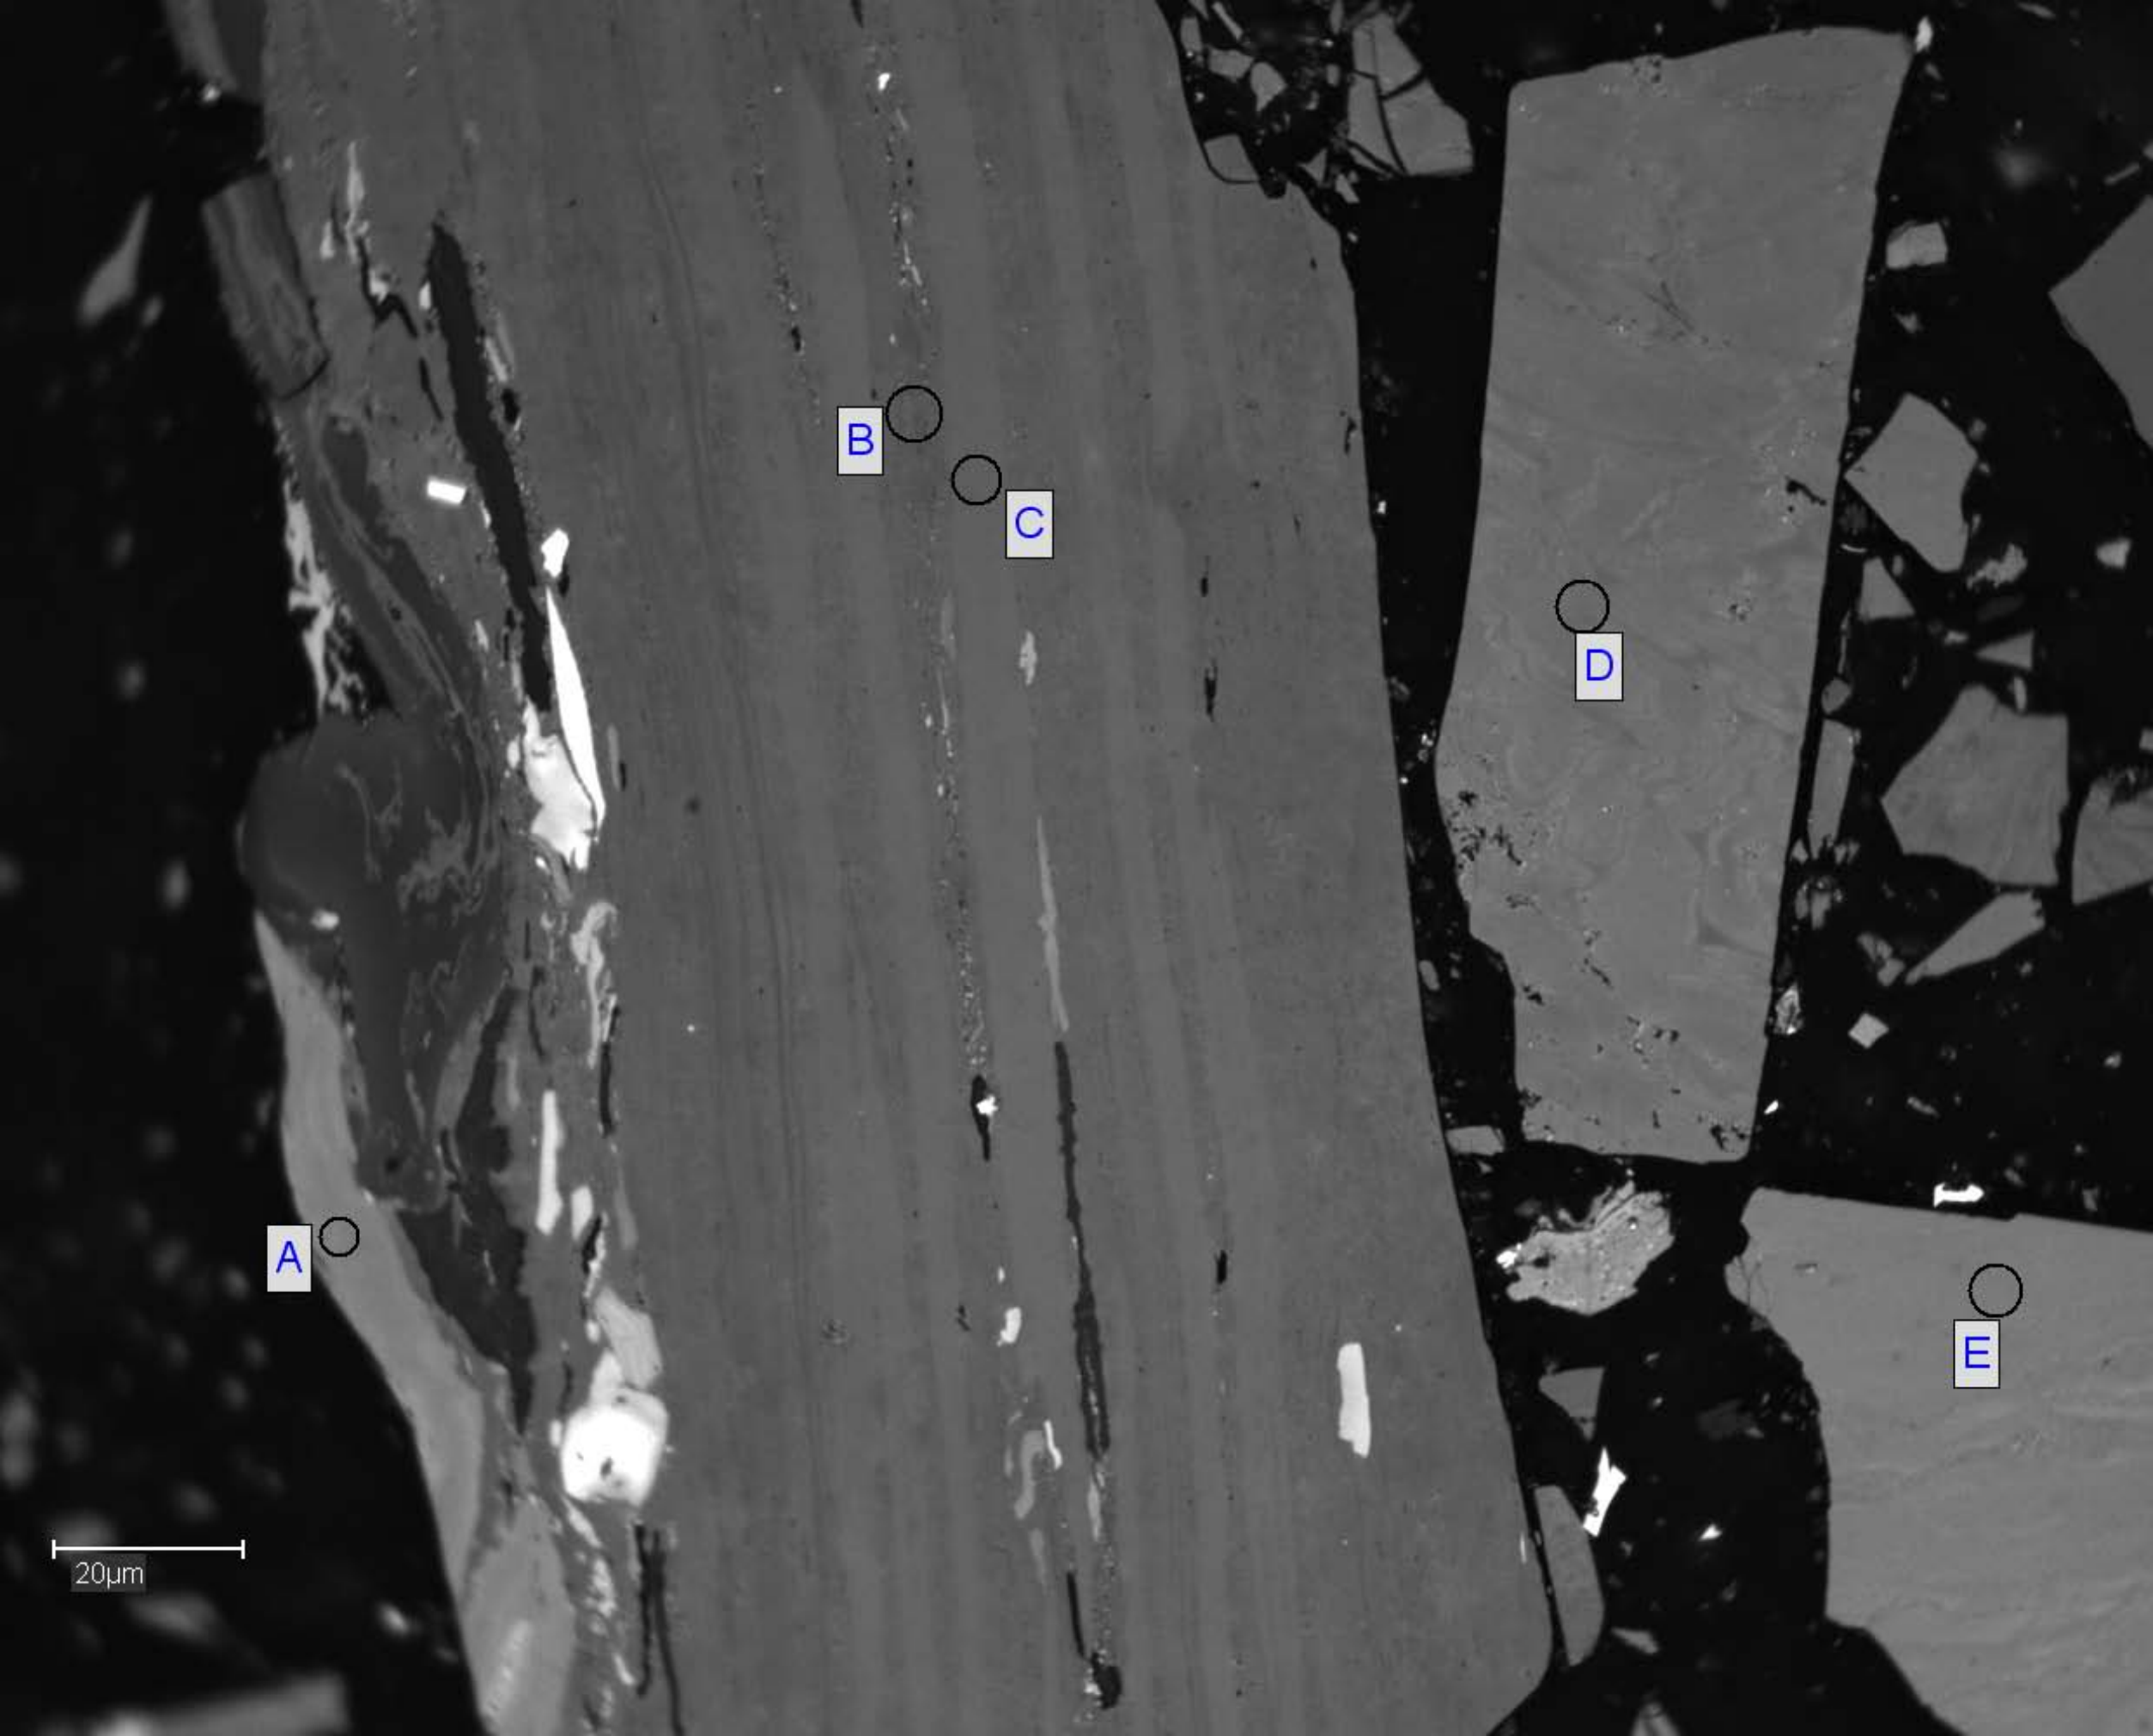

A


B

C

D

E

20µm

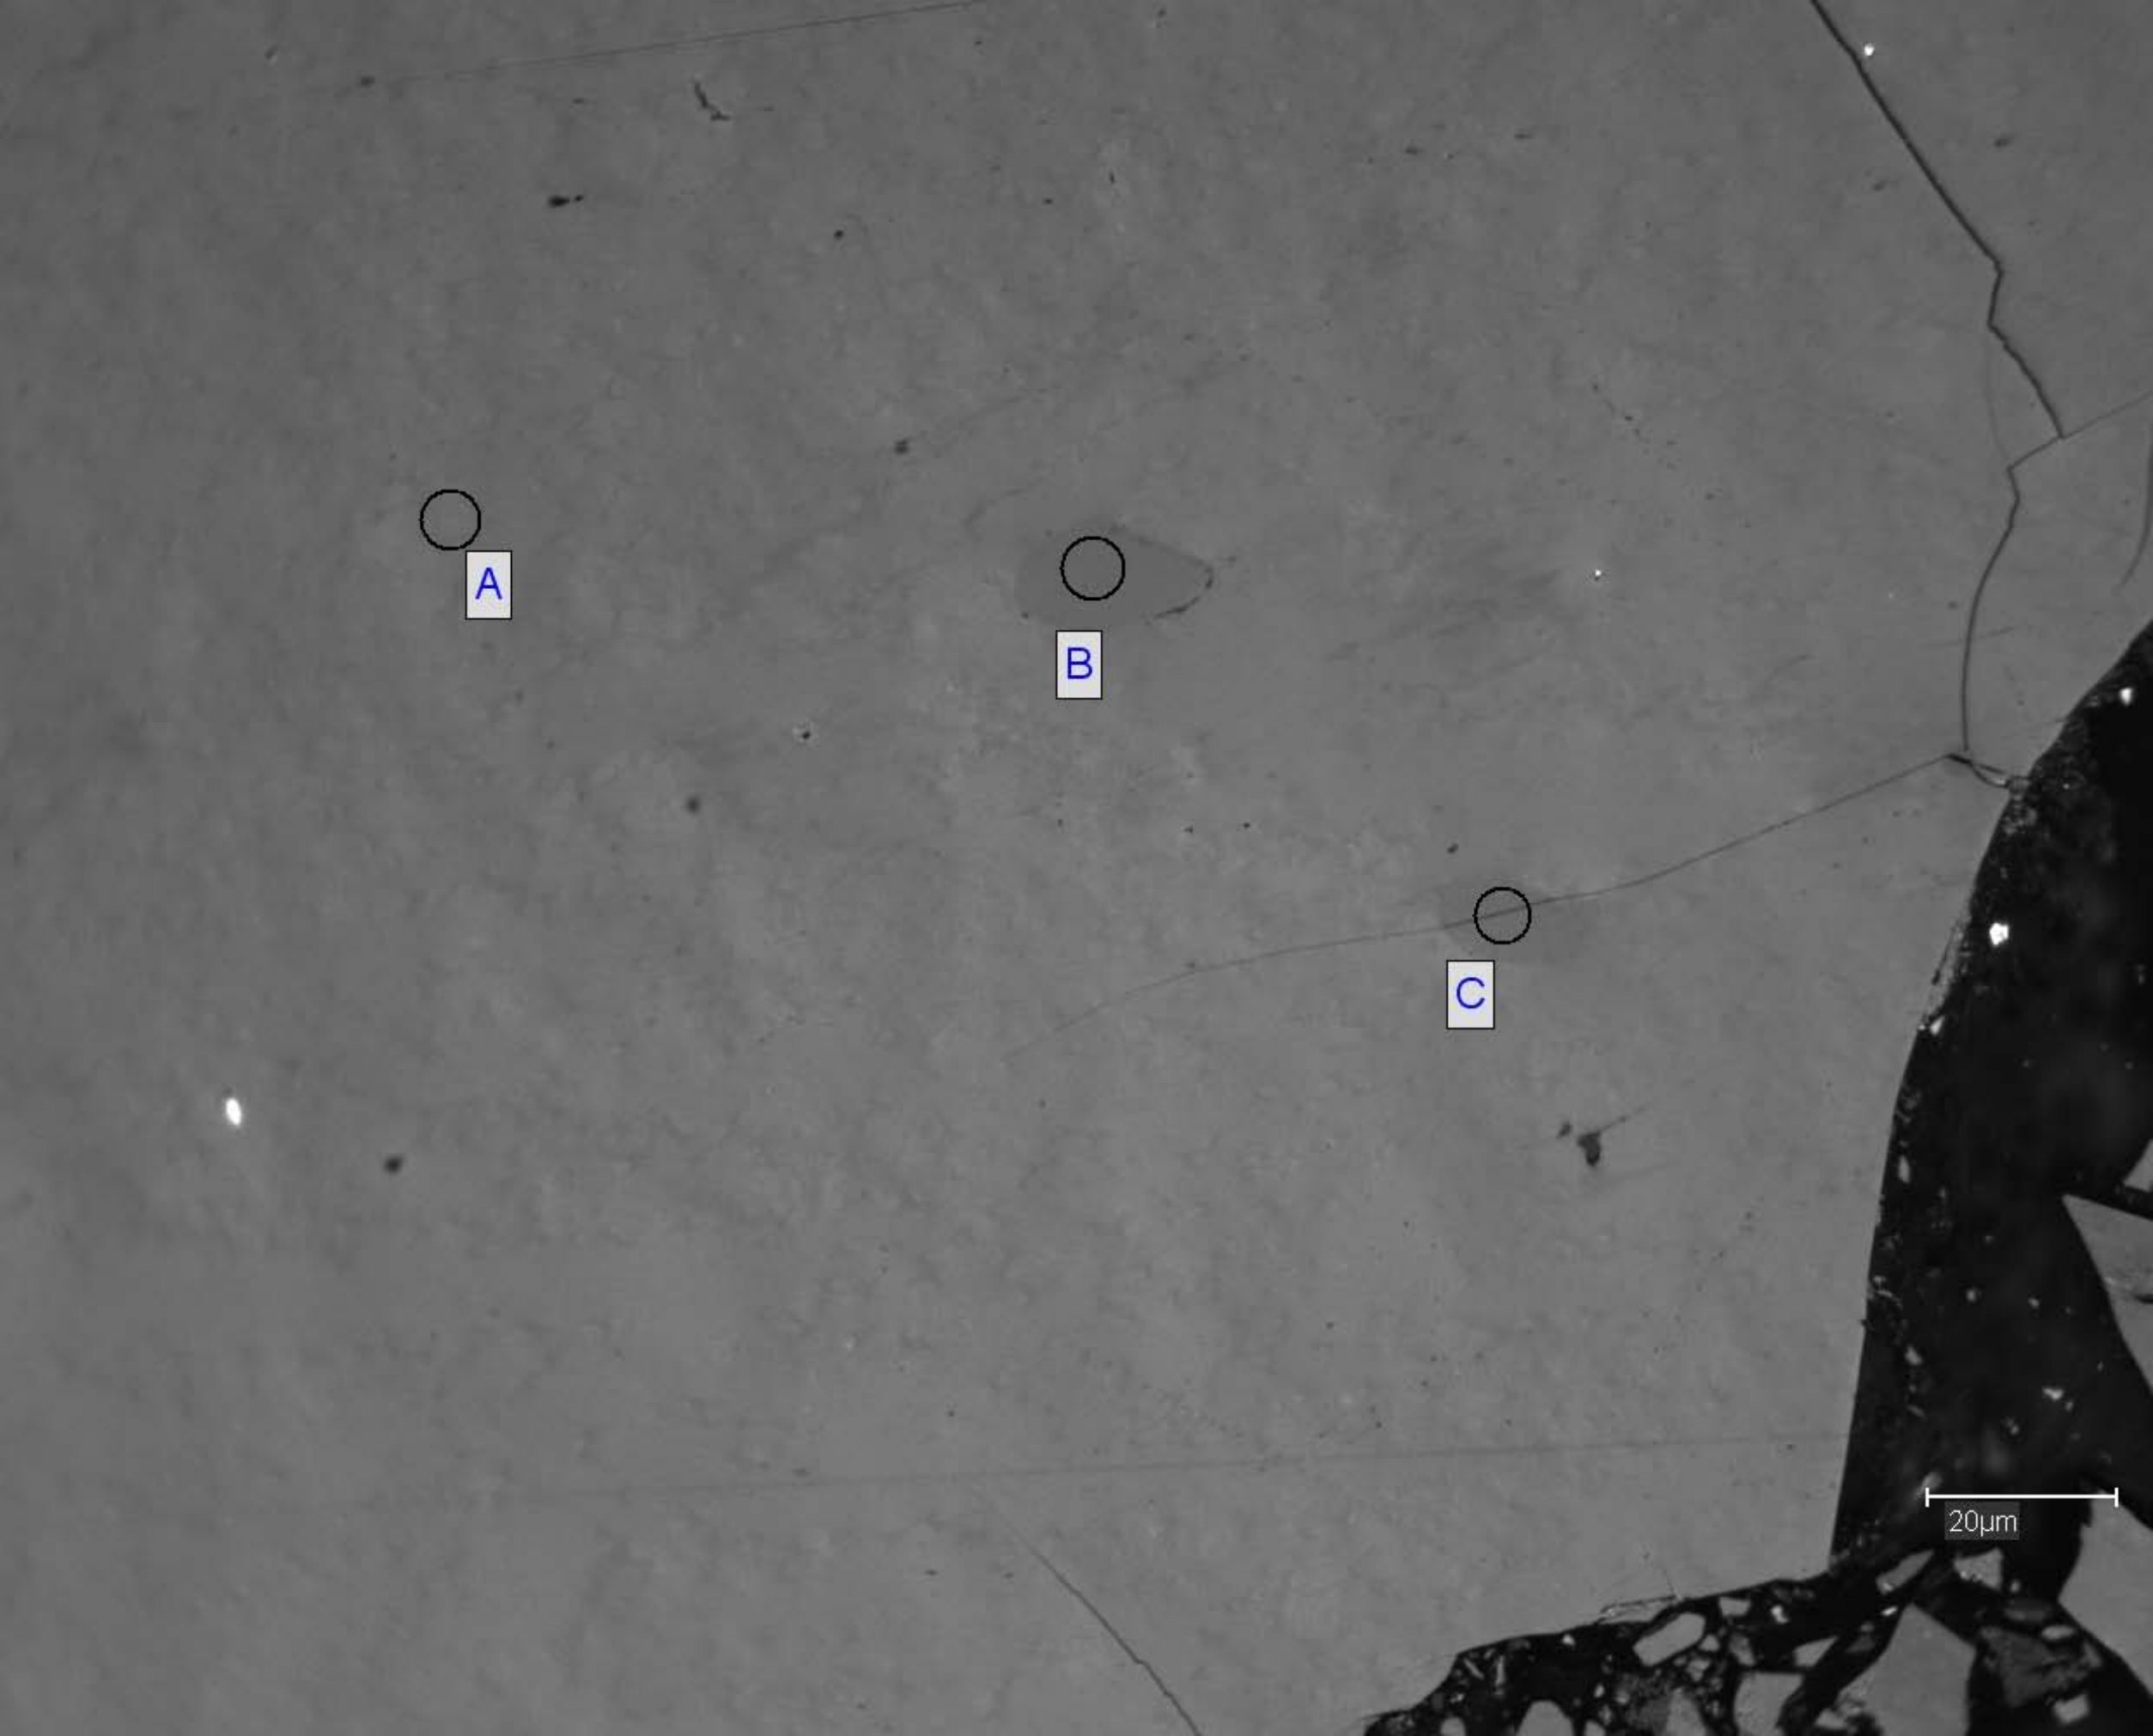

A



B



C

20µm

20μm



A



B

F




E

D



G

C

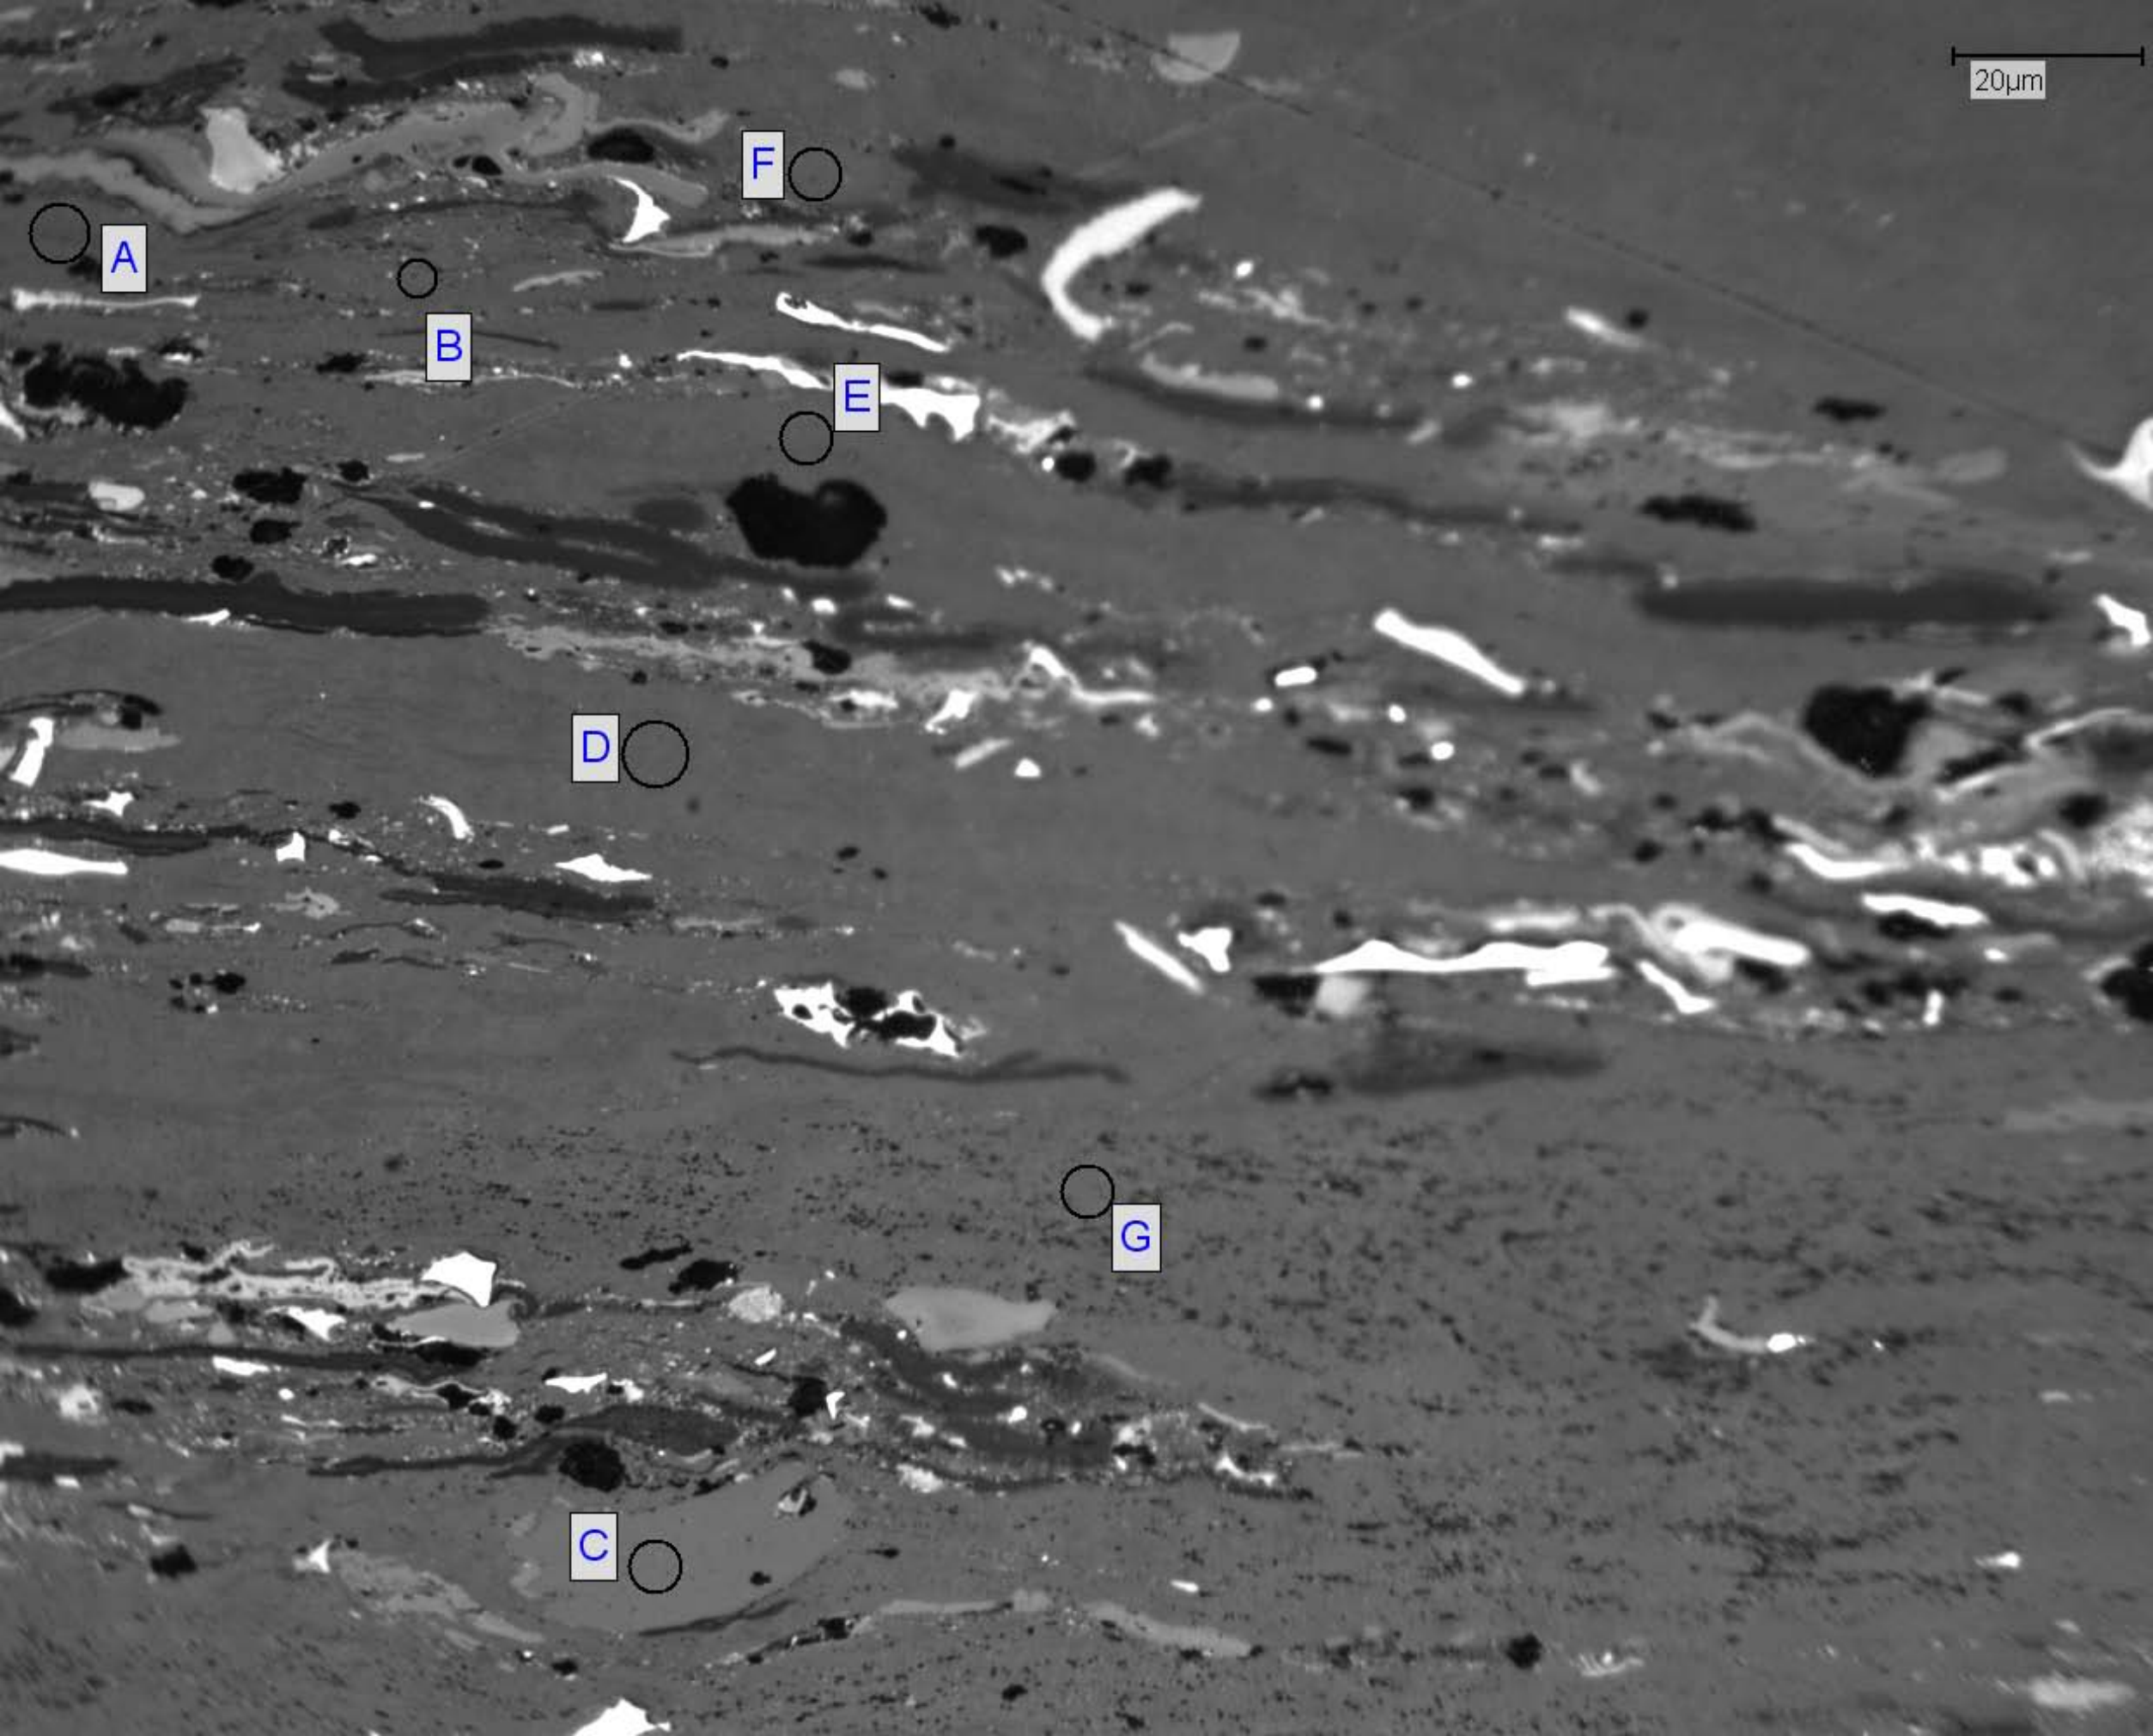

20μm

A



B




C



D



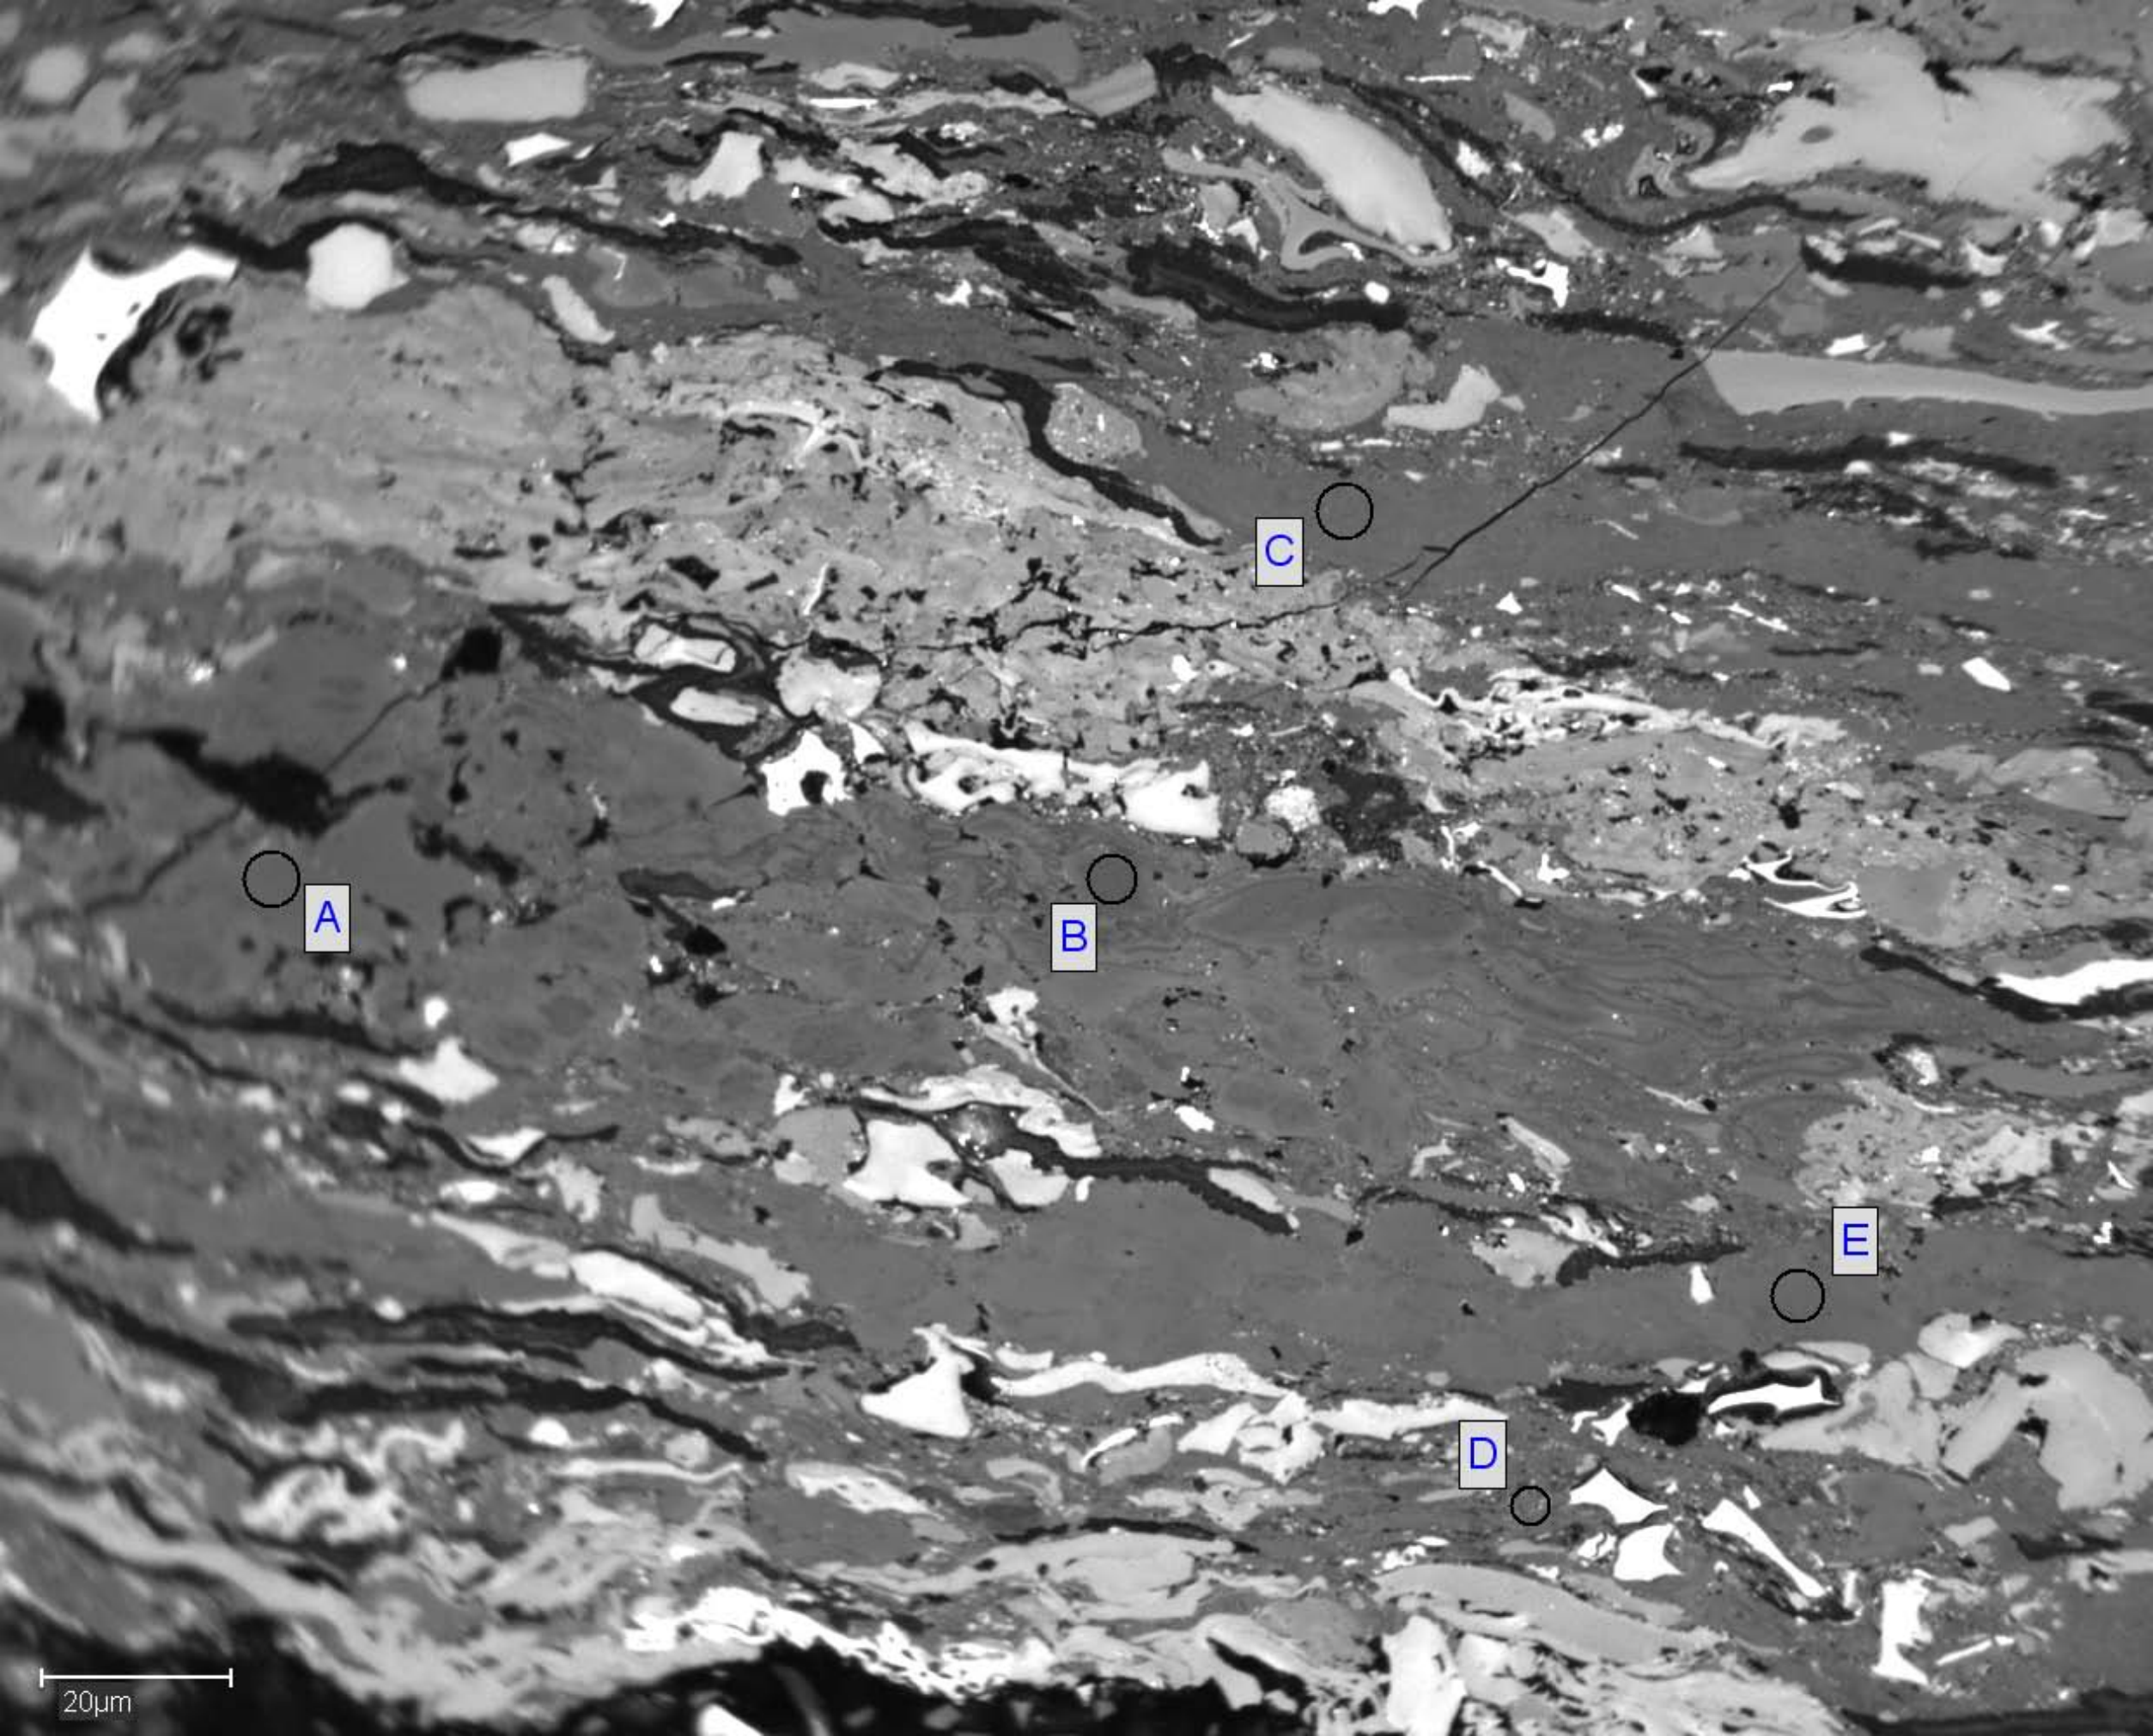

A


B

C

D

E

20µm

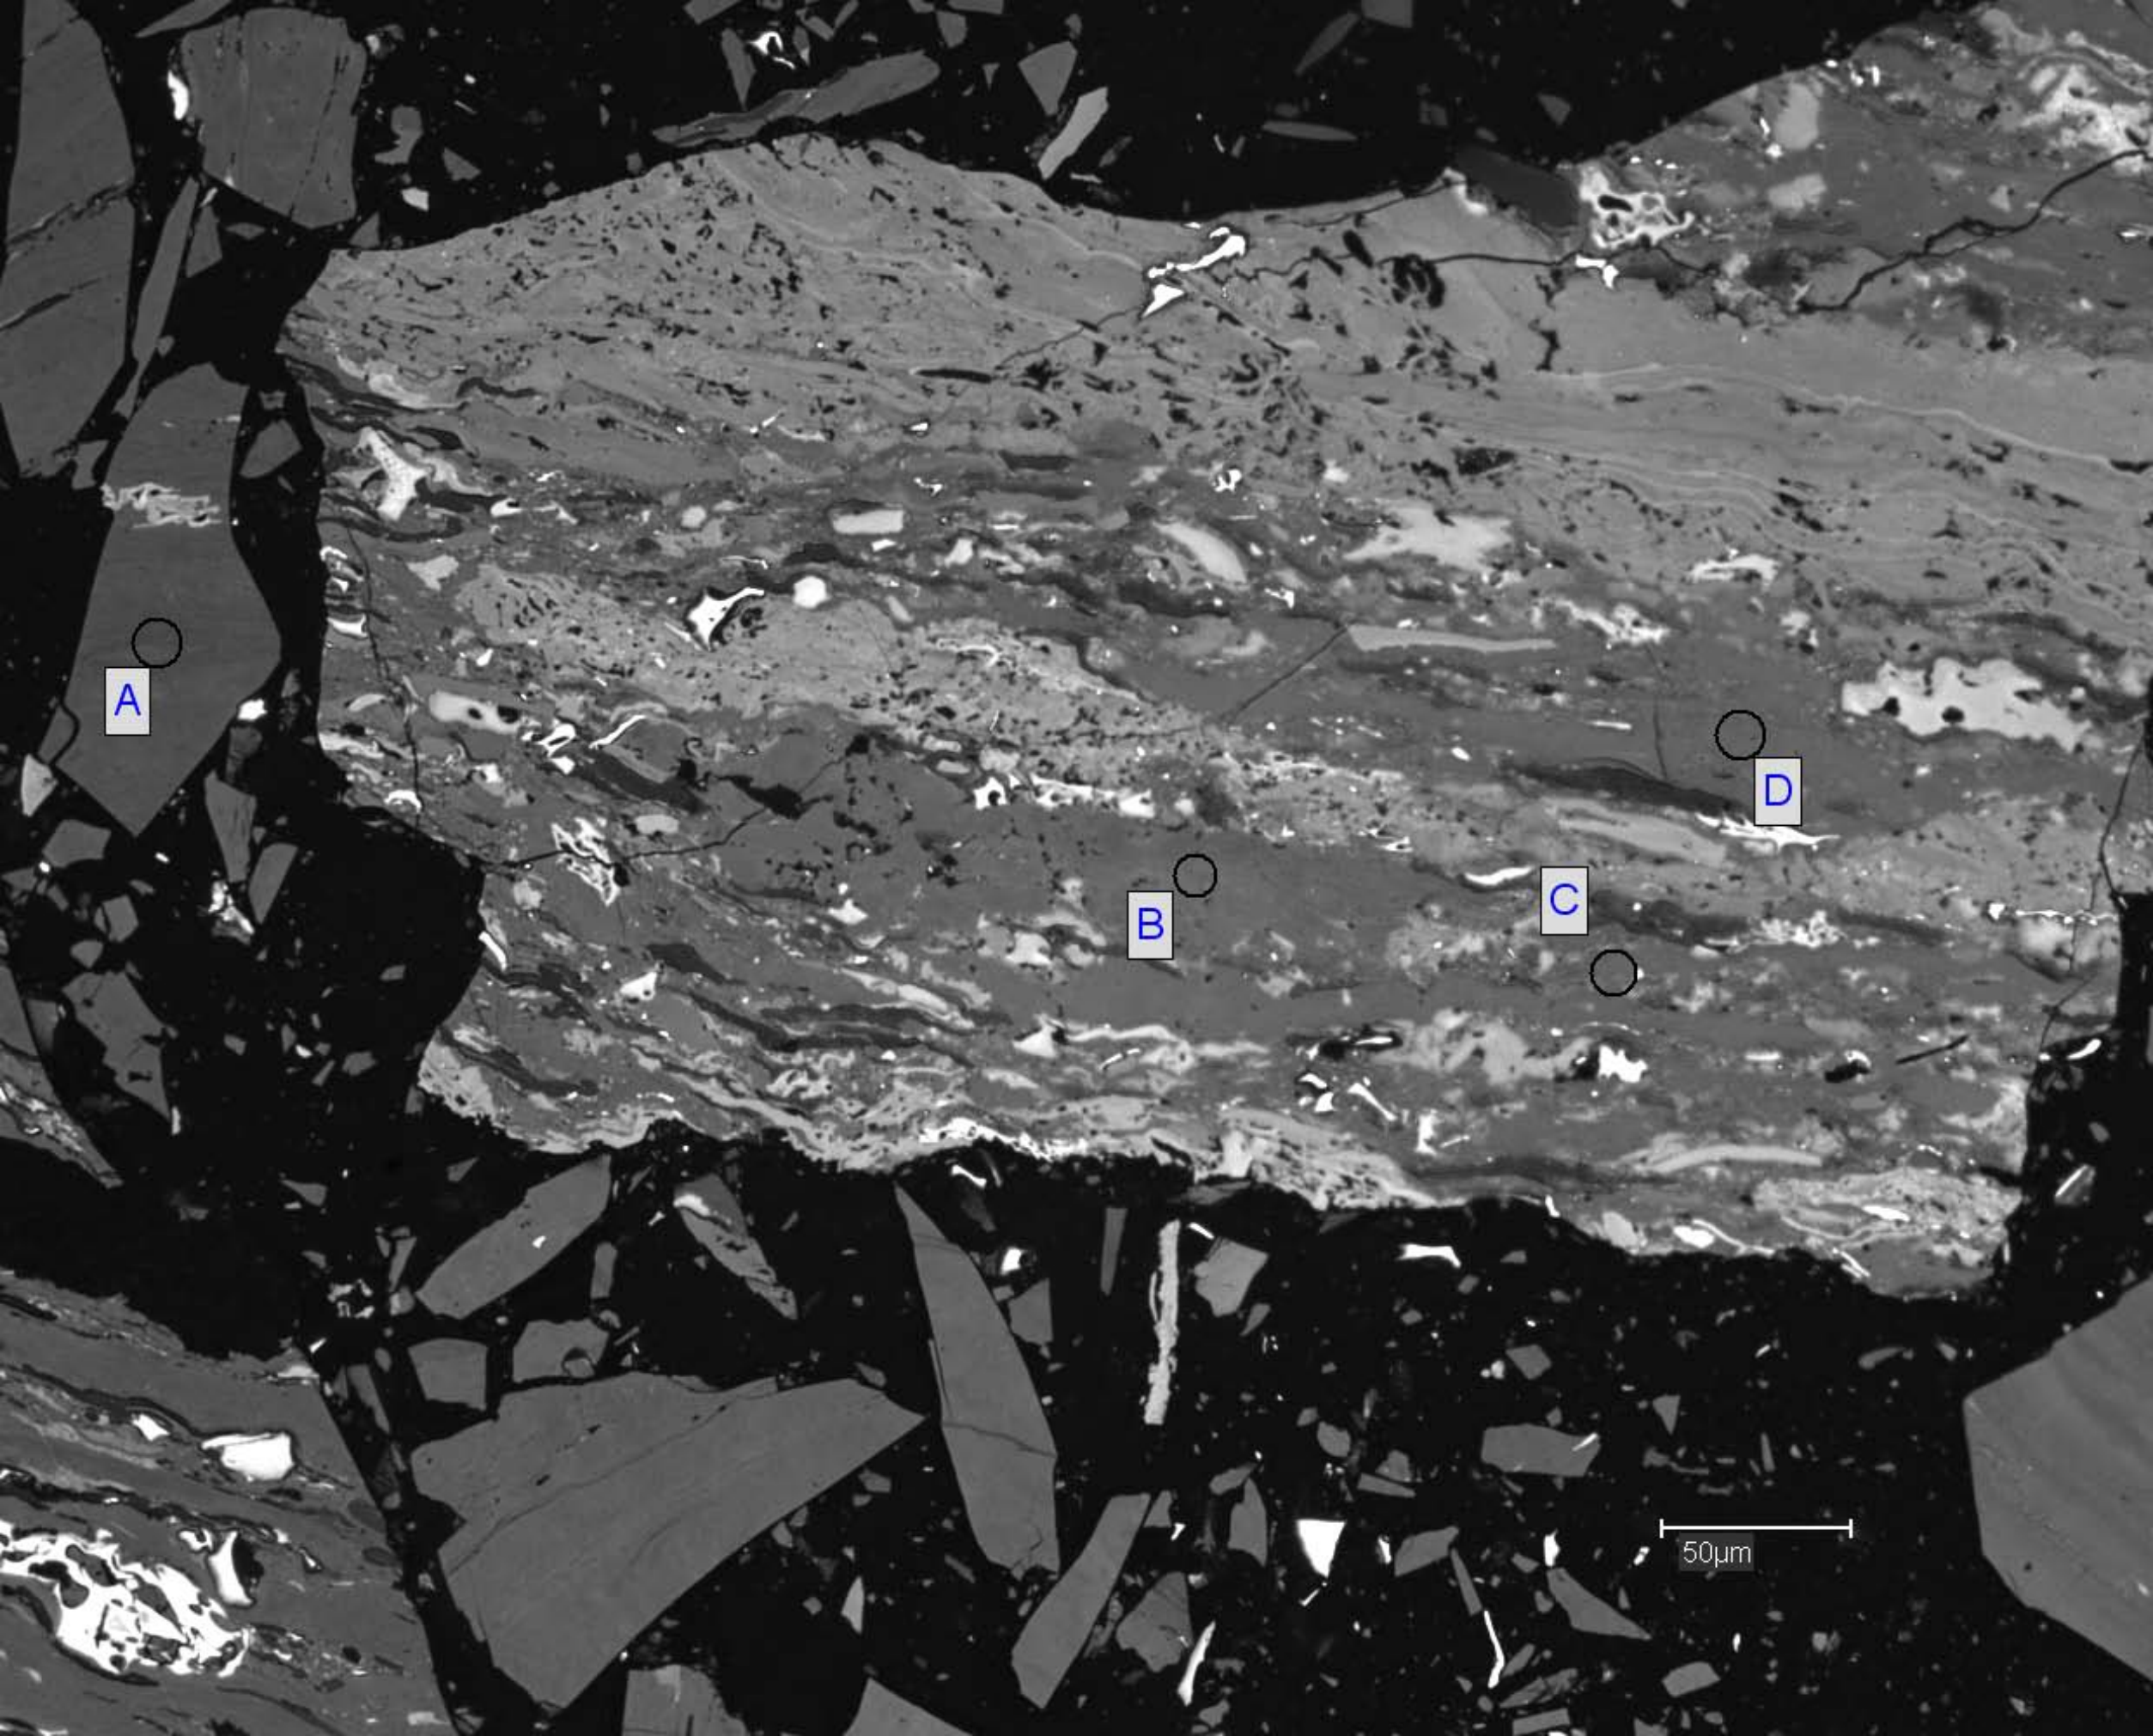


A

B

C

D

50µm

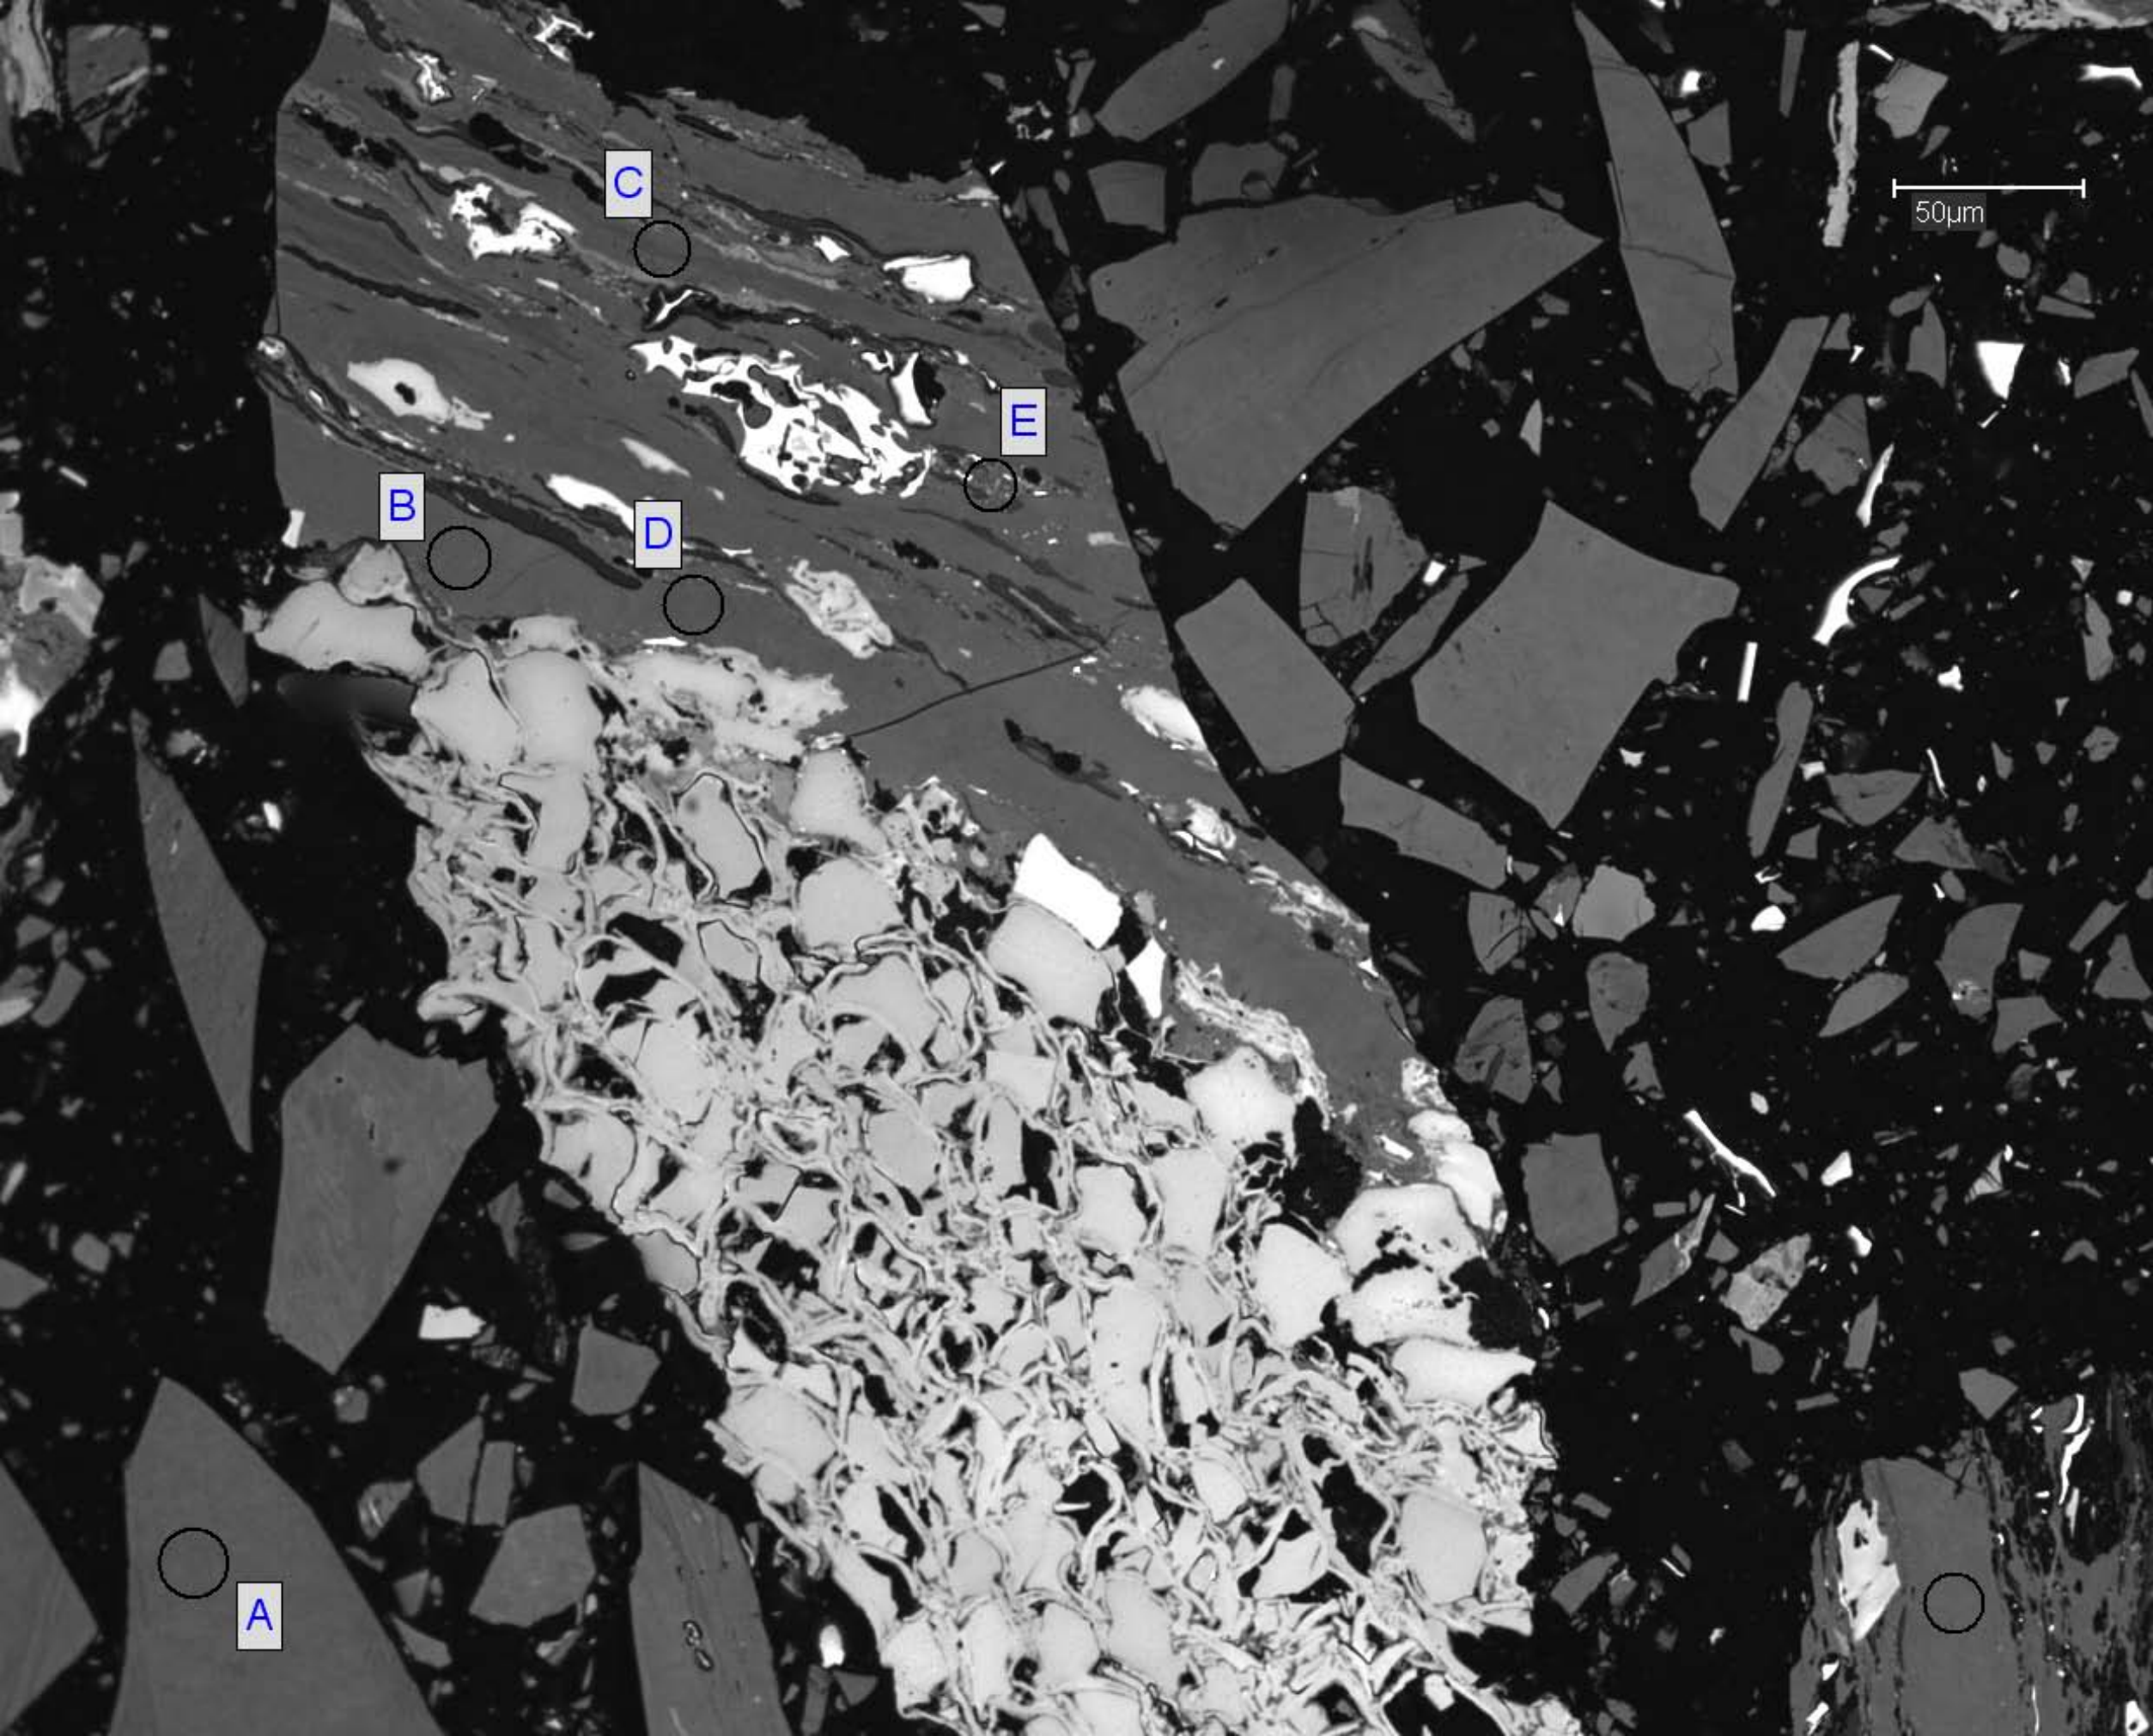

50µm


C

E

B

D

A

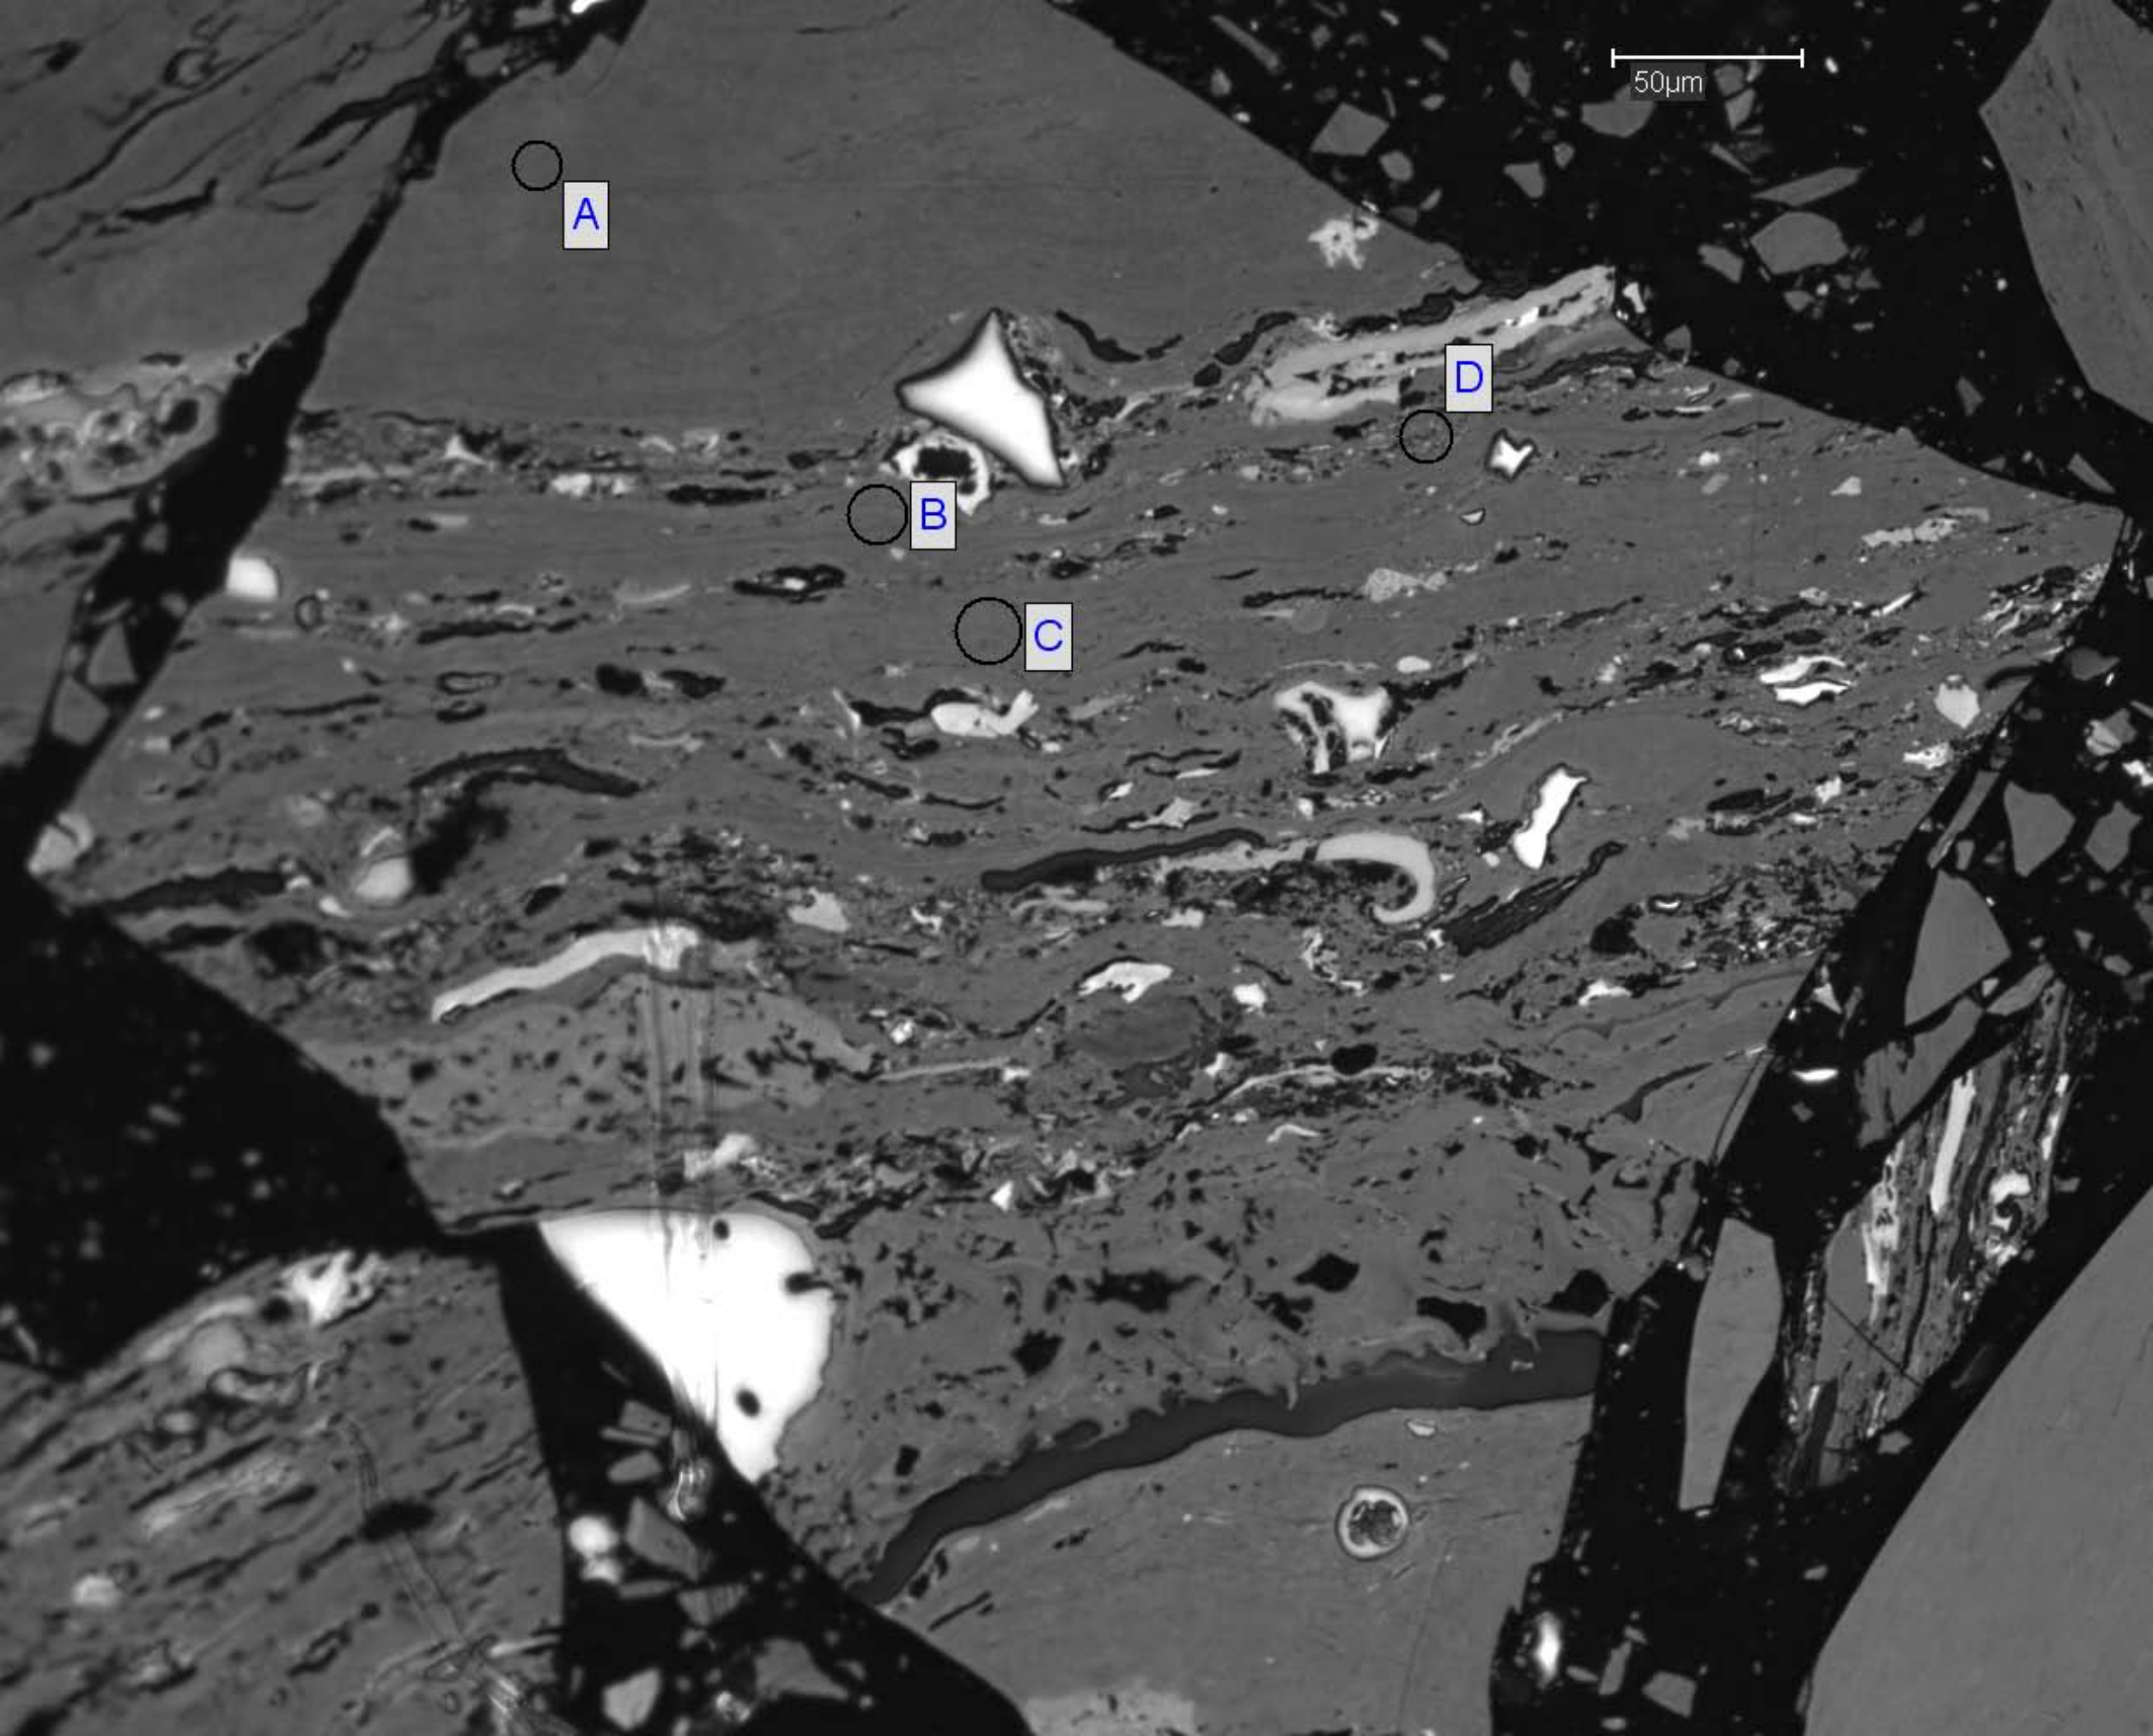

50µm



A




B



C



D

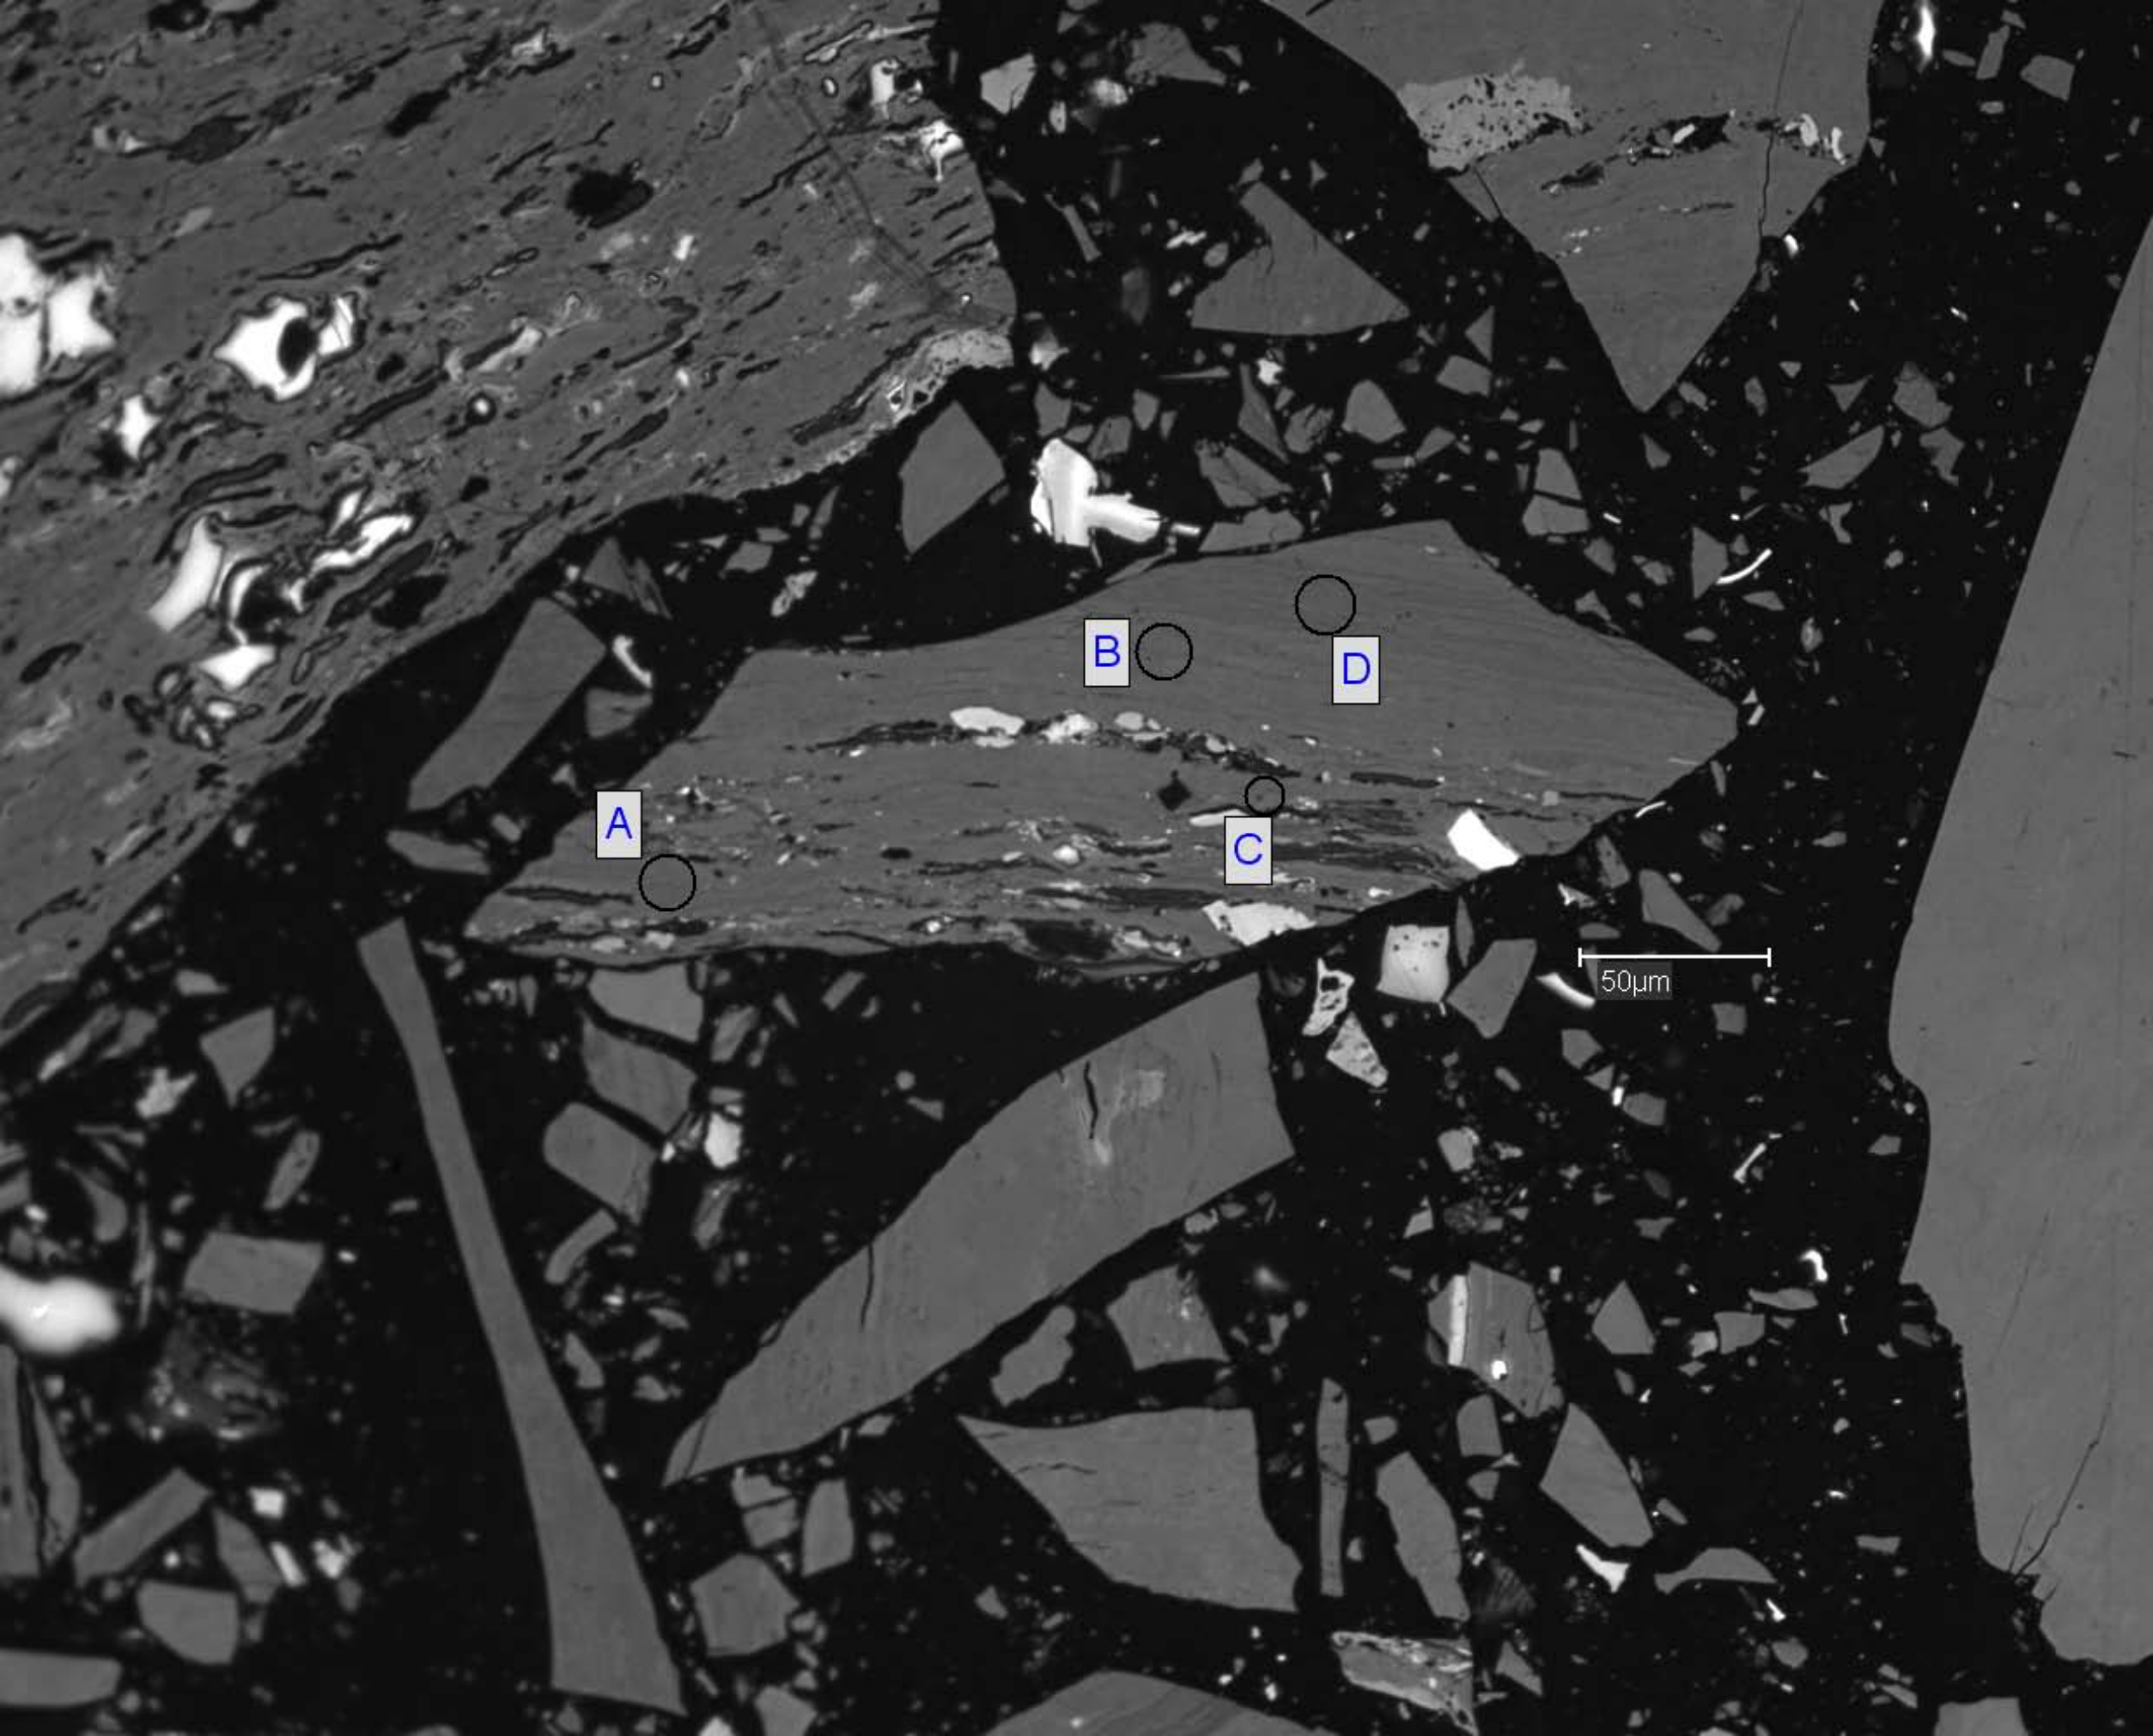


A

B

C

D

50µm

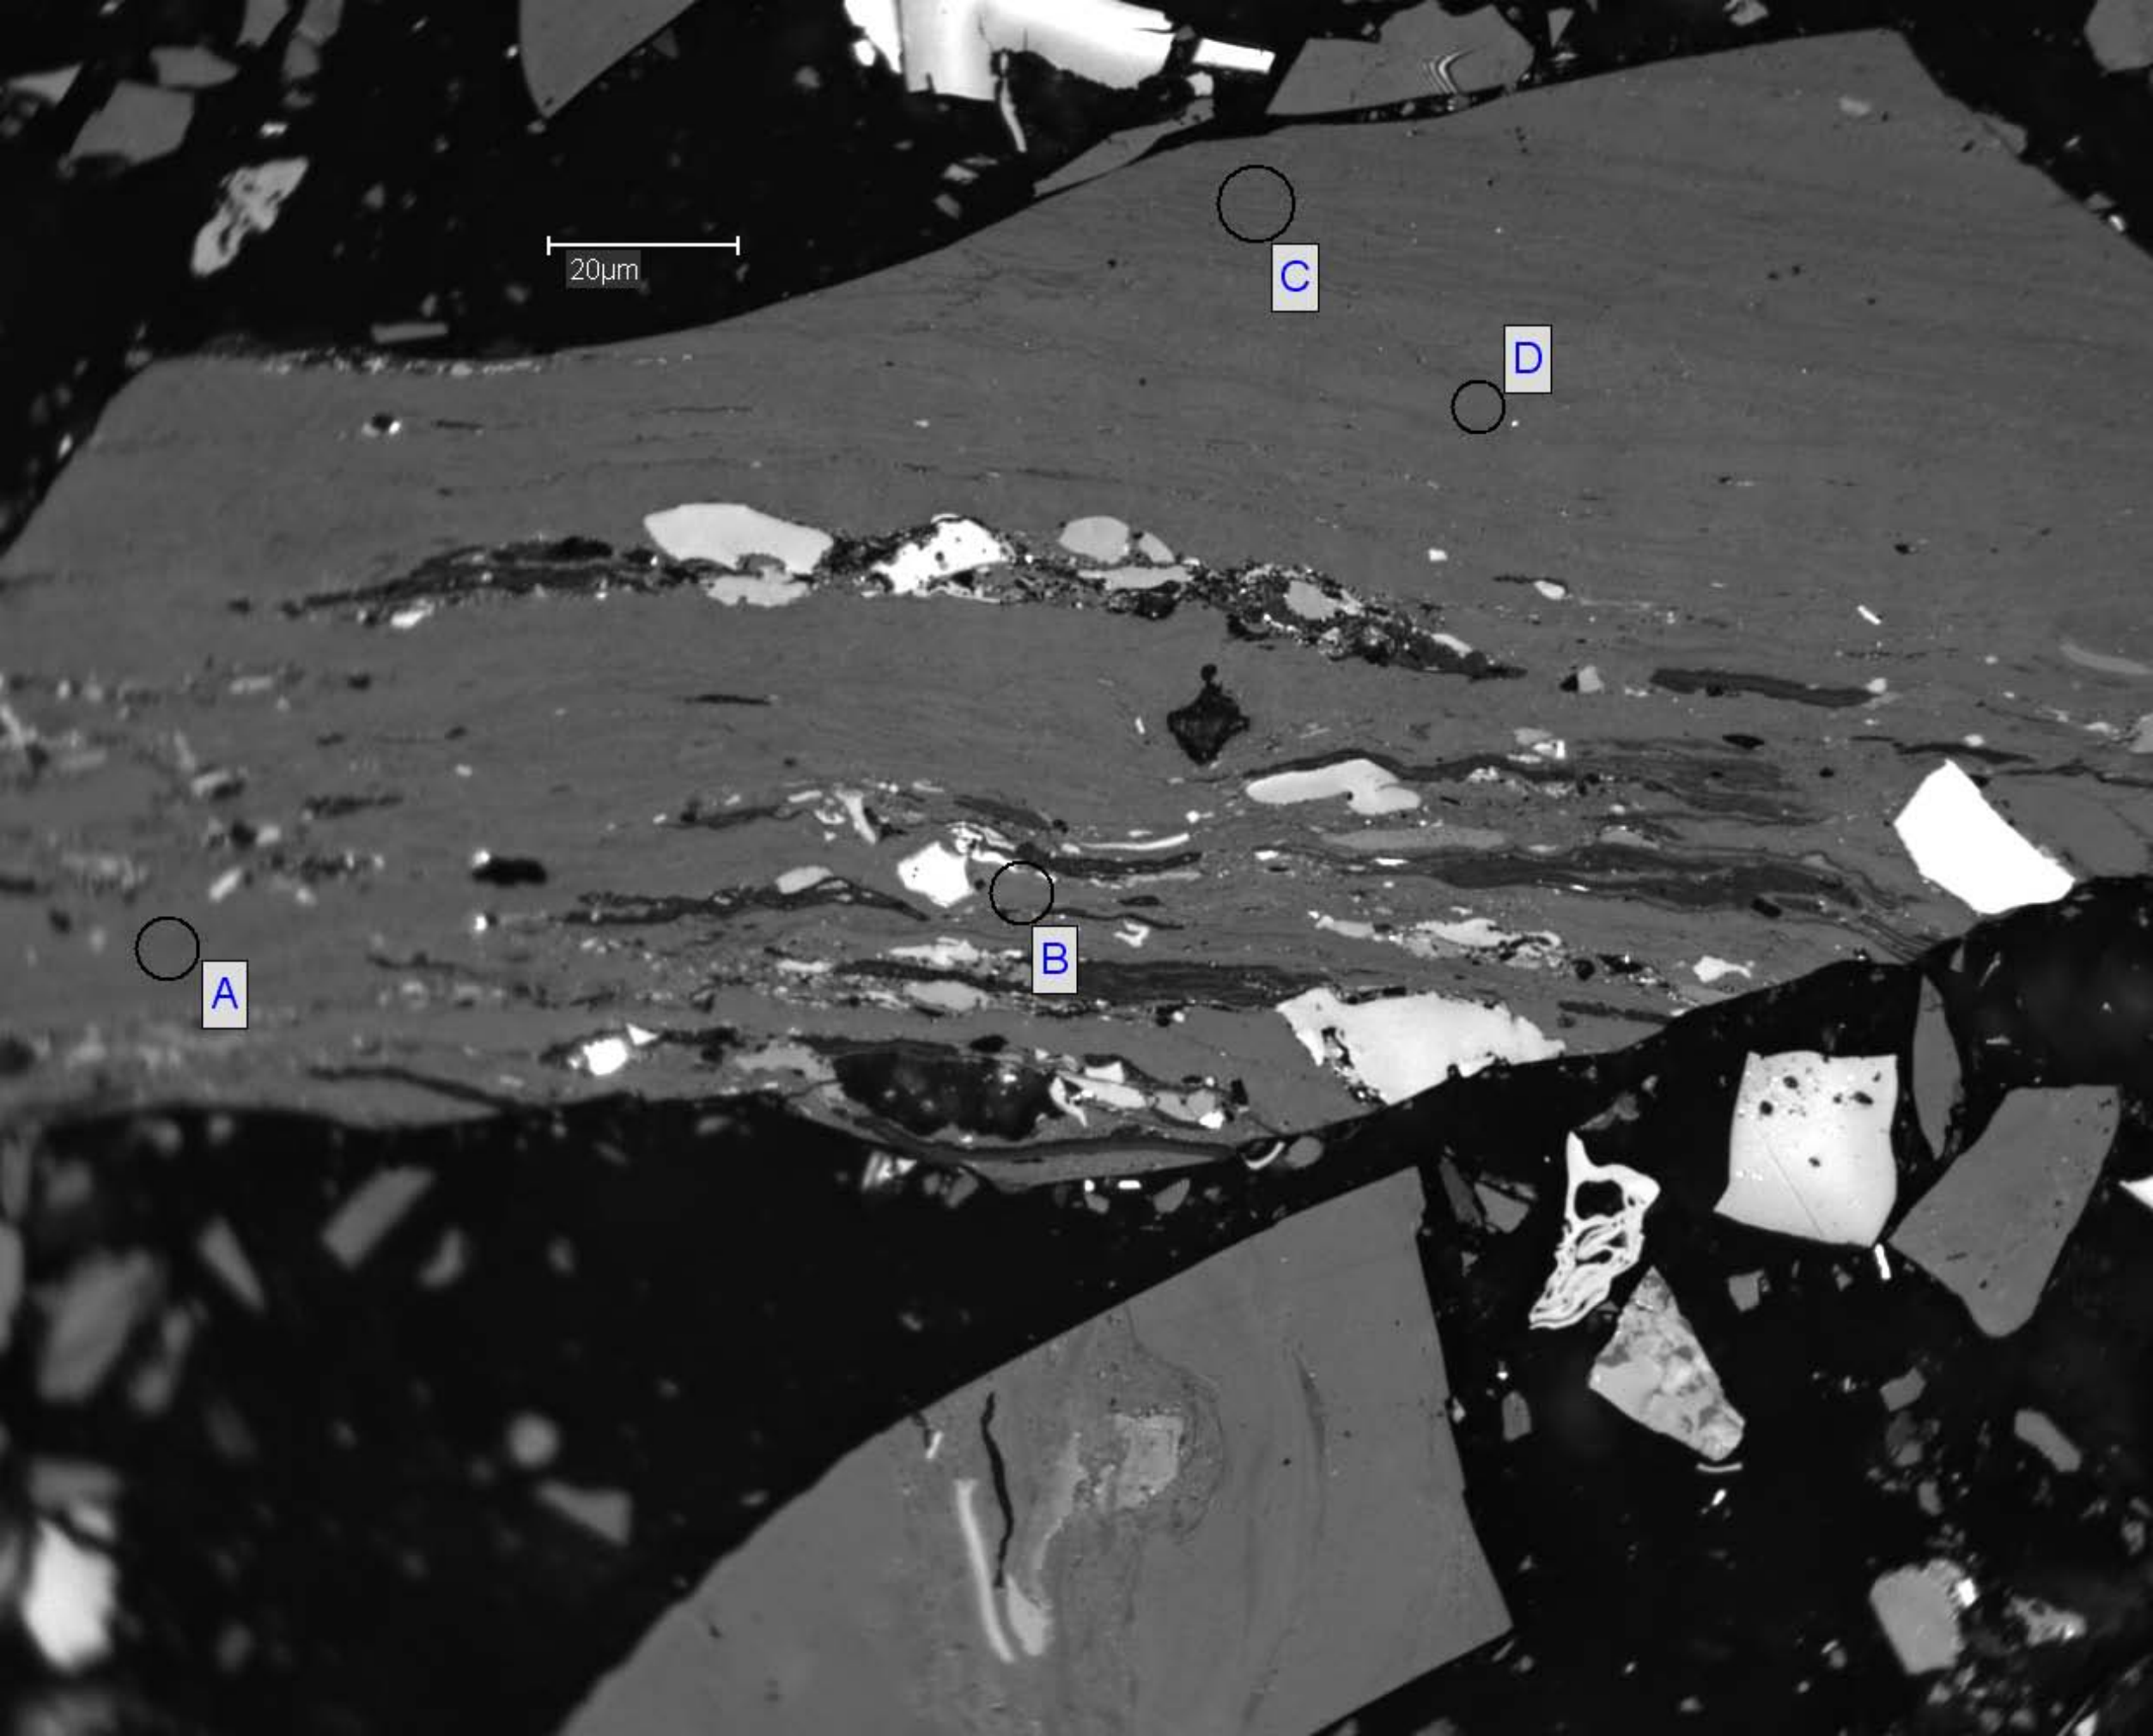


20µm

C

D

B

A

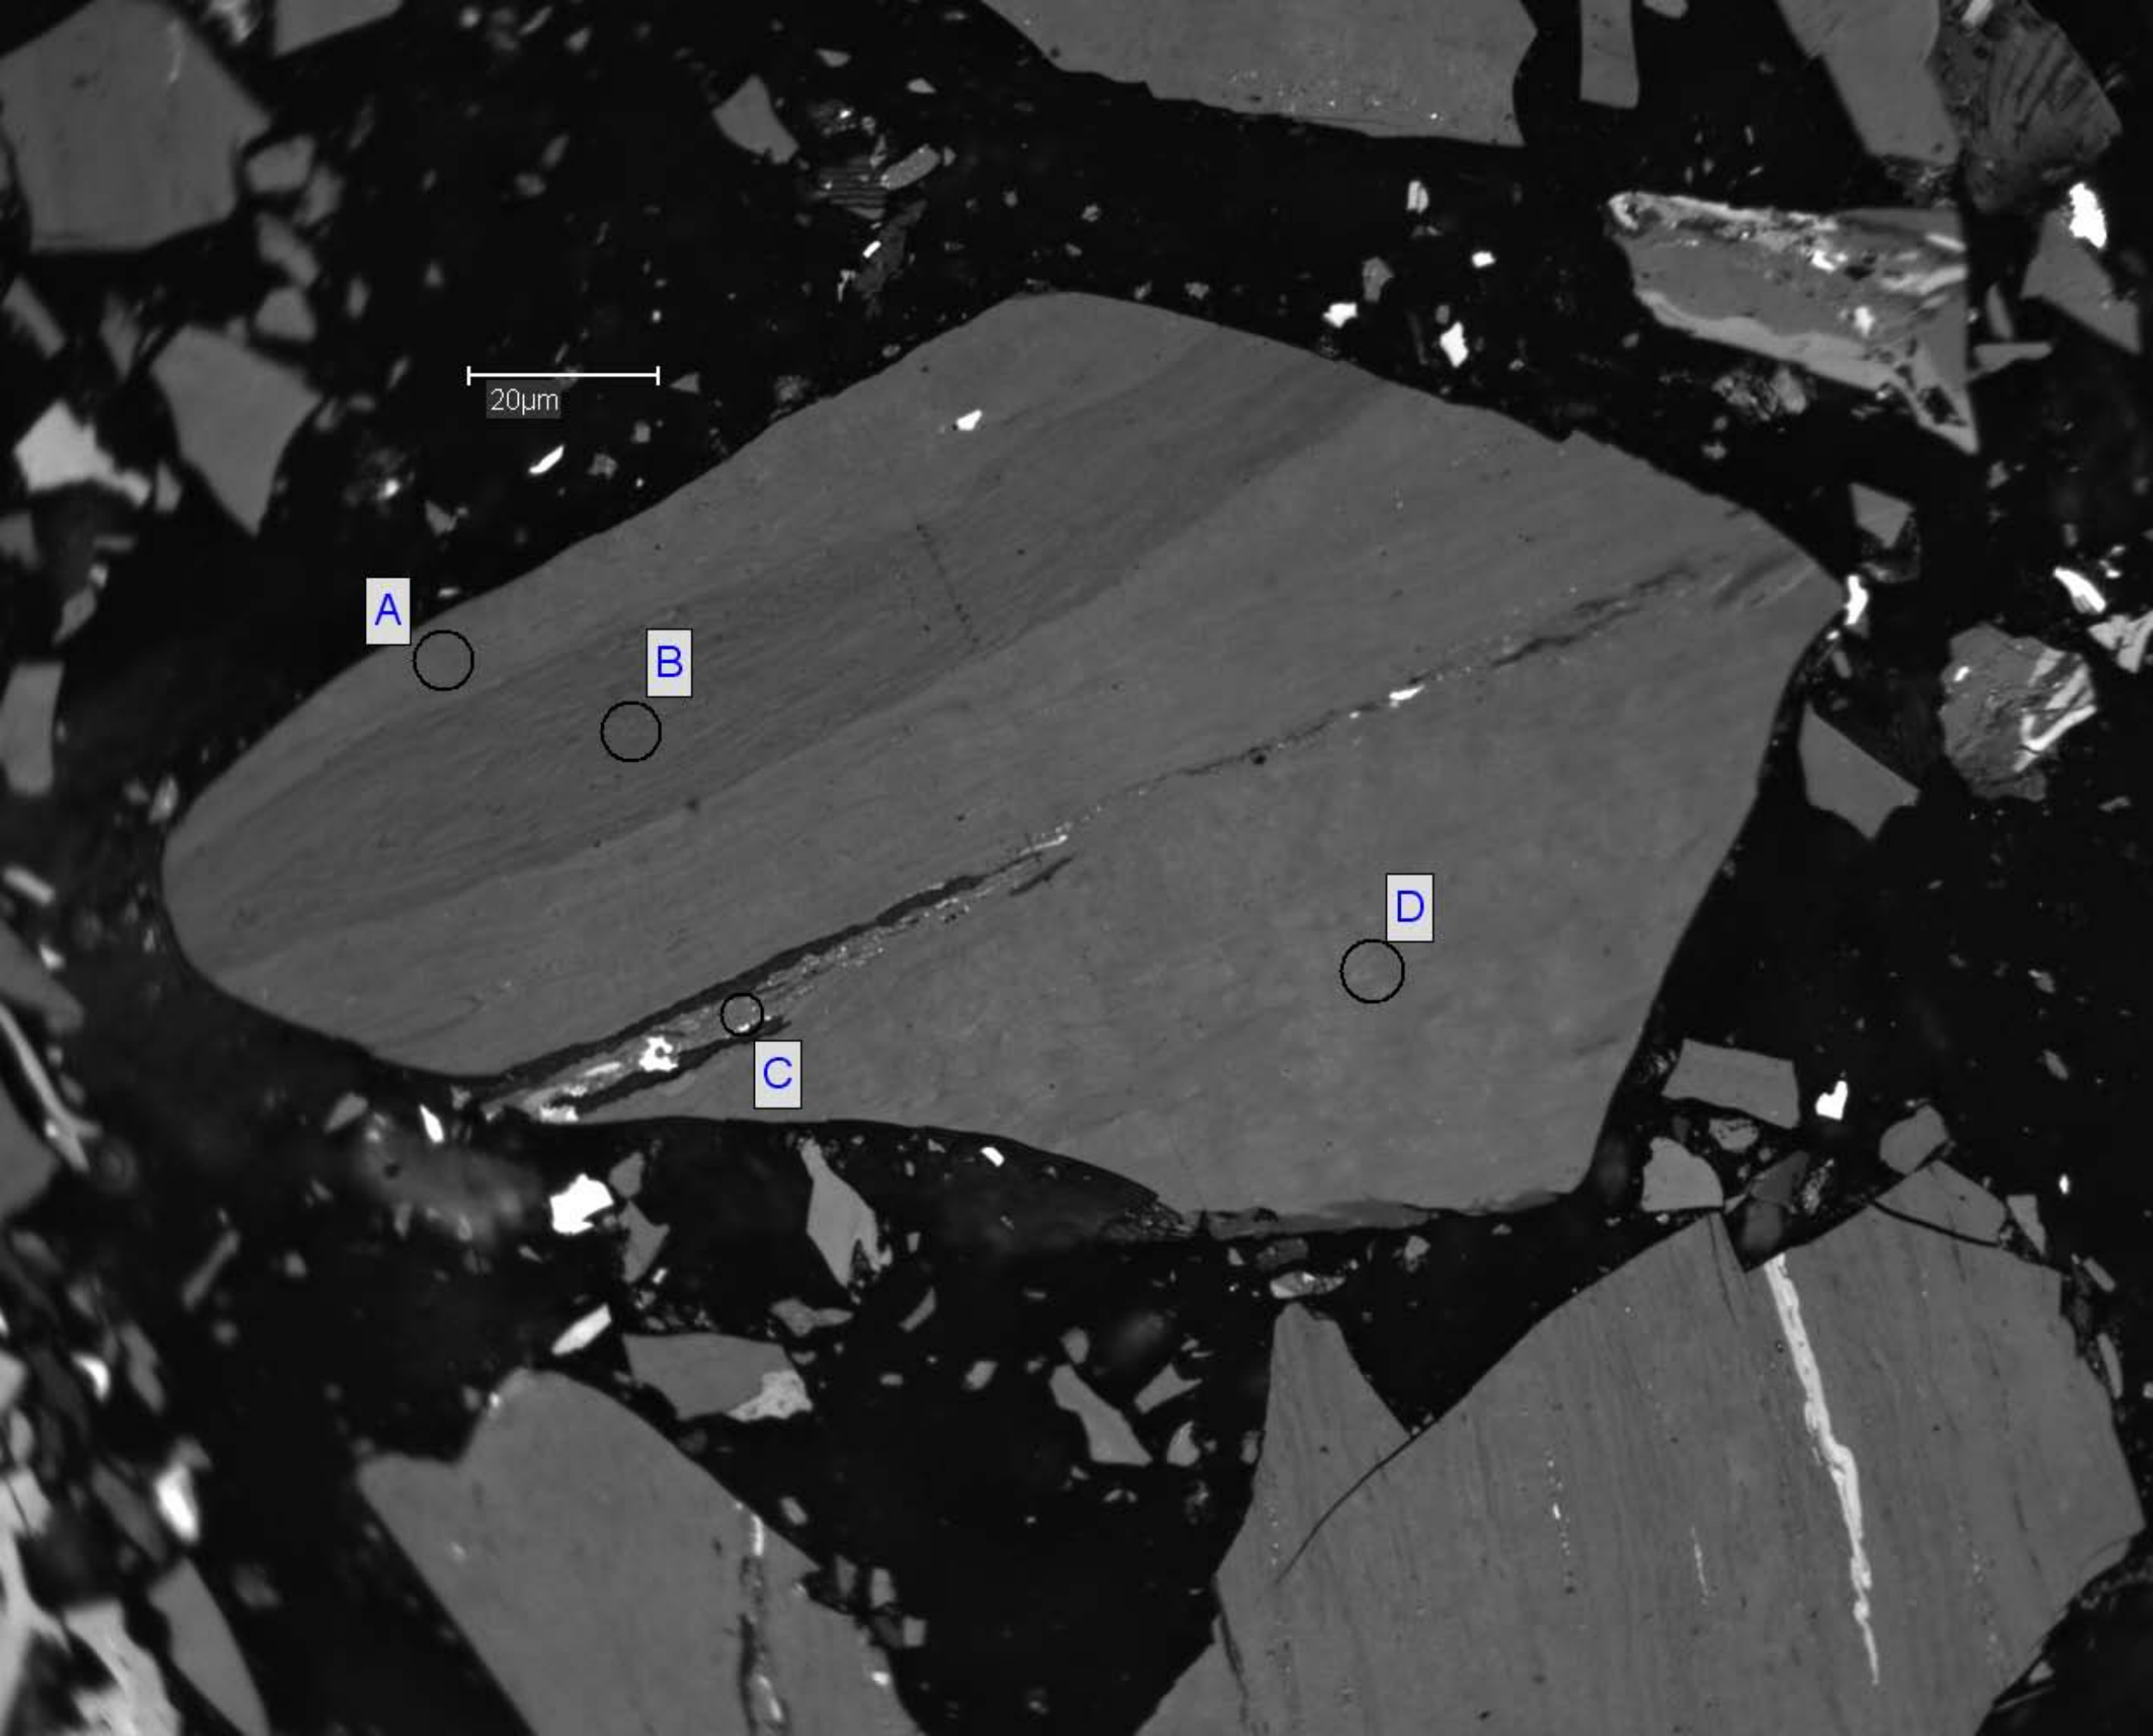


20µm

A

B

C

D

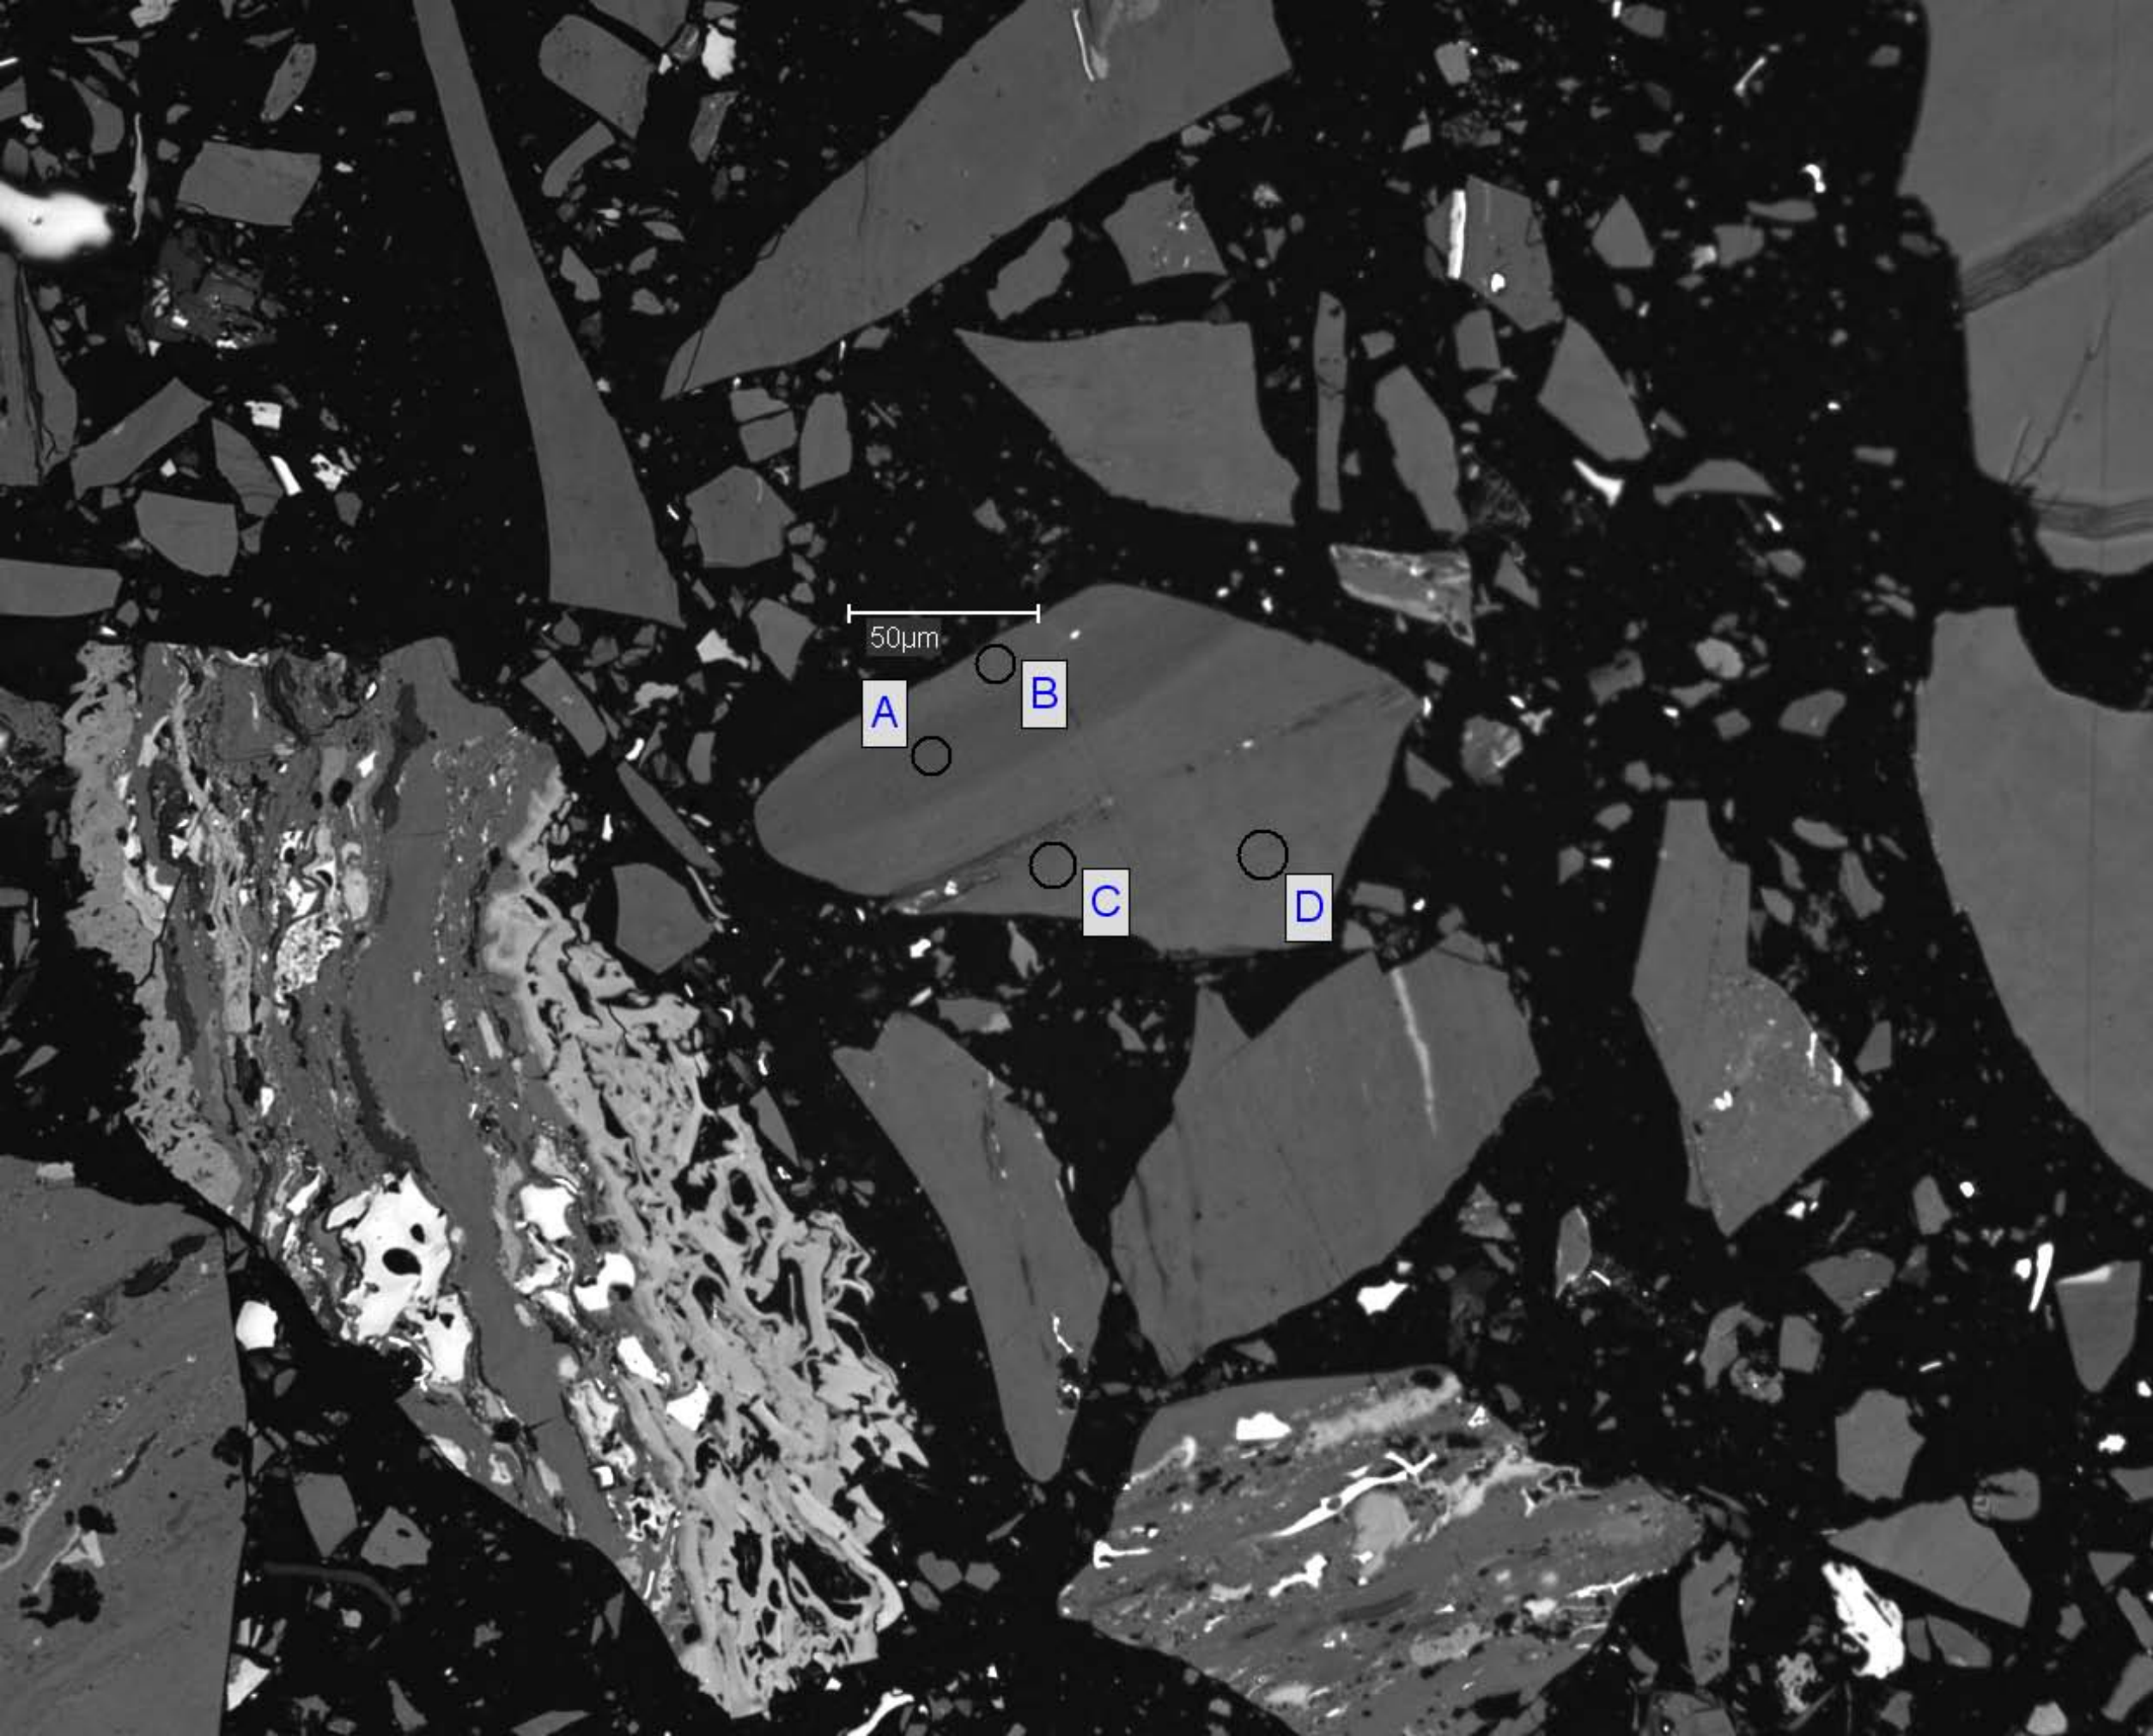


50µm

A

B

C

D

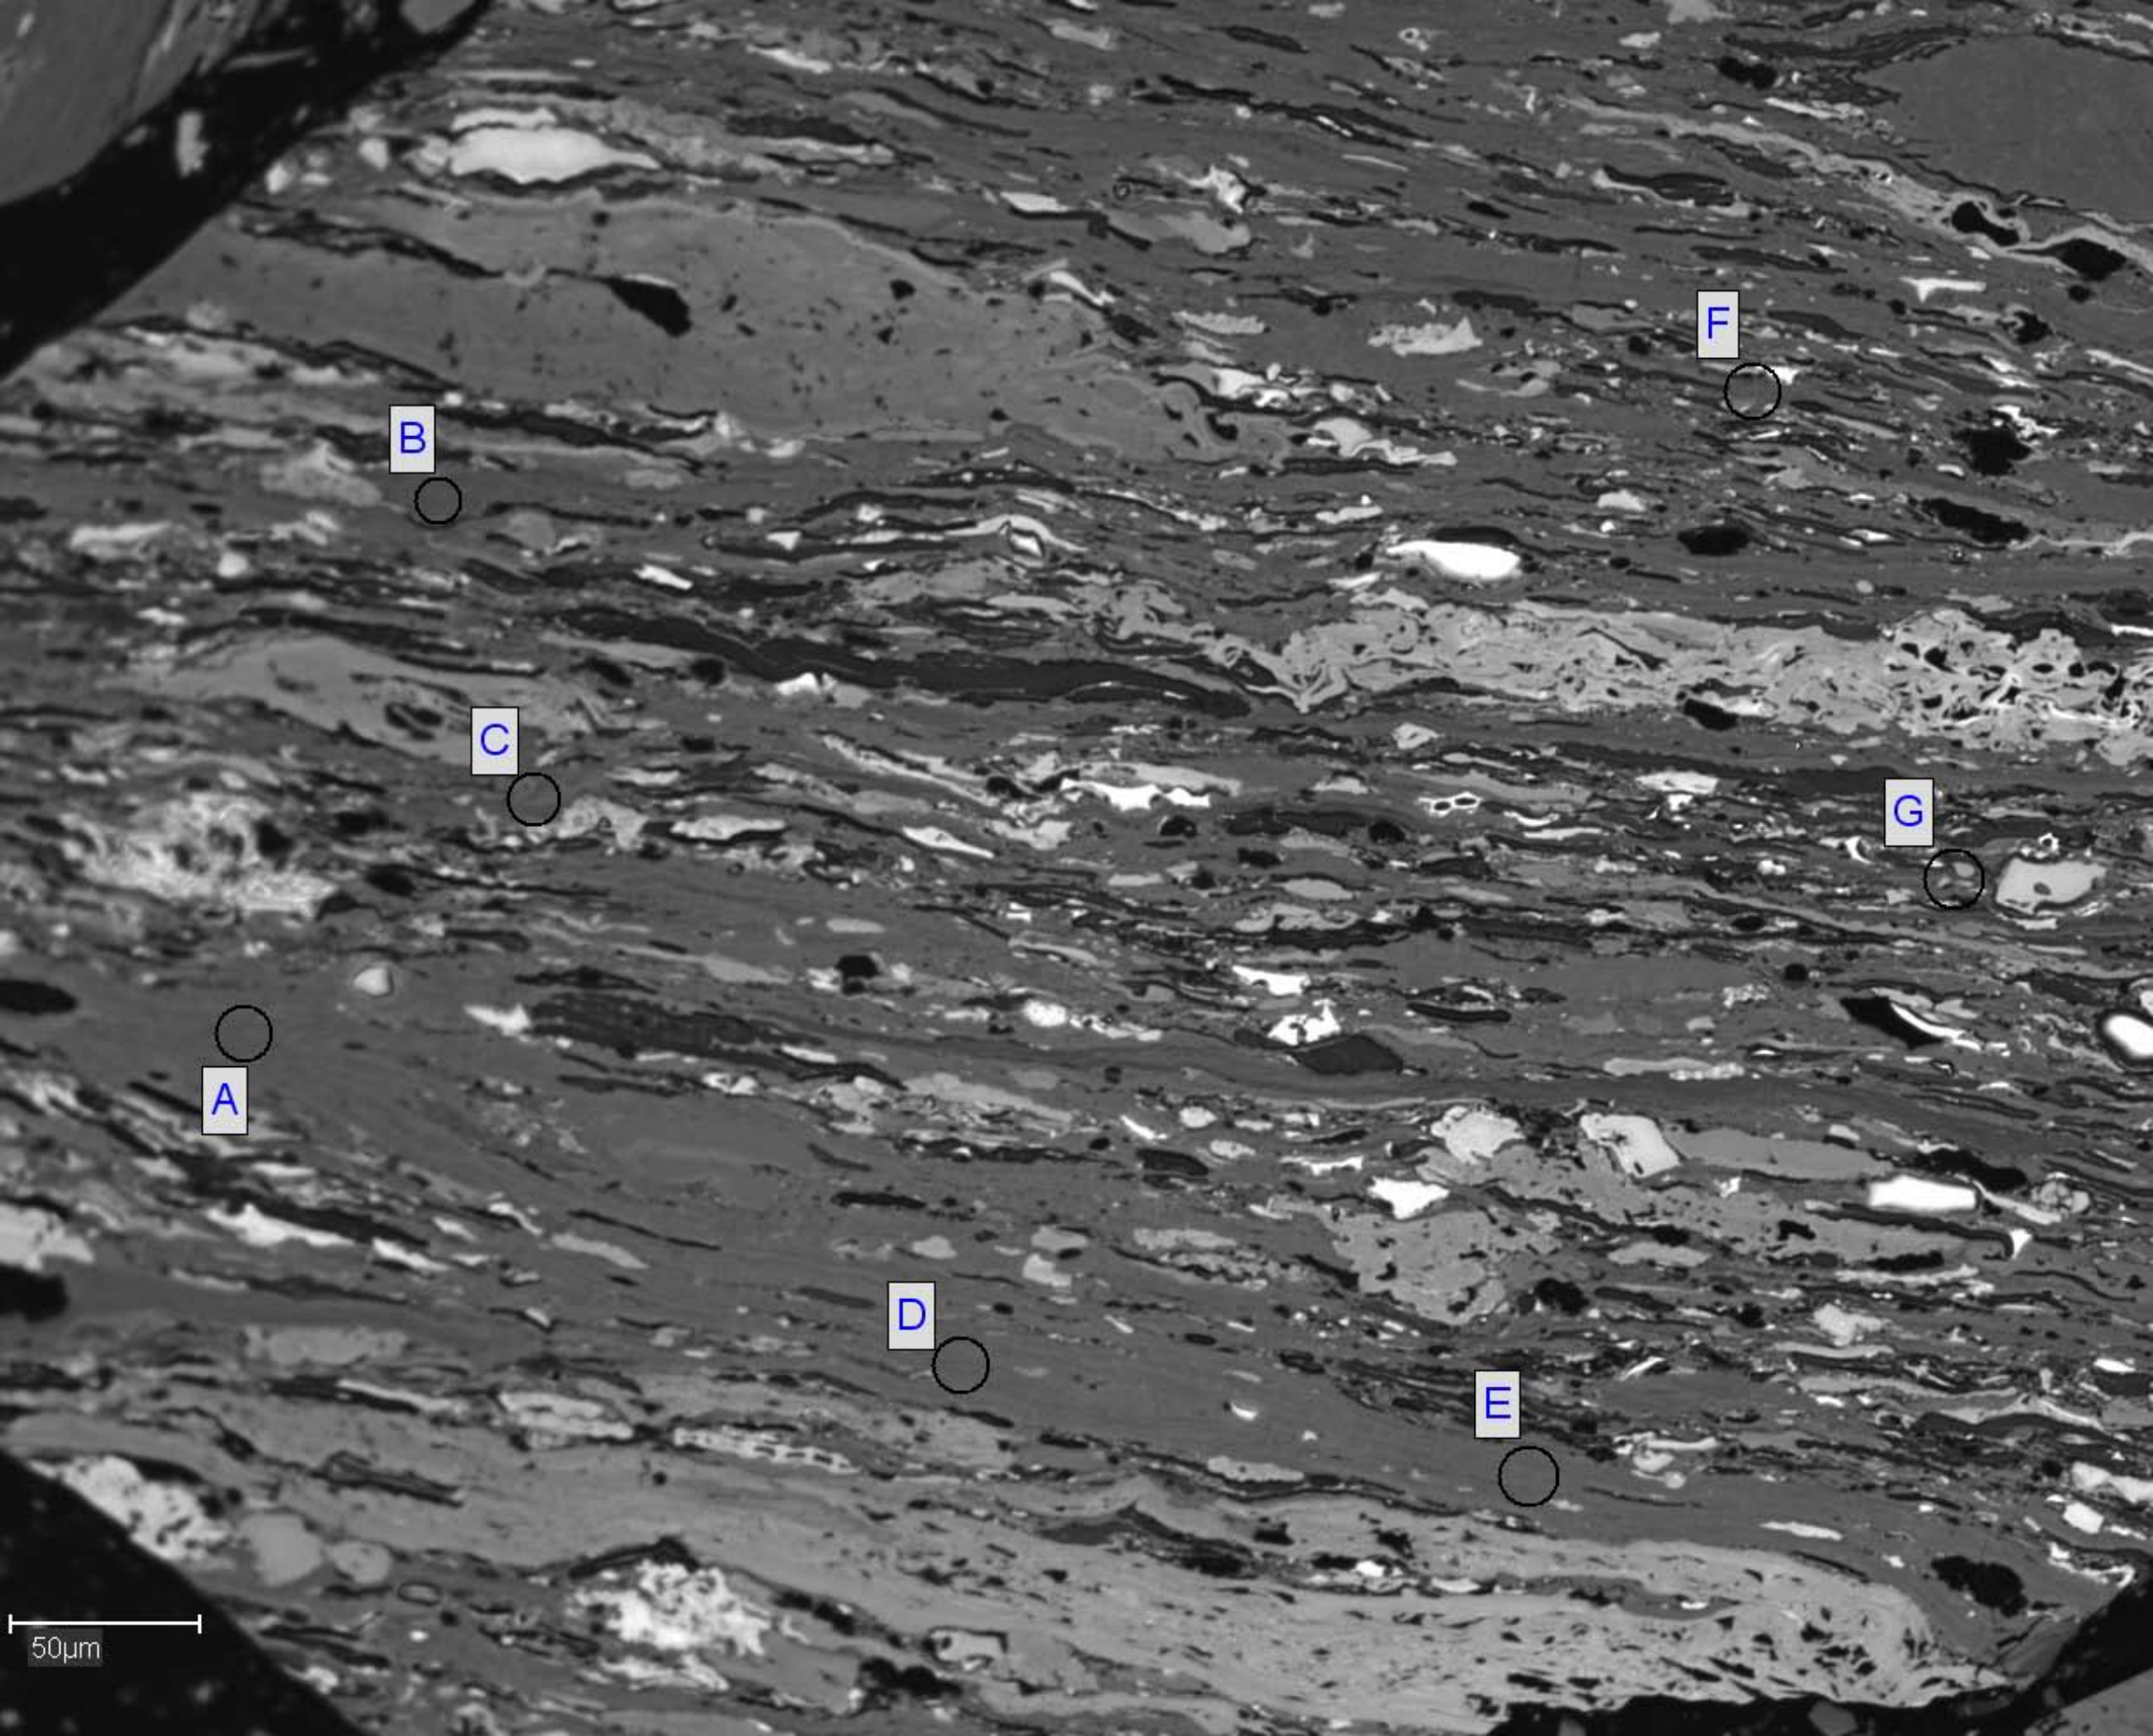

A

B

C


D

E

F

G

50µm

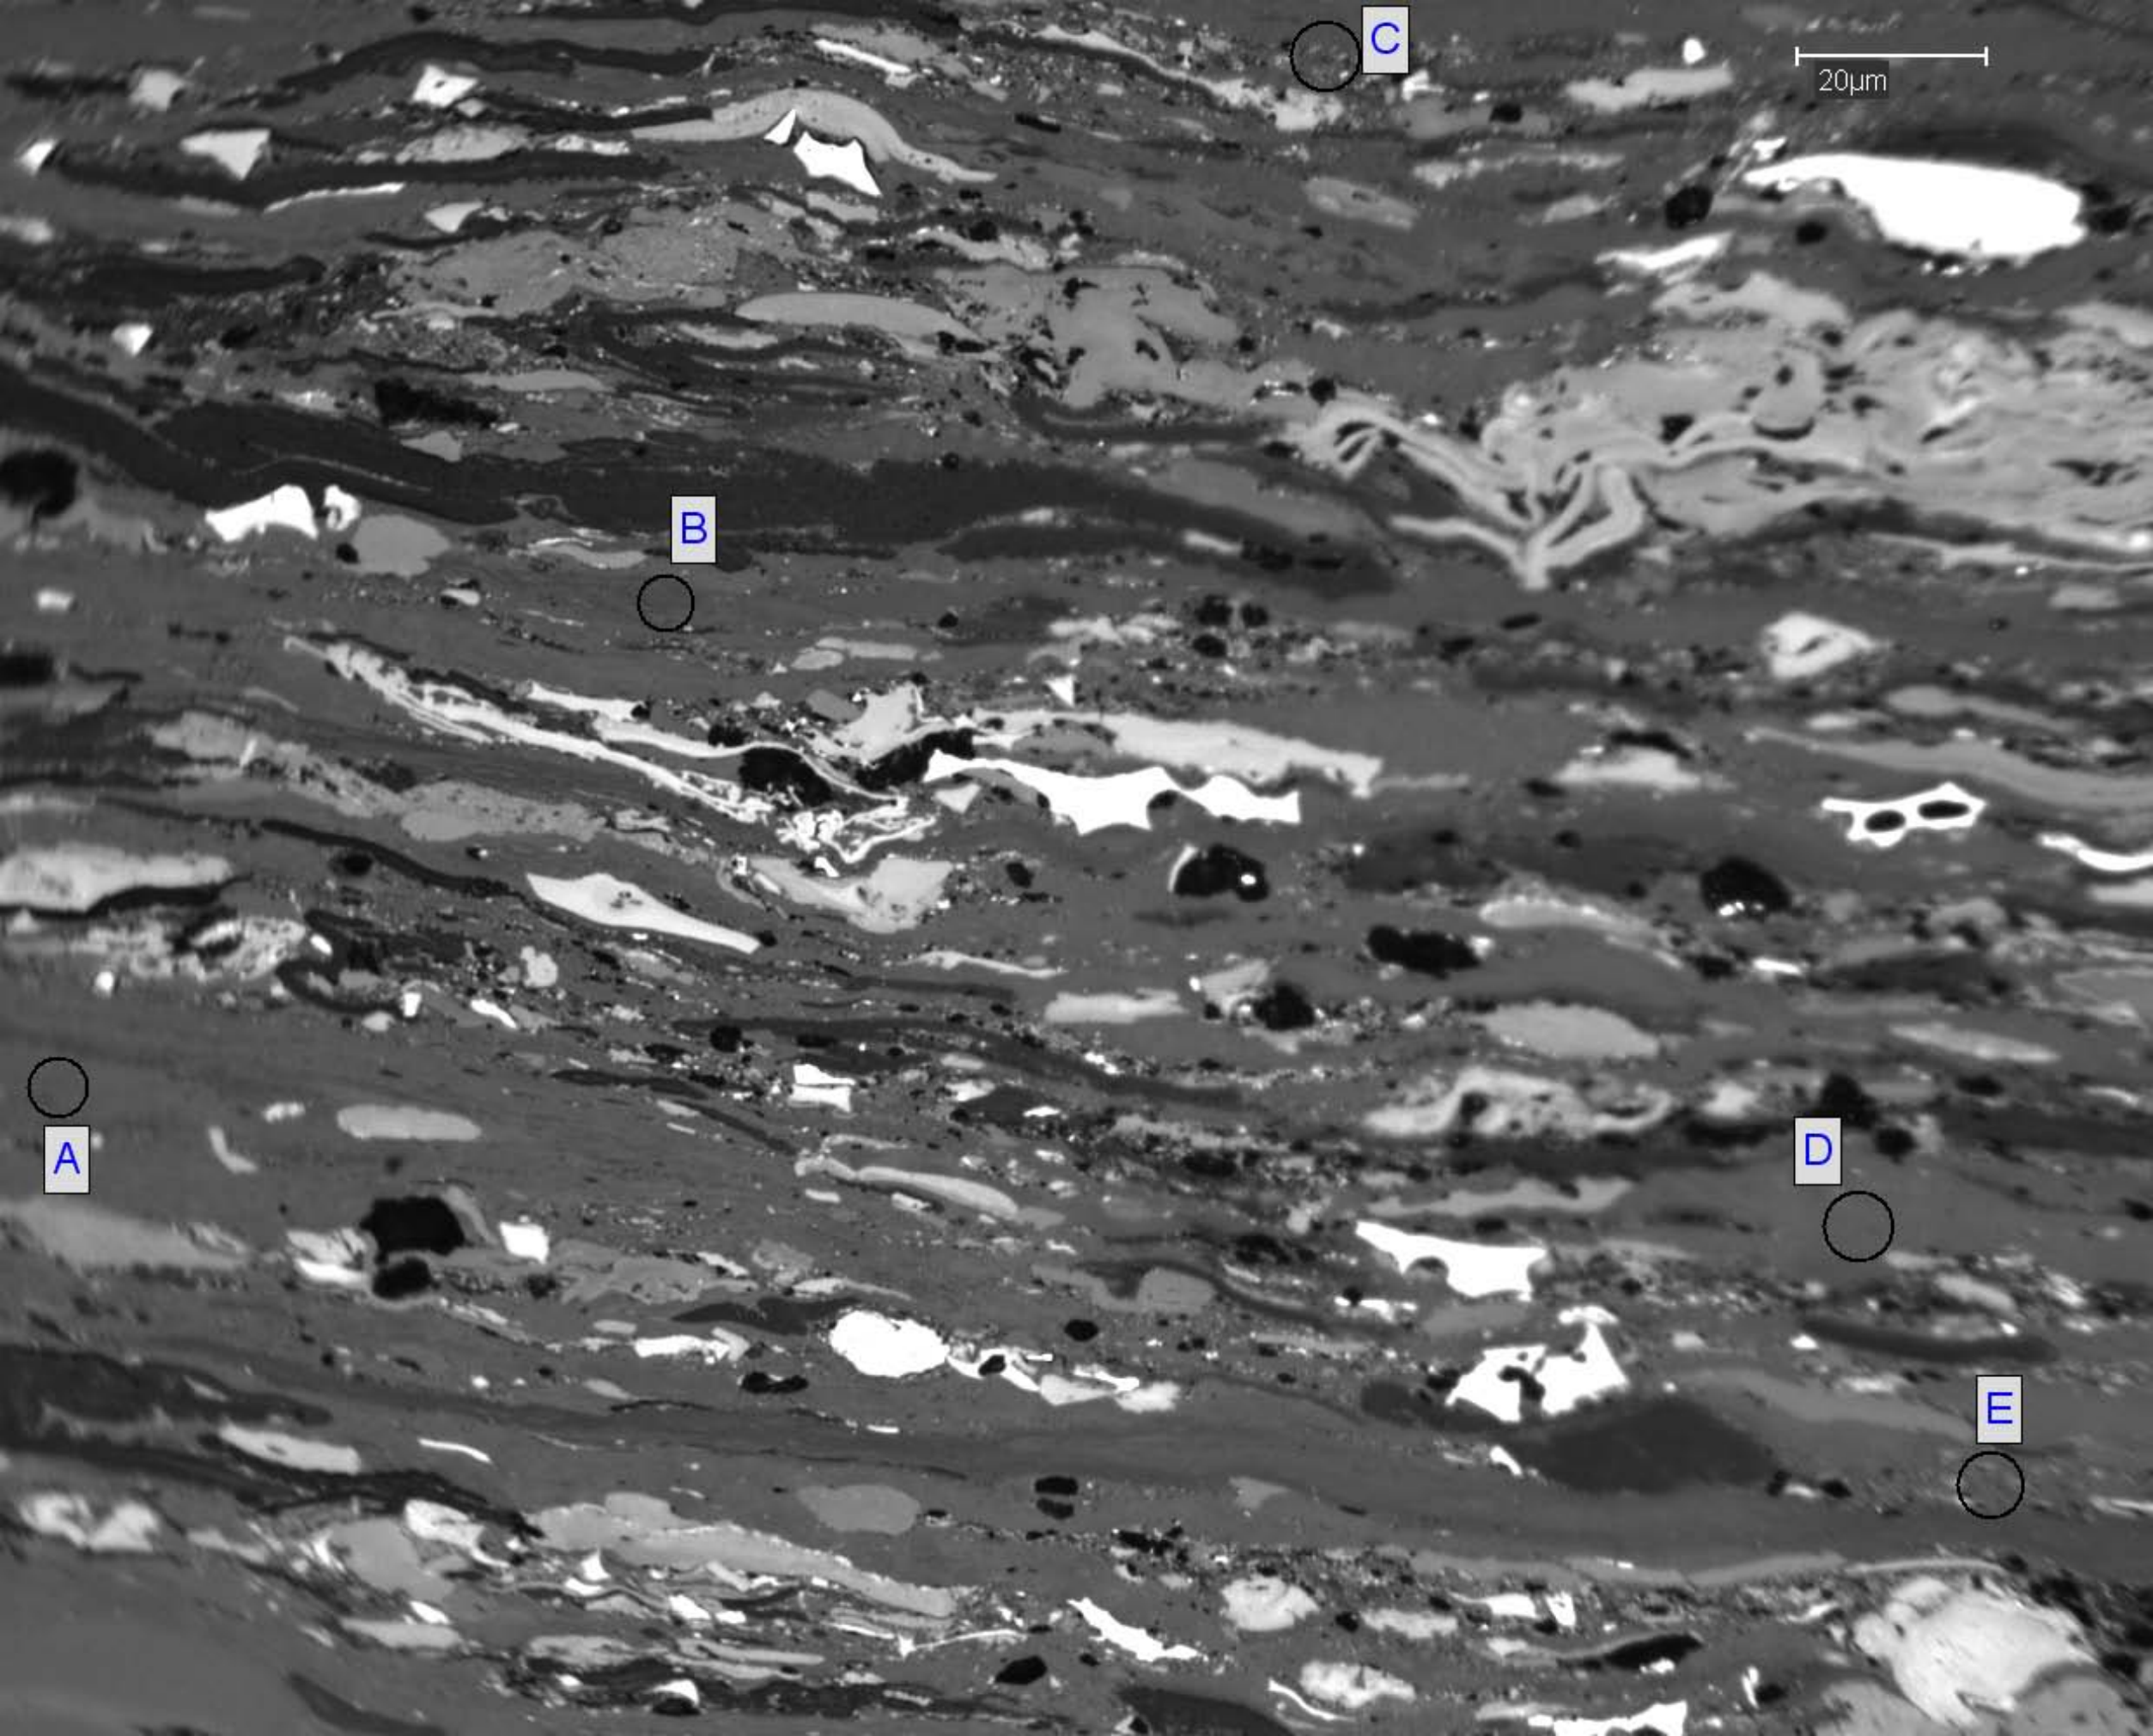

20µm

A

B

C

D

E

20μm


A ○


C ○

E ○

B ○

D ○

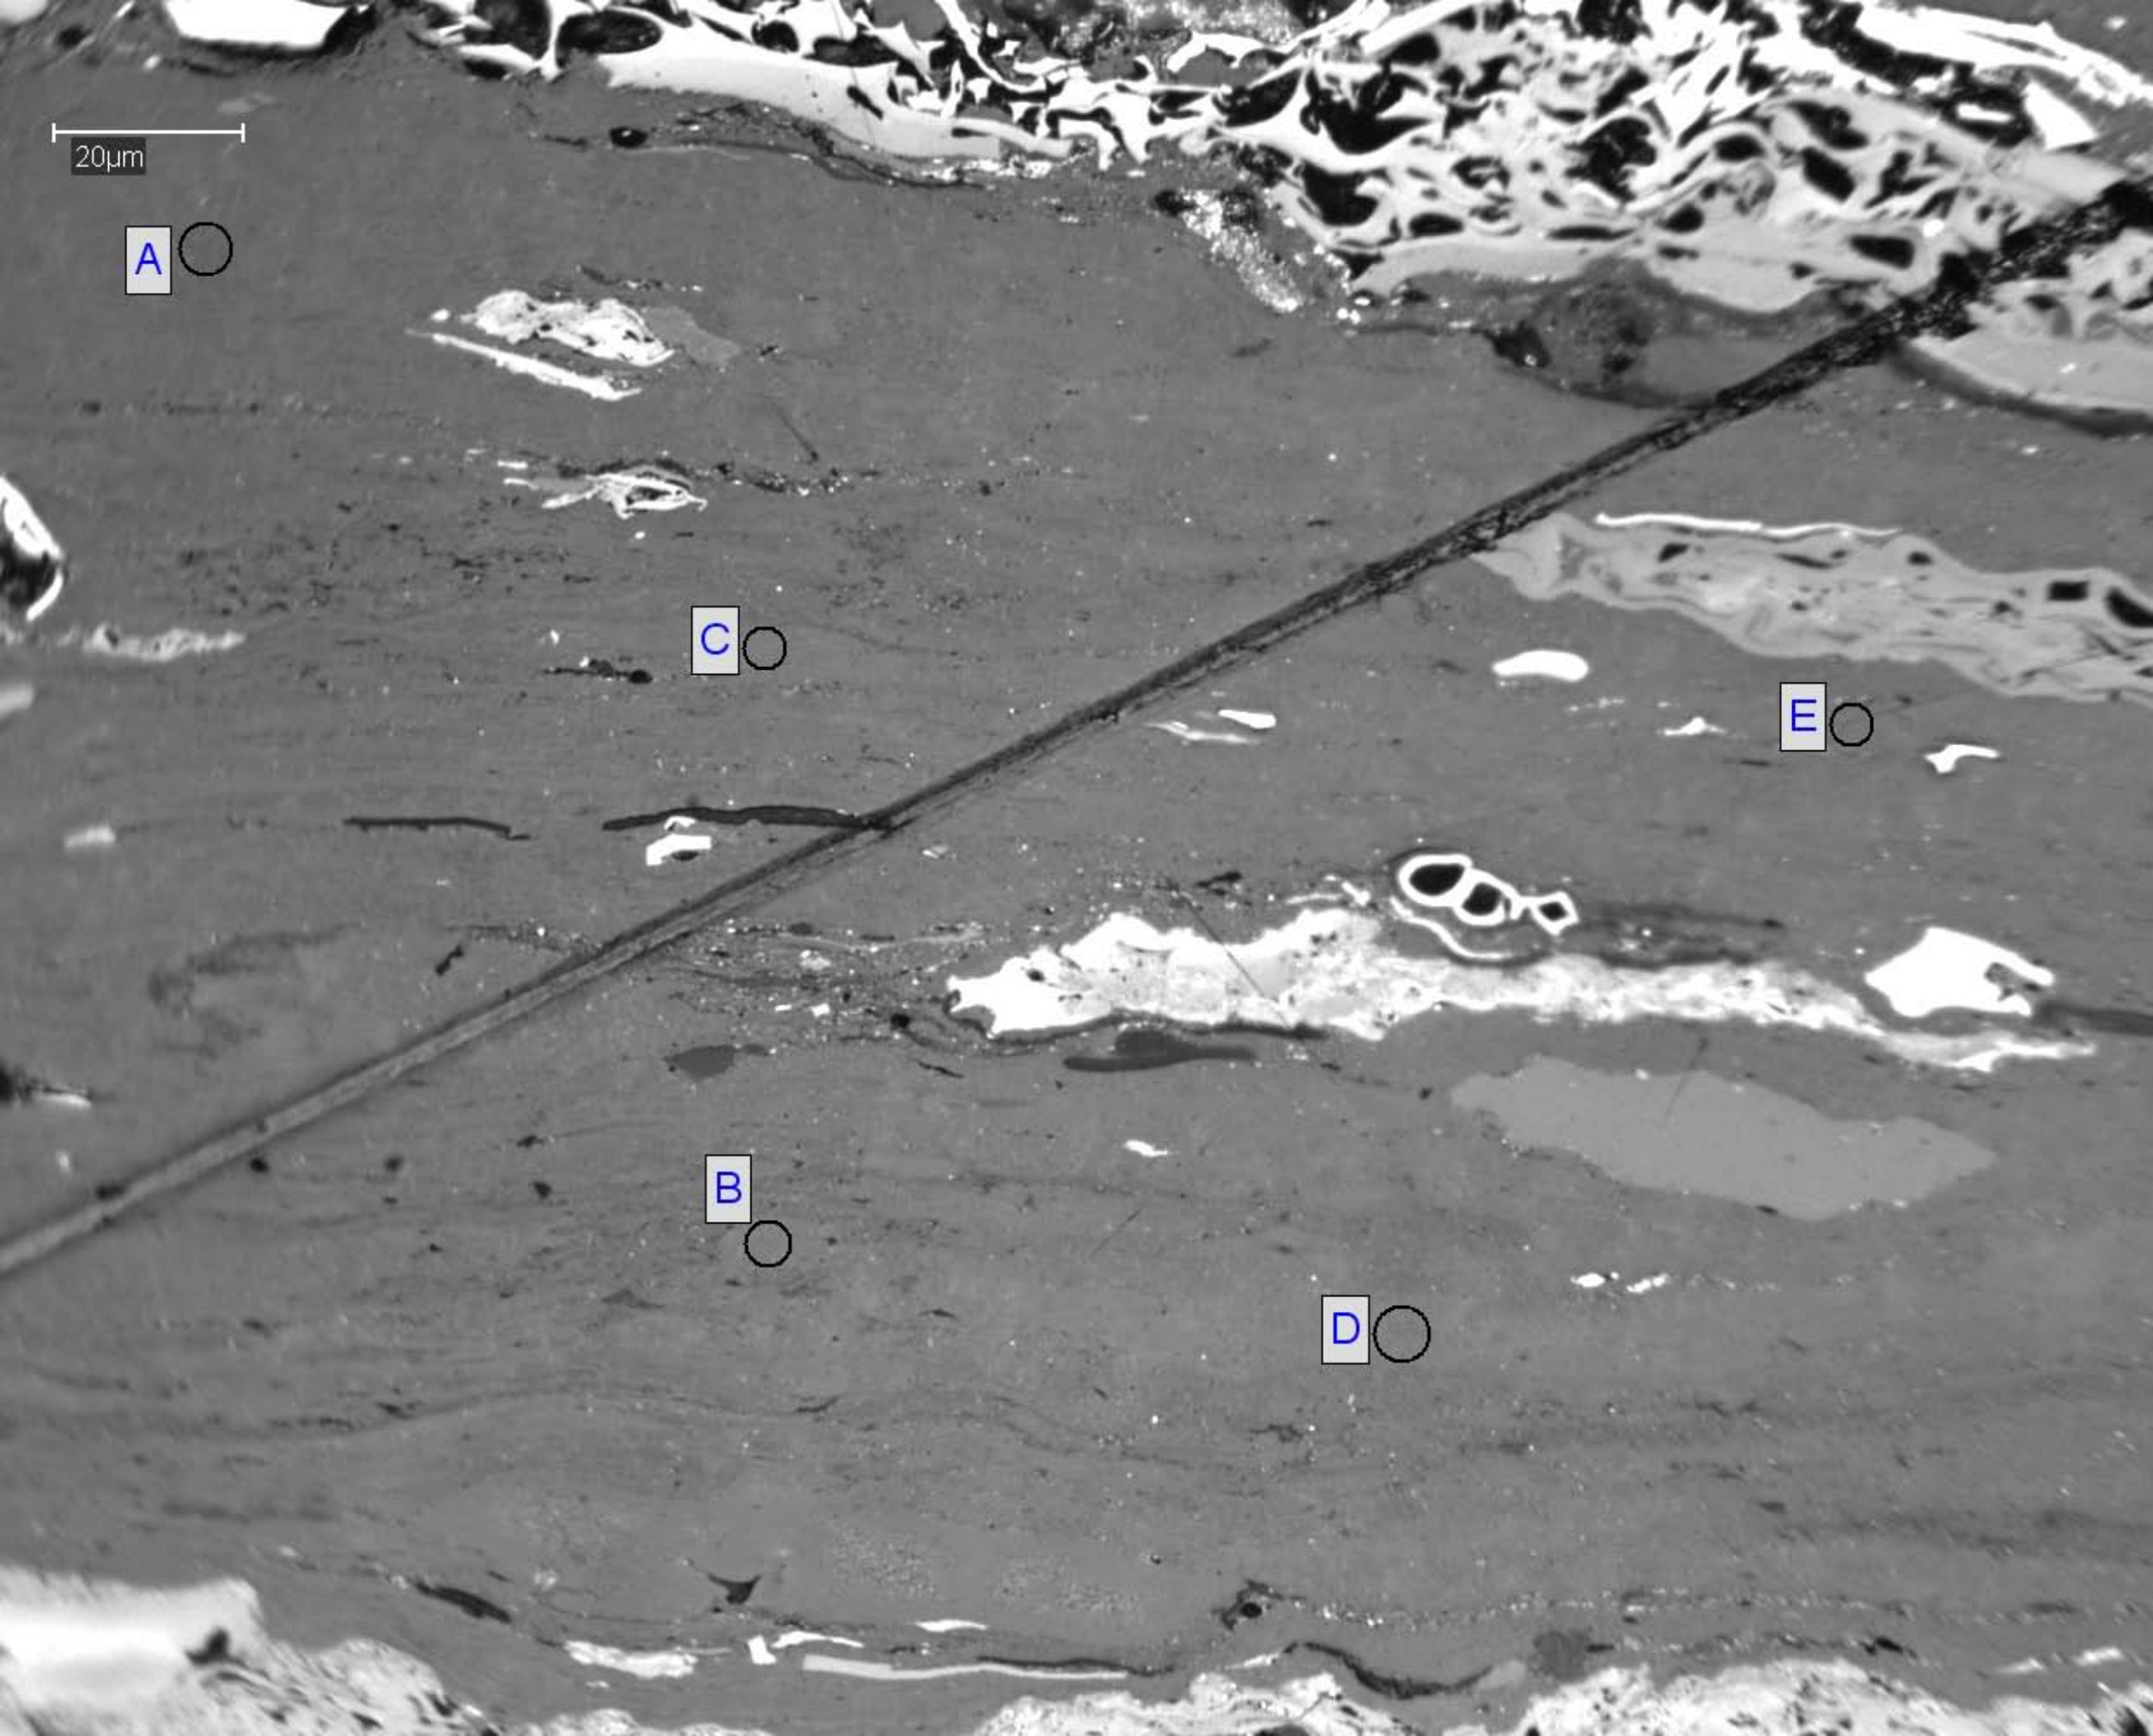

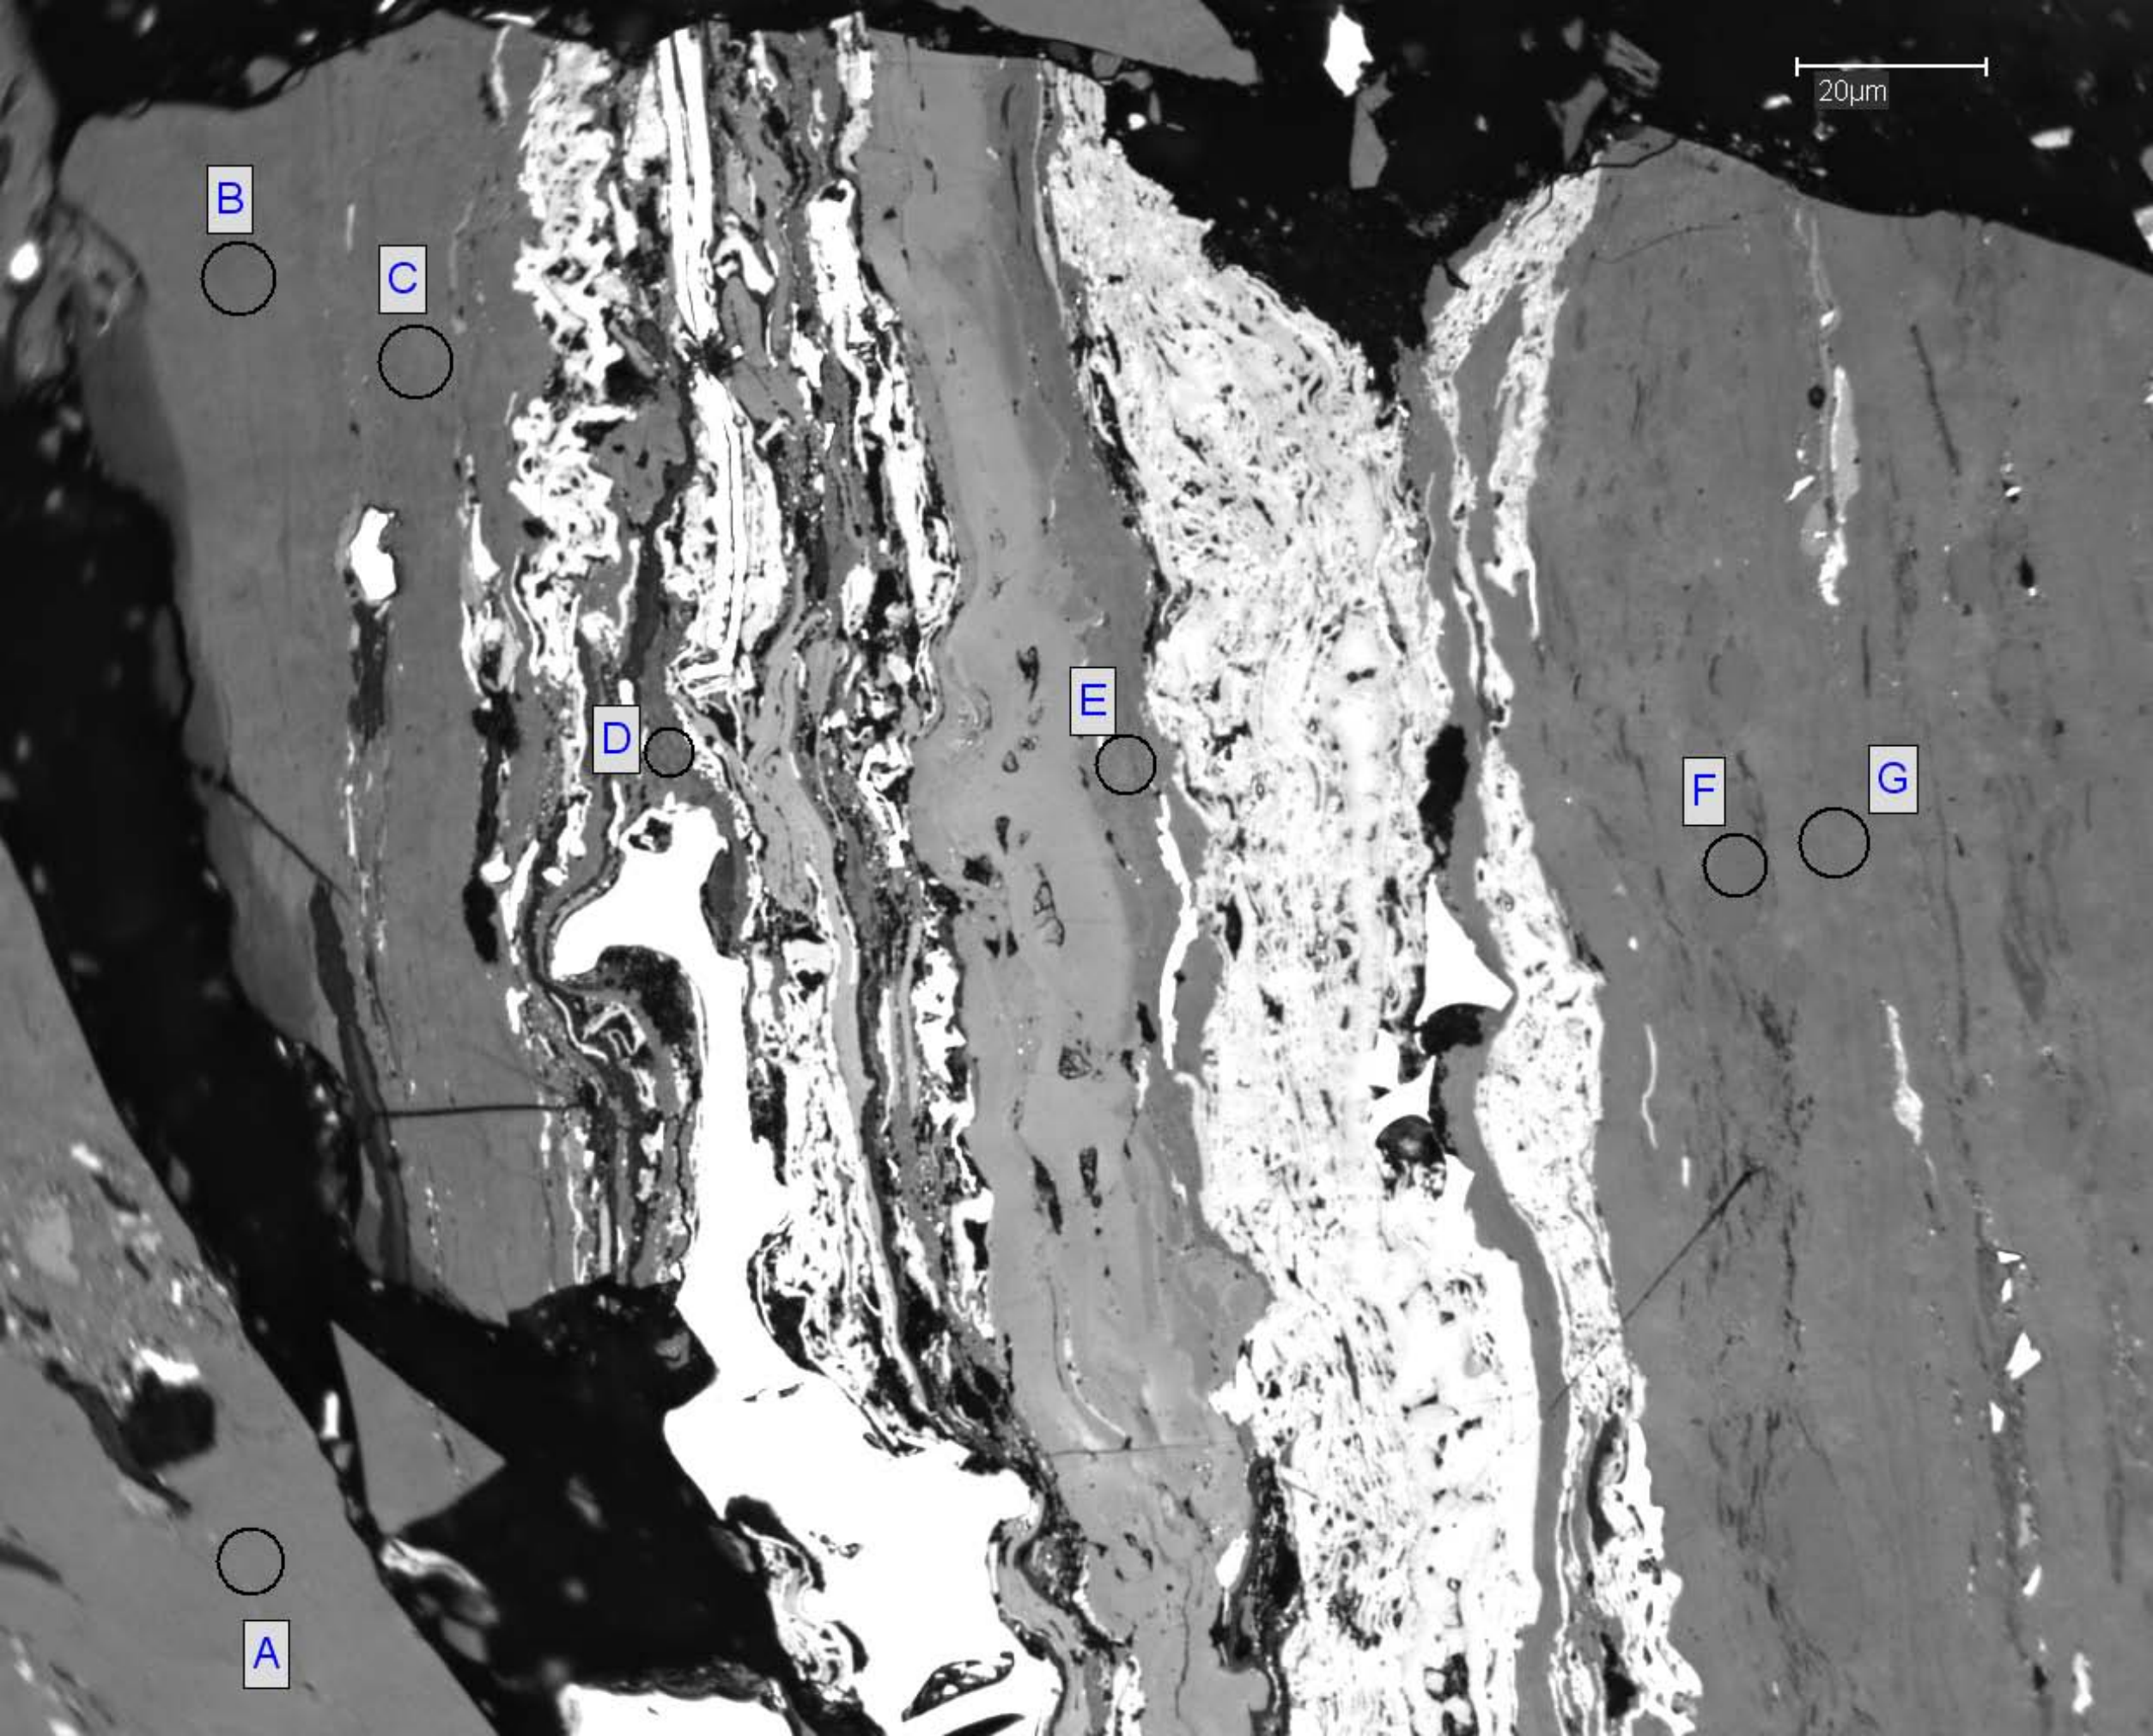

20µm

B



C



D



E



F




G



A



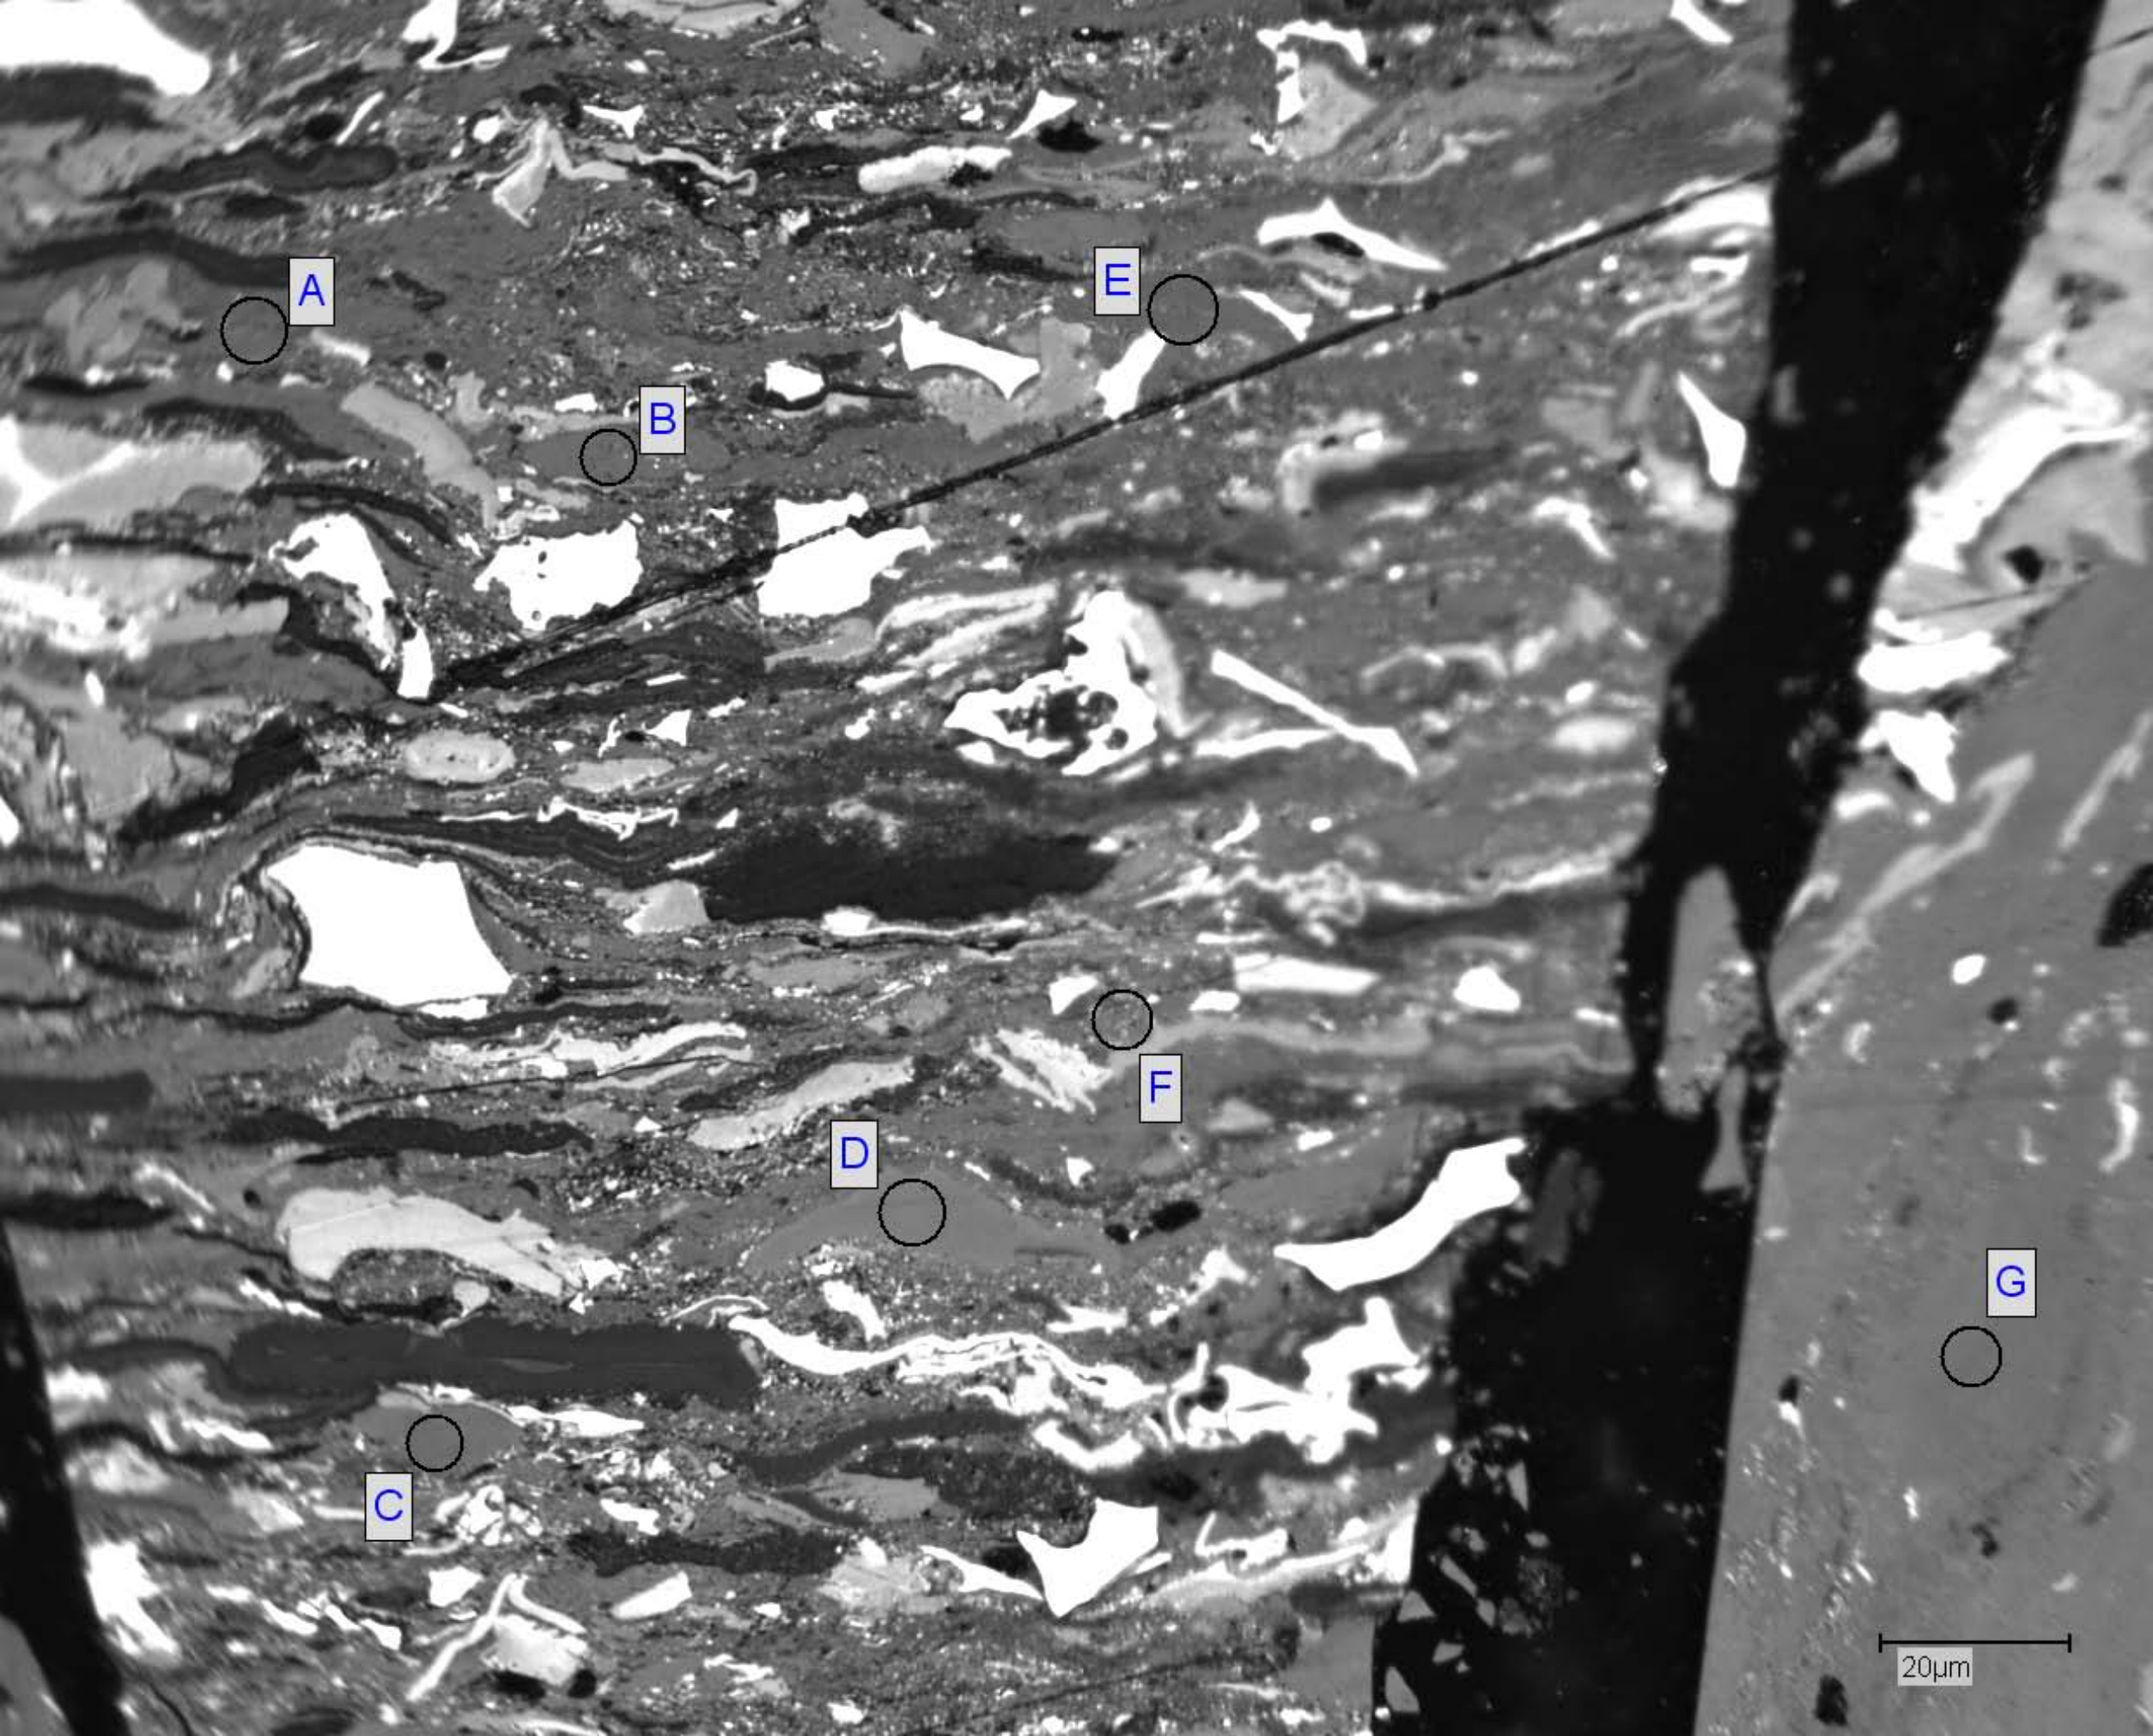

A

E

B

D

F

C

G

20µm

20µm

A



B



C



D



E




F



G



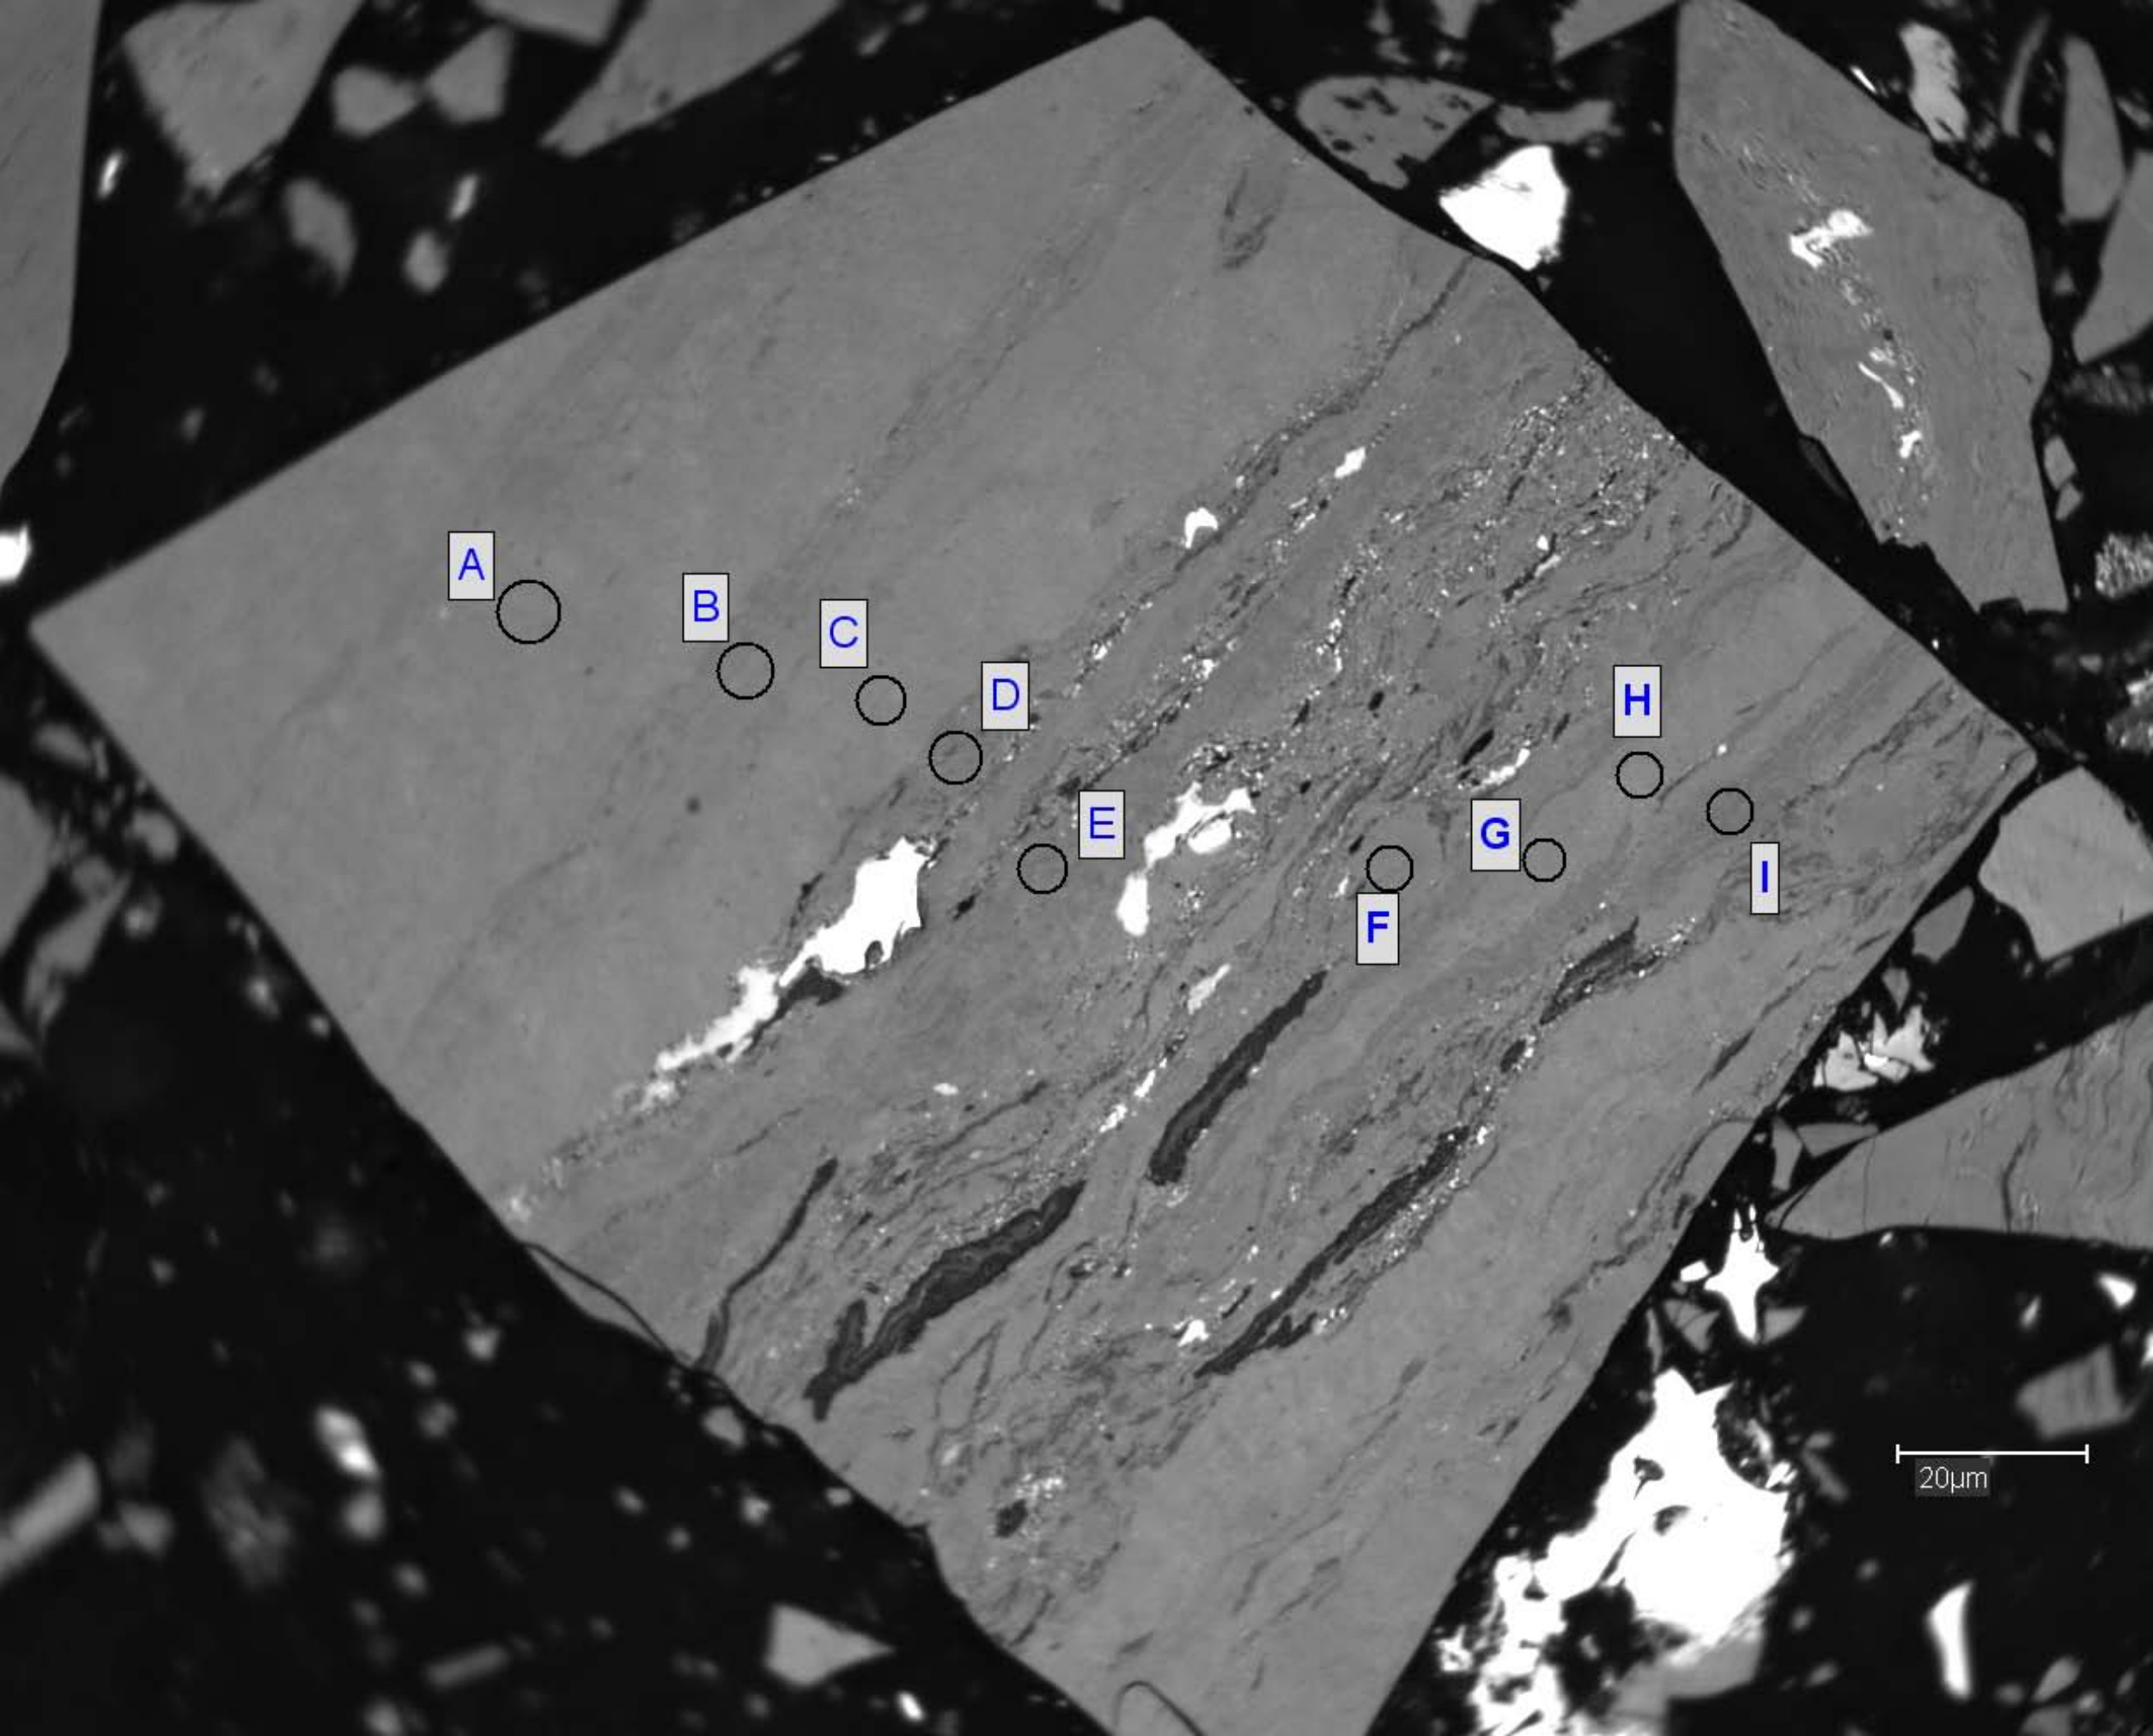

A

B

C

D

E


F

G

H

I

20µm

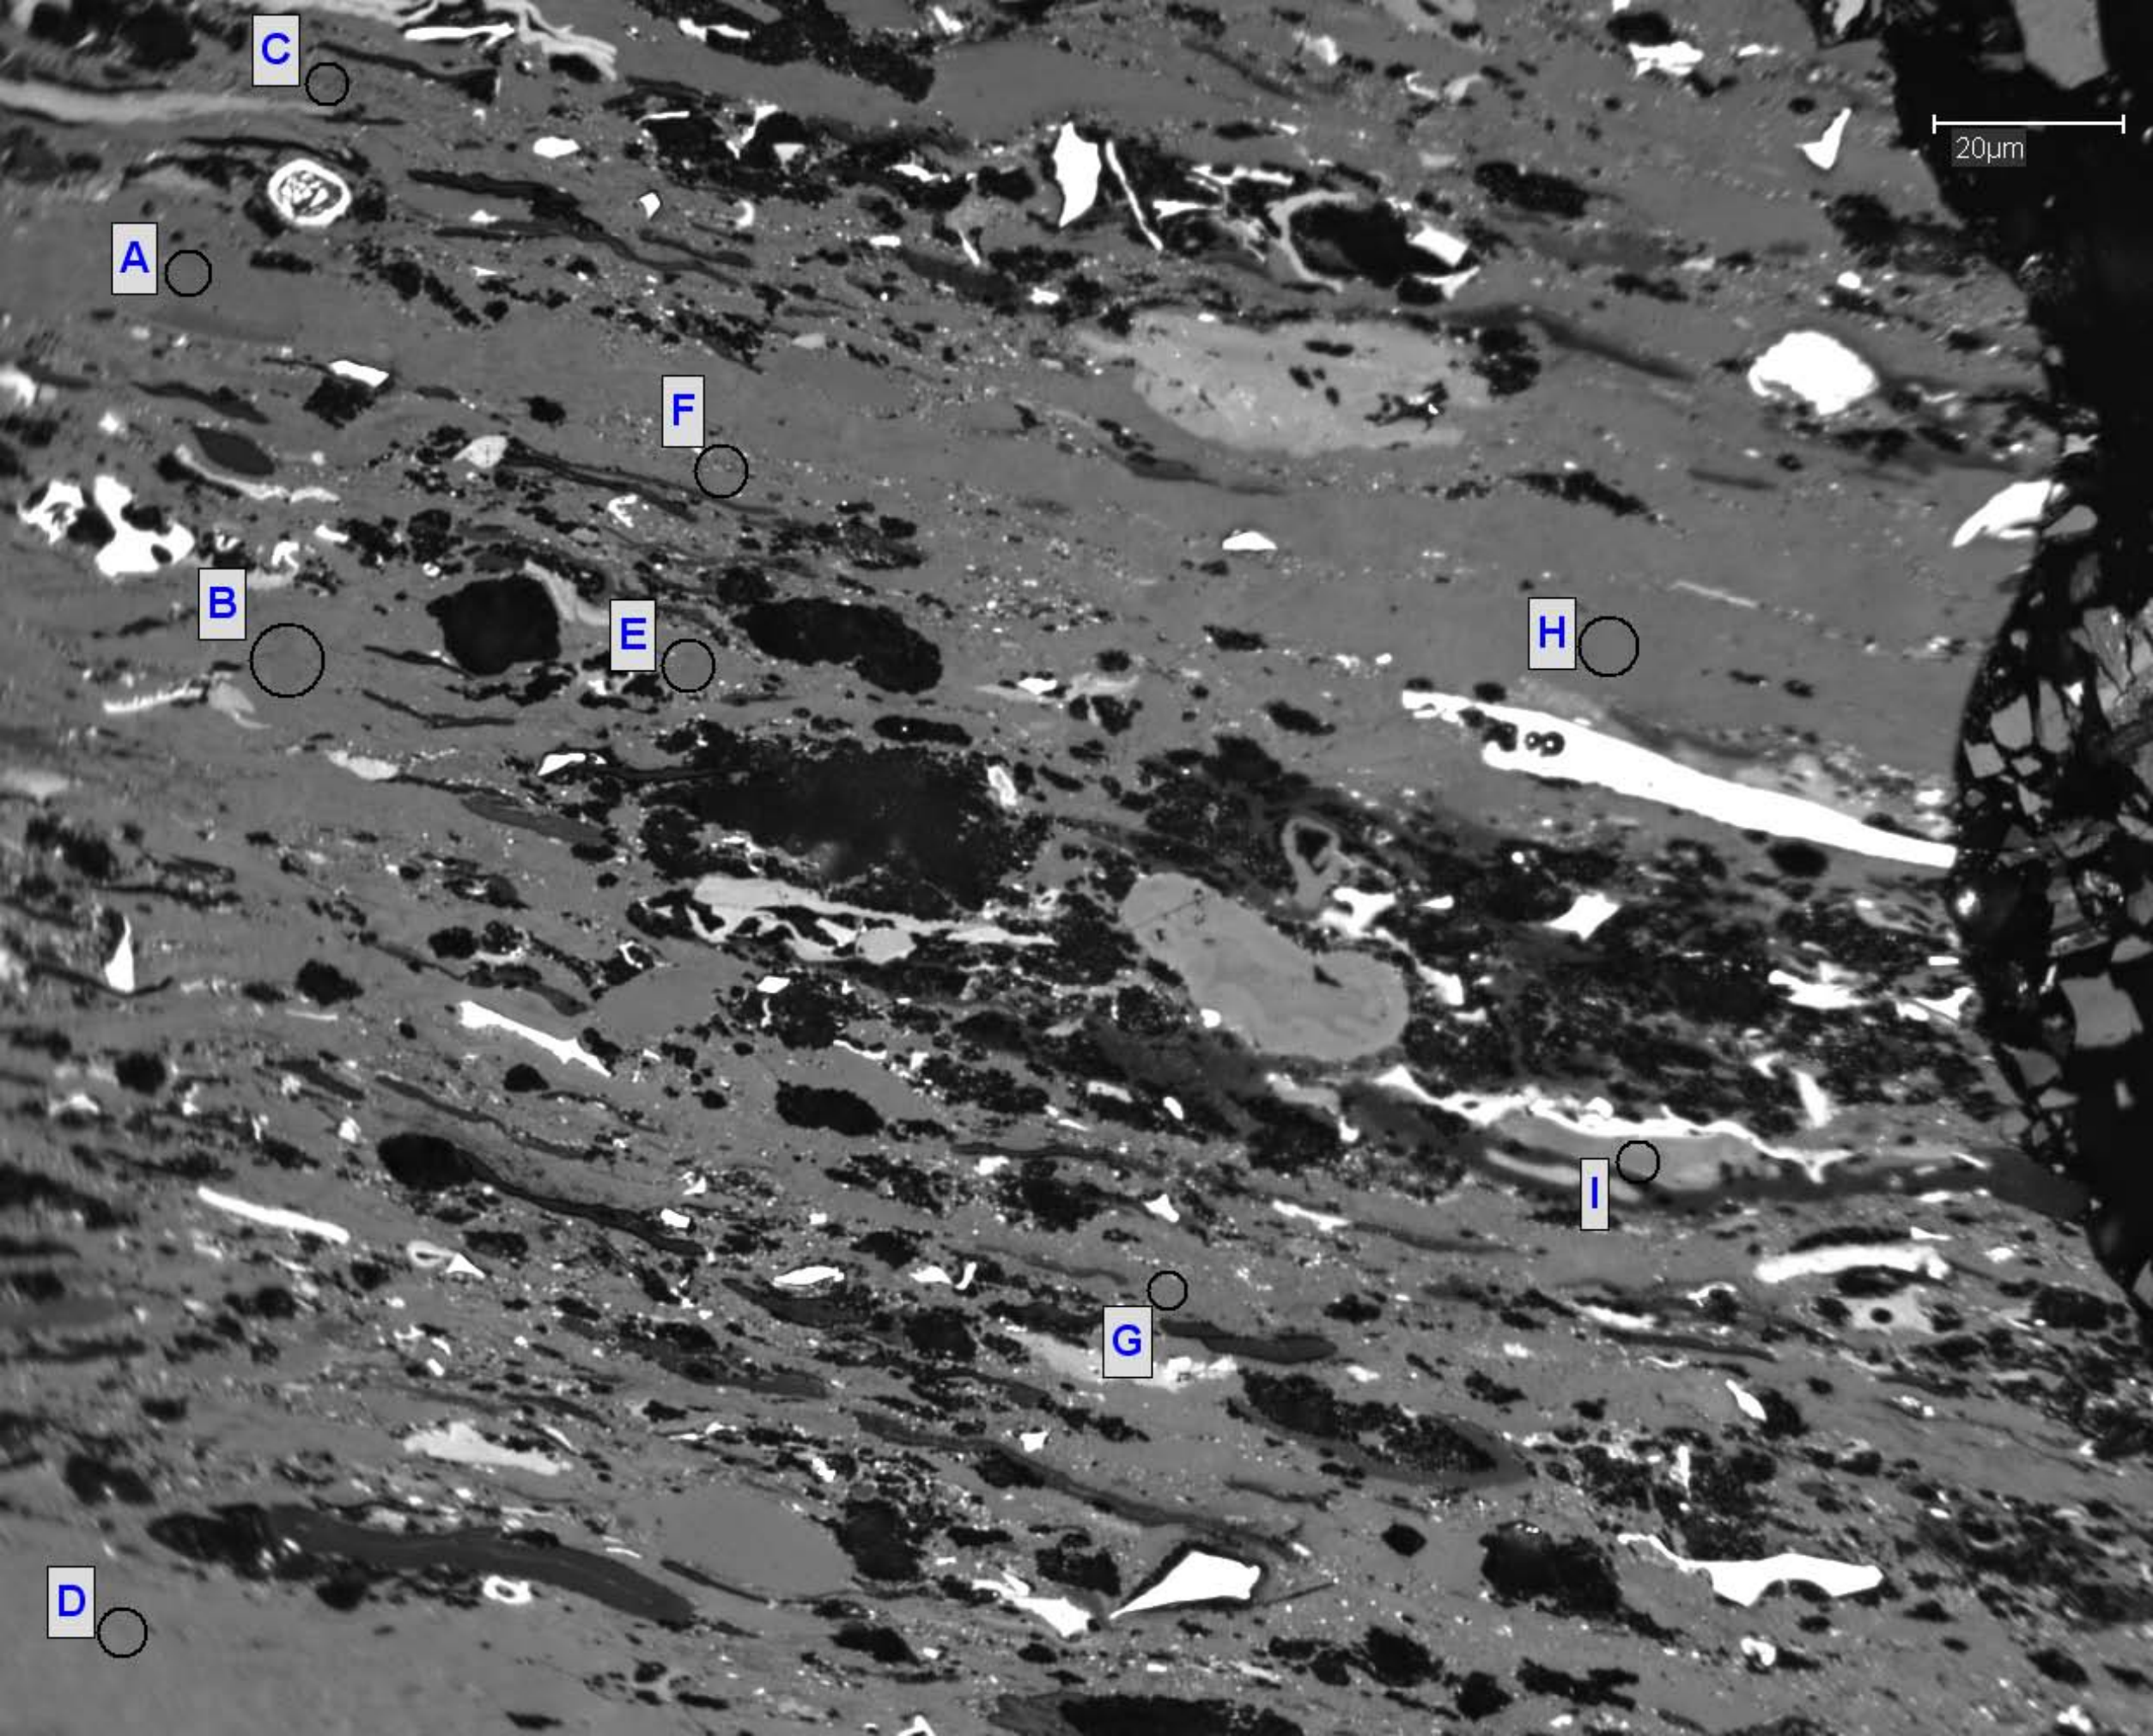

C

20µm

A

F

B

E

H

D

G

I

20µm

A


B


C

D

E

F

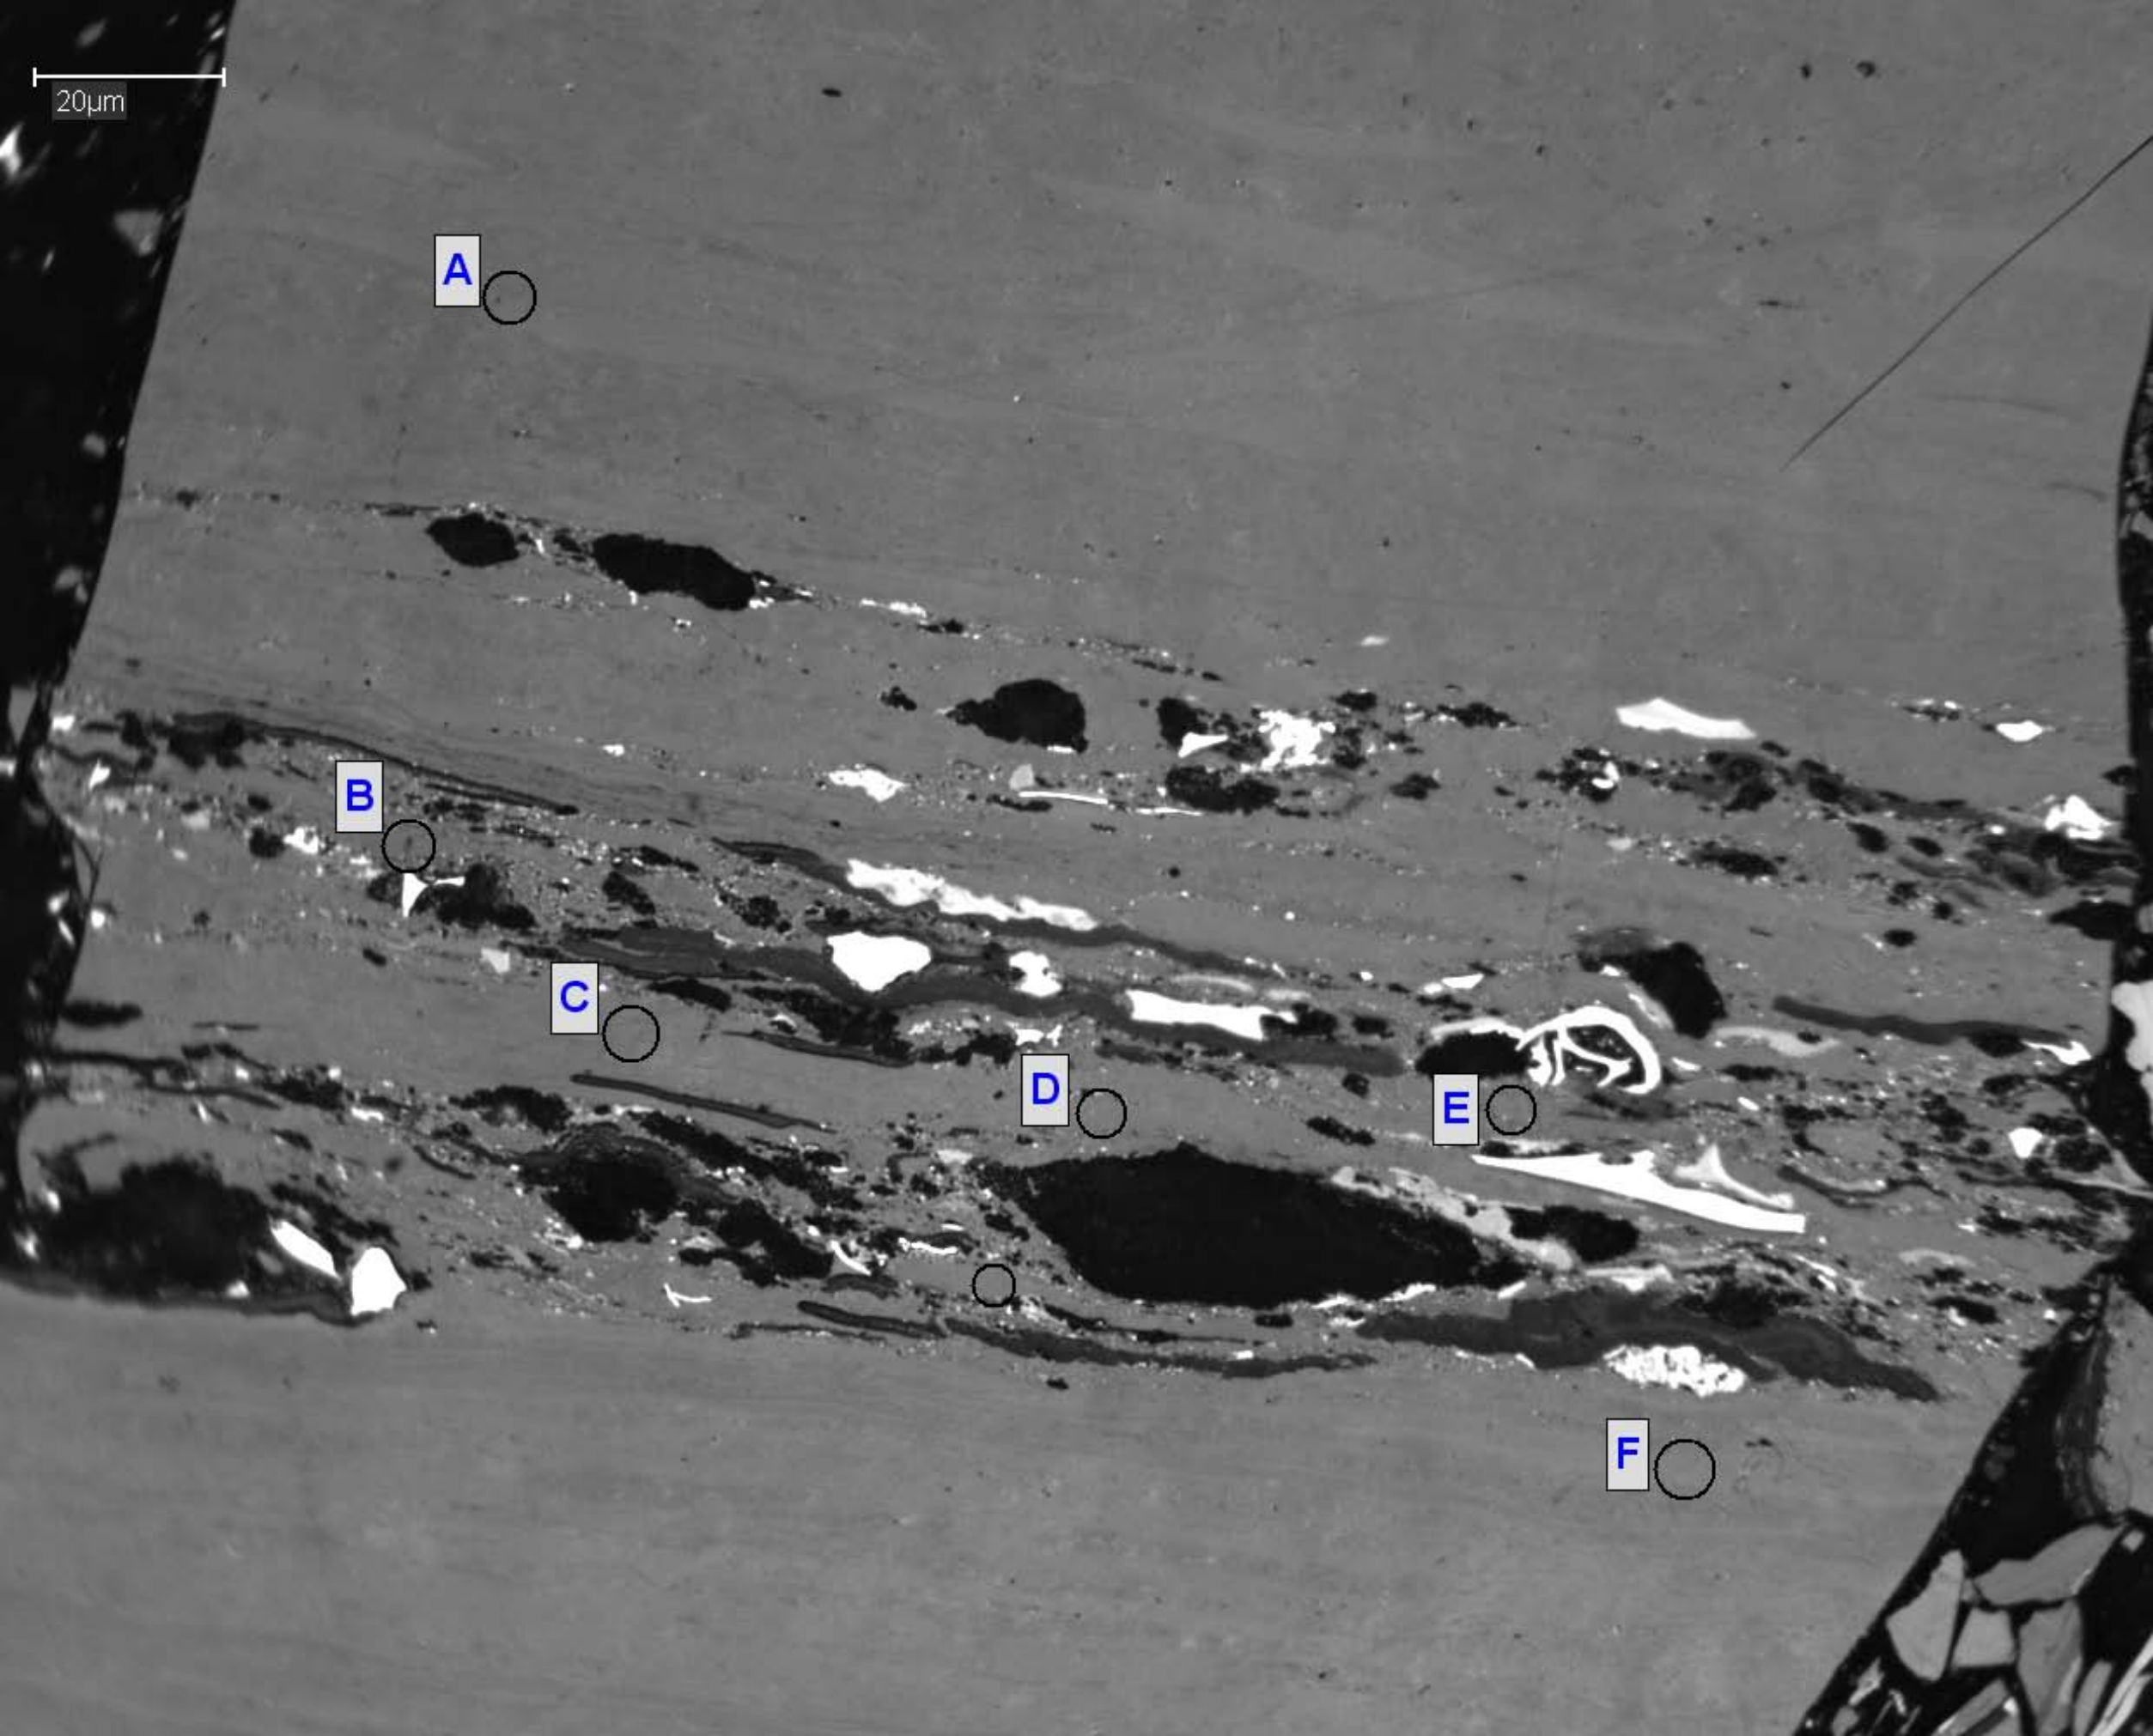

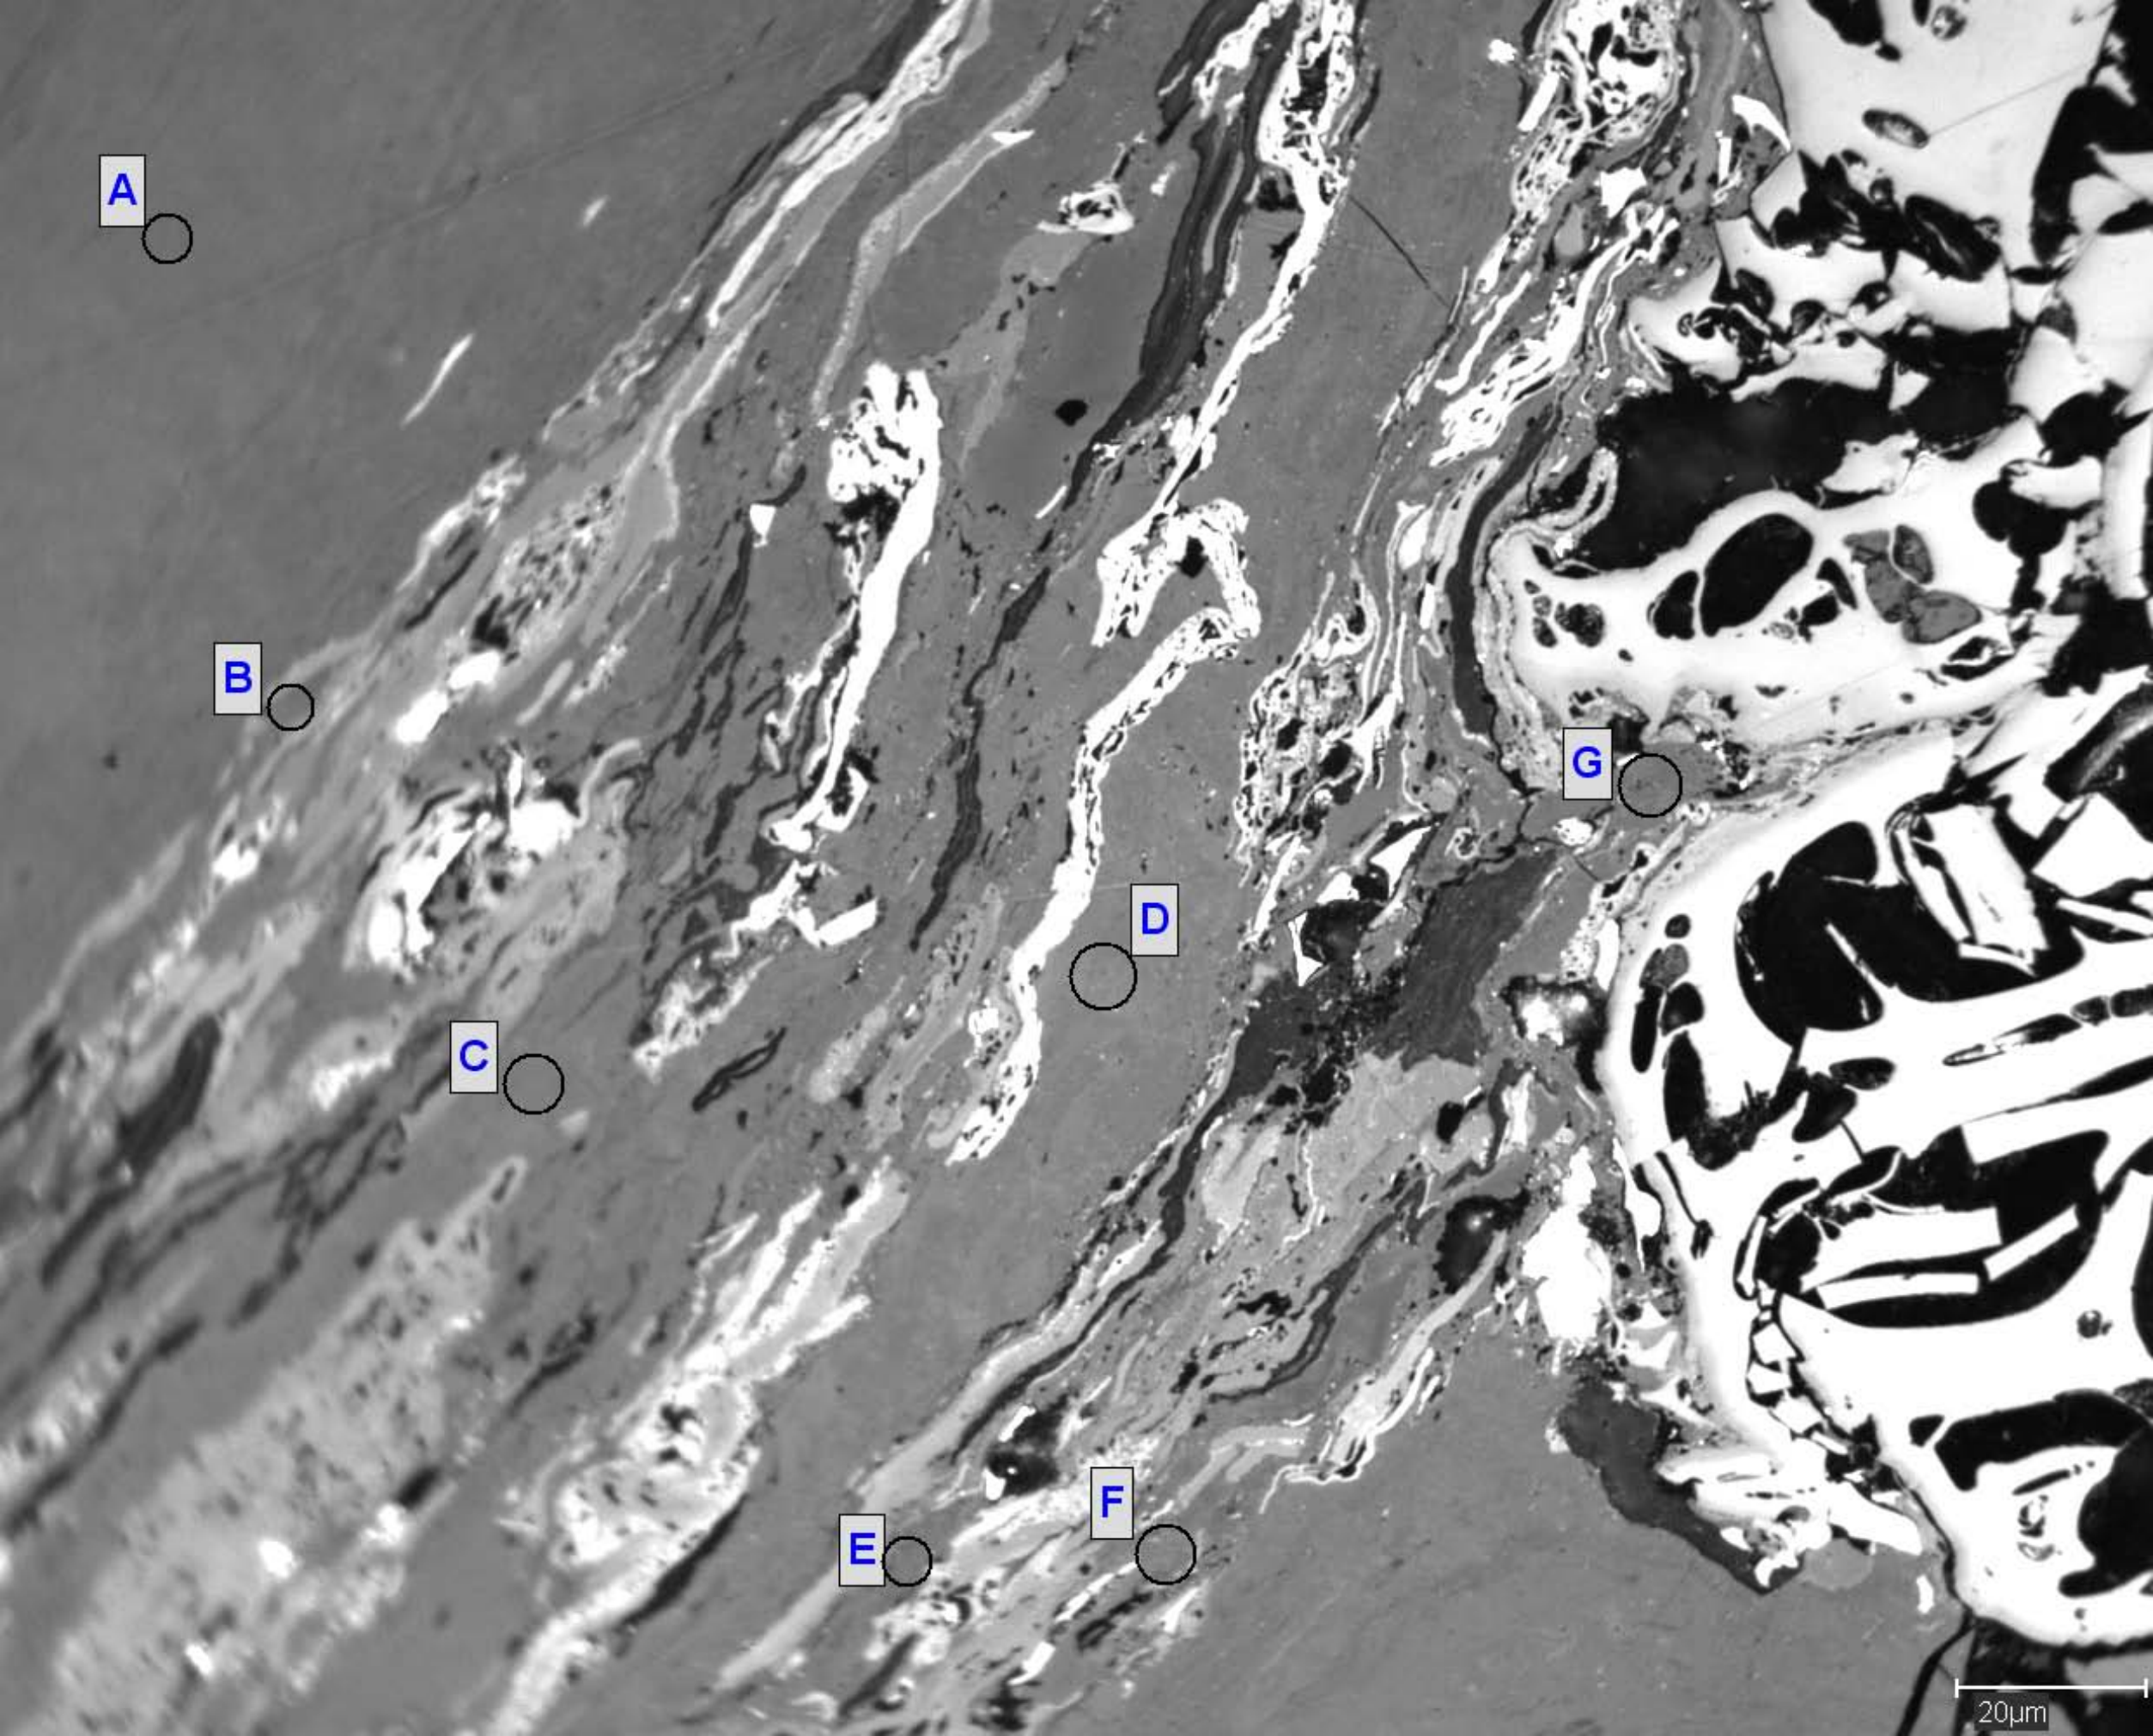

A

B

C

D

E

F

G

20µm

20μm

A



B



C



D



E

